

WETHERBY Wall Systems

Part of ROCKWOOL Group

Wetherby Wall Systems

Steel Frame - Cavity Spacer Rail

Stone Wool with Silicone Render Finish

Low Rise




The following Wetherby EWI detail drawing set is generic and is not be used for a specific project.
Please contact Wetherby Technical to obtain a project specific detail drawing set.

Wetherby Wall Systems Limited

1 Kid Glove Road, Golborne, Greater Manchester, WA3 3GS

Tel: 01942 717100 Fax: 01942 717101 E-mail: technical@wall-systems.co.uk Web: www.wall-systems.co.uk

- Steel Frame & Wetherby Approved Sheathing Board
- Breather Membrane (where specified)
- Wetherby Cavity Spacer Rail creating a cavity behind the insulation board
- Wetherby Approved Mechanical Fixing with 90mm Insulation Washer
- Wetherby Stone Wool Insulation Board
- HECK K+A Scrim Adhesive @ 4-6mm with Alkali Resistant Reinforcing Scrim Cloth
- HECK K+A Scrim Adhesive levelling coat @ 2-3mm
- HECK UG Universal Primer with HECK SHP 4S Silicone Resin Render

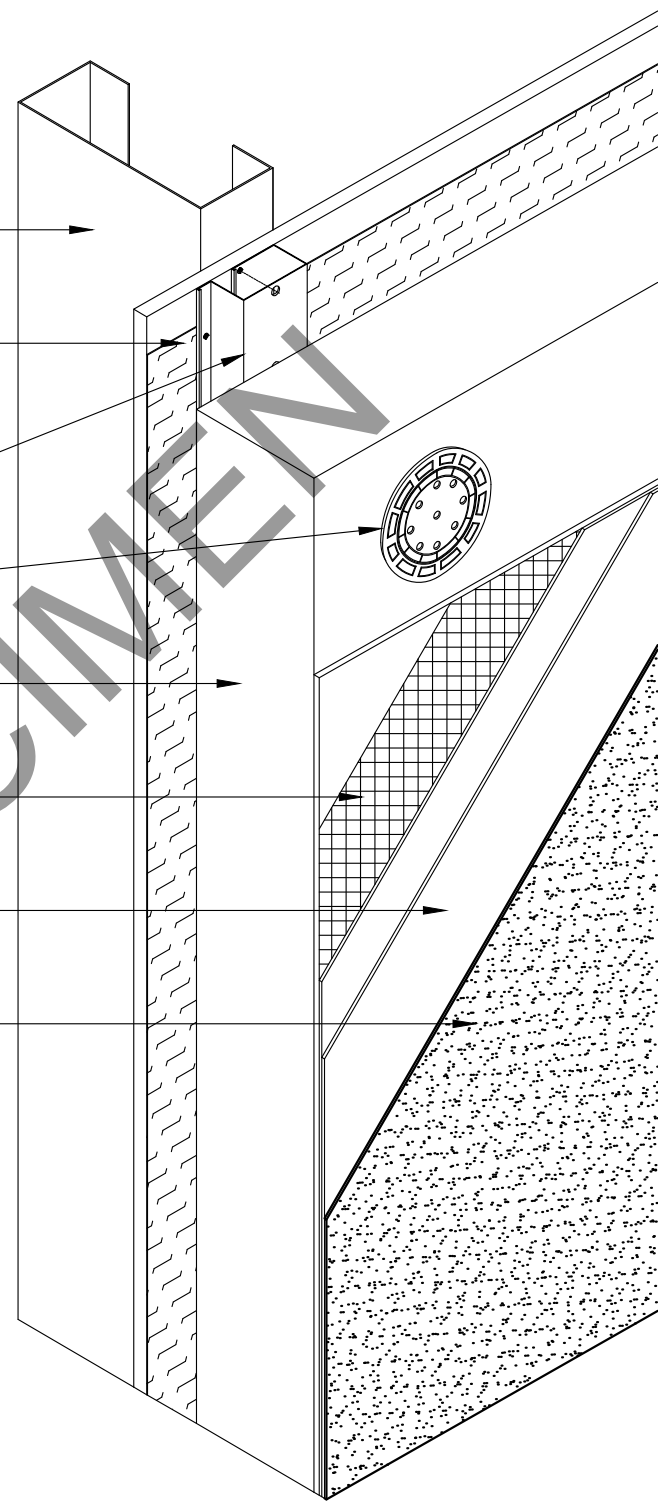

Project Name:
 Typical Details - Stone Wool with Silicone Render

Drawing Title:
 Isometric Detail

Drawing No:
 WWS-EWI-S-RR-SW-SIL-0001

Drawn by: N.K

Checked by: J.R

Revision: -

Scale: NTS

Date: 20.03.2026

Drawing Set: WWS-24

Wetherby Wall Systems Ltd


WETHERBY
 Wall Systems

Part of ROCKWOOL Group

1 Kid Glove Road, Golborne, WA3 3GS
 Tel: 01942 717100 Fax: 01942 717101
 Web: www.wall-systems.co.uk
 E-mail: technical@wall-systems.co.uk
 © WWS-LTD 1998-2025. All rights reserved

Note: The intent of this drawing is to show the correct application of Wetherby products and systems only. All other building elements are shown for illustrative purposes only and it is not intended to detail the building construction. Detail drawings must be read in conjunction with the Wetherby project specific specification with the specification information taking precedence.

LOW RISE

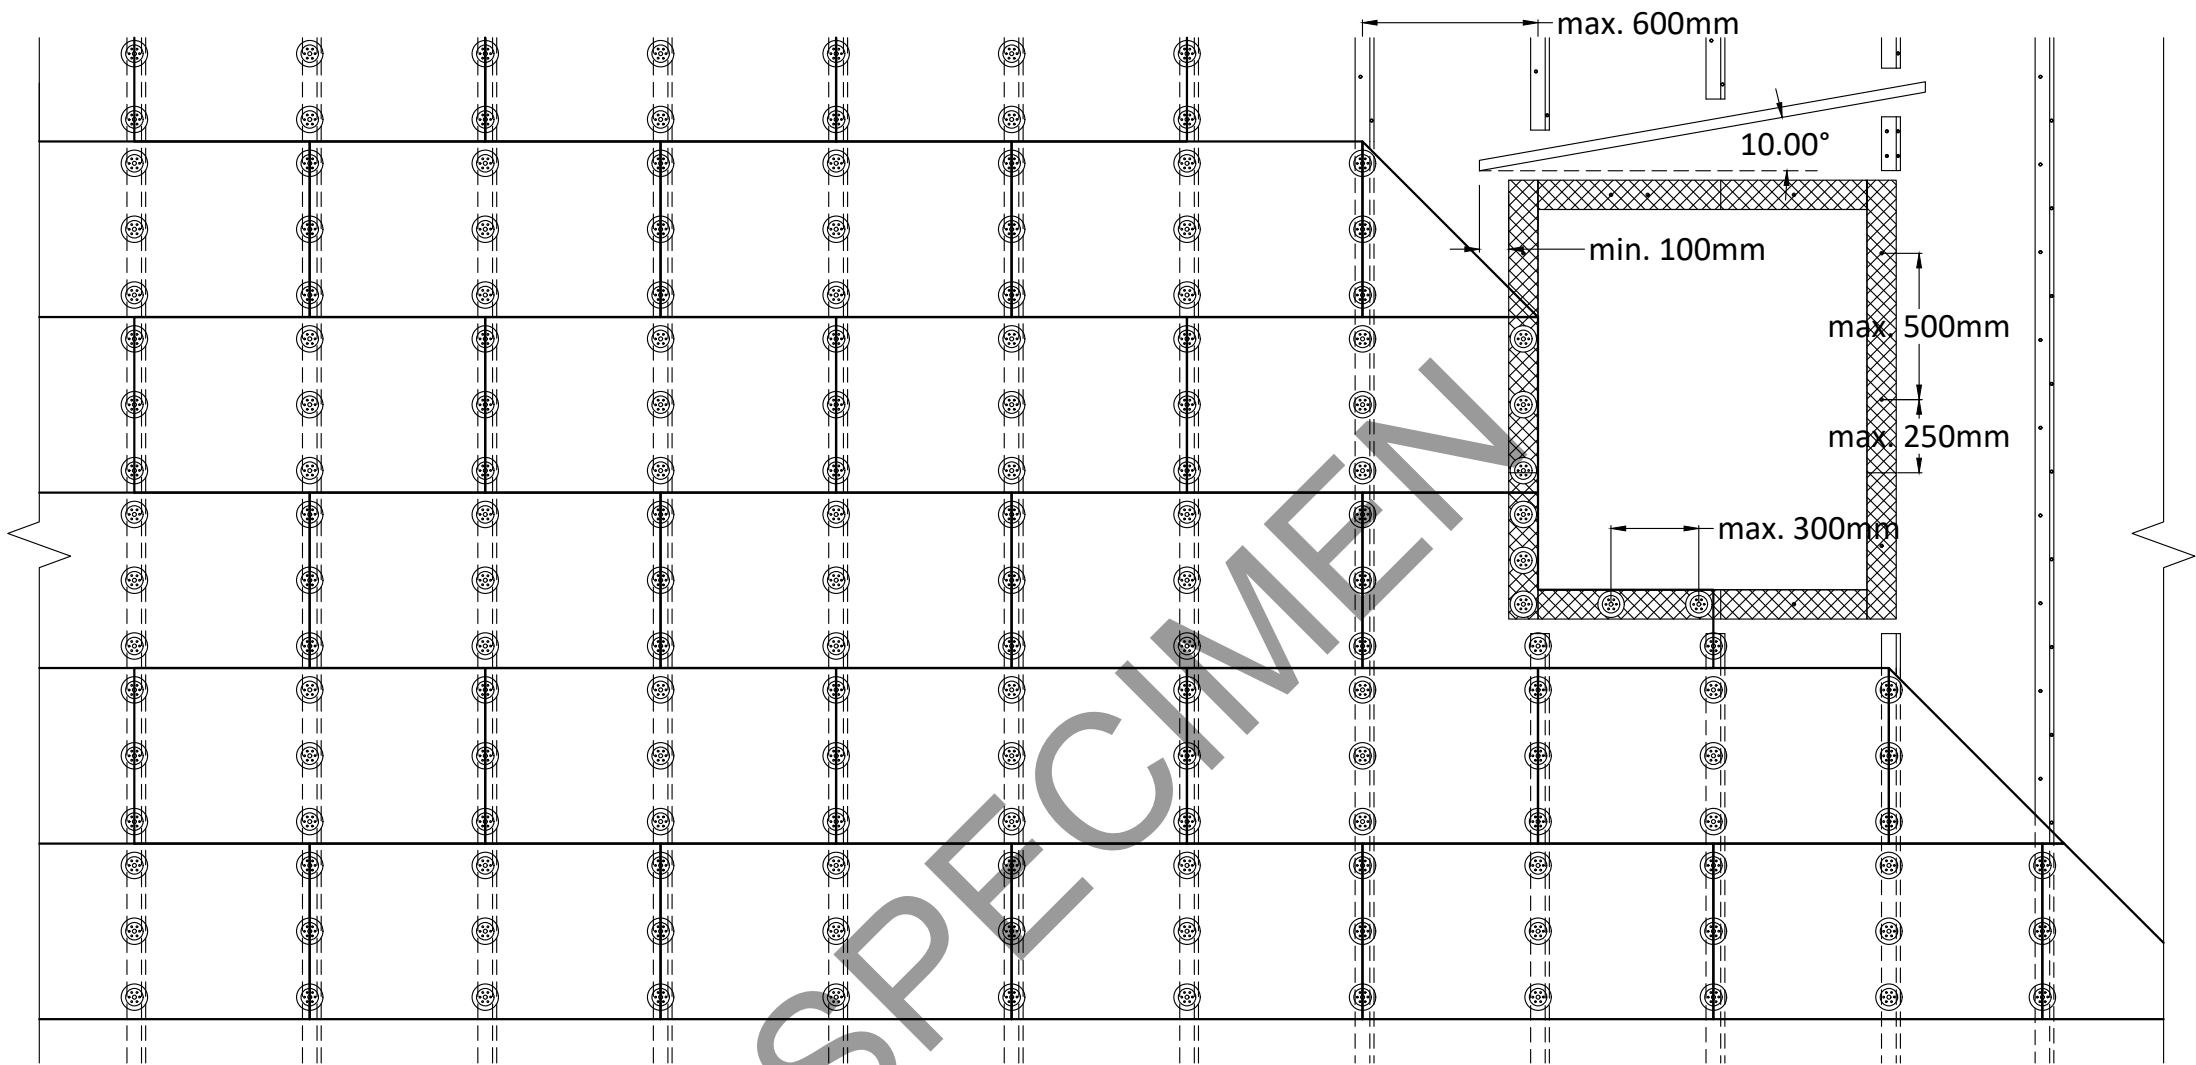

Wetherby Cavity Spacer Rail layout at max. 600mm centres

6 mechanical insulation fixings per insulation board
(3 fixings through the board centre line and 3 half fixings down each side)

Additional fixings required at max. 300mm centres at opening cill and head

Tenmat Non-Ventilated Fire Barrier (NVFB) Closed State Cavity Fire Barrier installed around all openings under
min. 2mm compression and mechanically fixed at max. 500mm centres and max. 250mm from each end

- Notes:**
- 1 - Fixing pattern for Wetherby Stone Wool Insulation shown indicatively only - refer to project specification for fixing pattern. (subject to wind load calculations).
 - 2 - Wetherby Cavity Spacer Rail to be mechanically fixed through the outer leg and through the centre at max. 300mm centres
 - 3 - 15mm rails can be packed out up to 15mm, 25mm rails can be packed out up to 25mm and 50mm rails can be packed out up to 10mm (forming a total max. cavity depth of 60mm). Rails must be securely fixed and stable with each fixing point packed, ensuring rails are suitable to recieve the EWI system and a minimum 15mm cavity must always be maintained.
 - 4- Where packing out is required, fixing lengths must be checked to ensure adequate embedment into the sheathing board / substrate. This must be confirmed on site prior to the installation of the Wetherby system.
 - 5 - Wetherby Deflector Bead to be bedded on Wetherby Approved Silicone Sealant and mechanically fixed at max. 300mm centres above all openings with min. 10° falls, extending min. 100mm either side of the NVFB.
 - 6 - For application to second storey walls and above, an additional stainless steel fire fixing must be installed at a minimum of 1 per m2, through the reinforcing basecoat and mesh layer.
 - 7 - NHBC Standards require that in all cases, an additional stainless steel fire fixing must be installed at a minimum of 1 per insulation board or 1 per m2 (whichever provides the greater number), through the reinforcing basecoat and mesh layer.

Project Name:	Drawn by: N.K
Typical Details - Stone Wool with Silicone Render	Checked by: J.R
Drawing Title:	Revision: -
Fixing Pattern Detail	Scale: NTS
Drawing No:	Date: 20.03.2026
WWS-EWI-S-RR-SW-SIL-0002	Drawing Set: WWS-24

Wetherby Wall Systems Ltd

WETHERBY

Wall Systems

Part of ROCKWOOL Group


1 Kid Glove Road, Golborne, WA3 3GS

Tel: 01942 717100 Fax: 01942 717101

Web: www.wall-systems.co.uk

E-mail: technical@wall-systems.co.uk

© WWS-LTD 1998-2025. All rights reserved

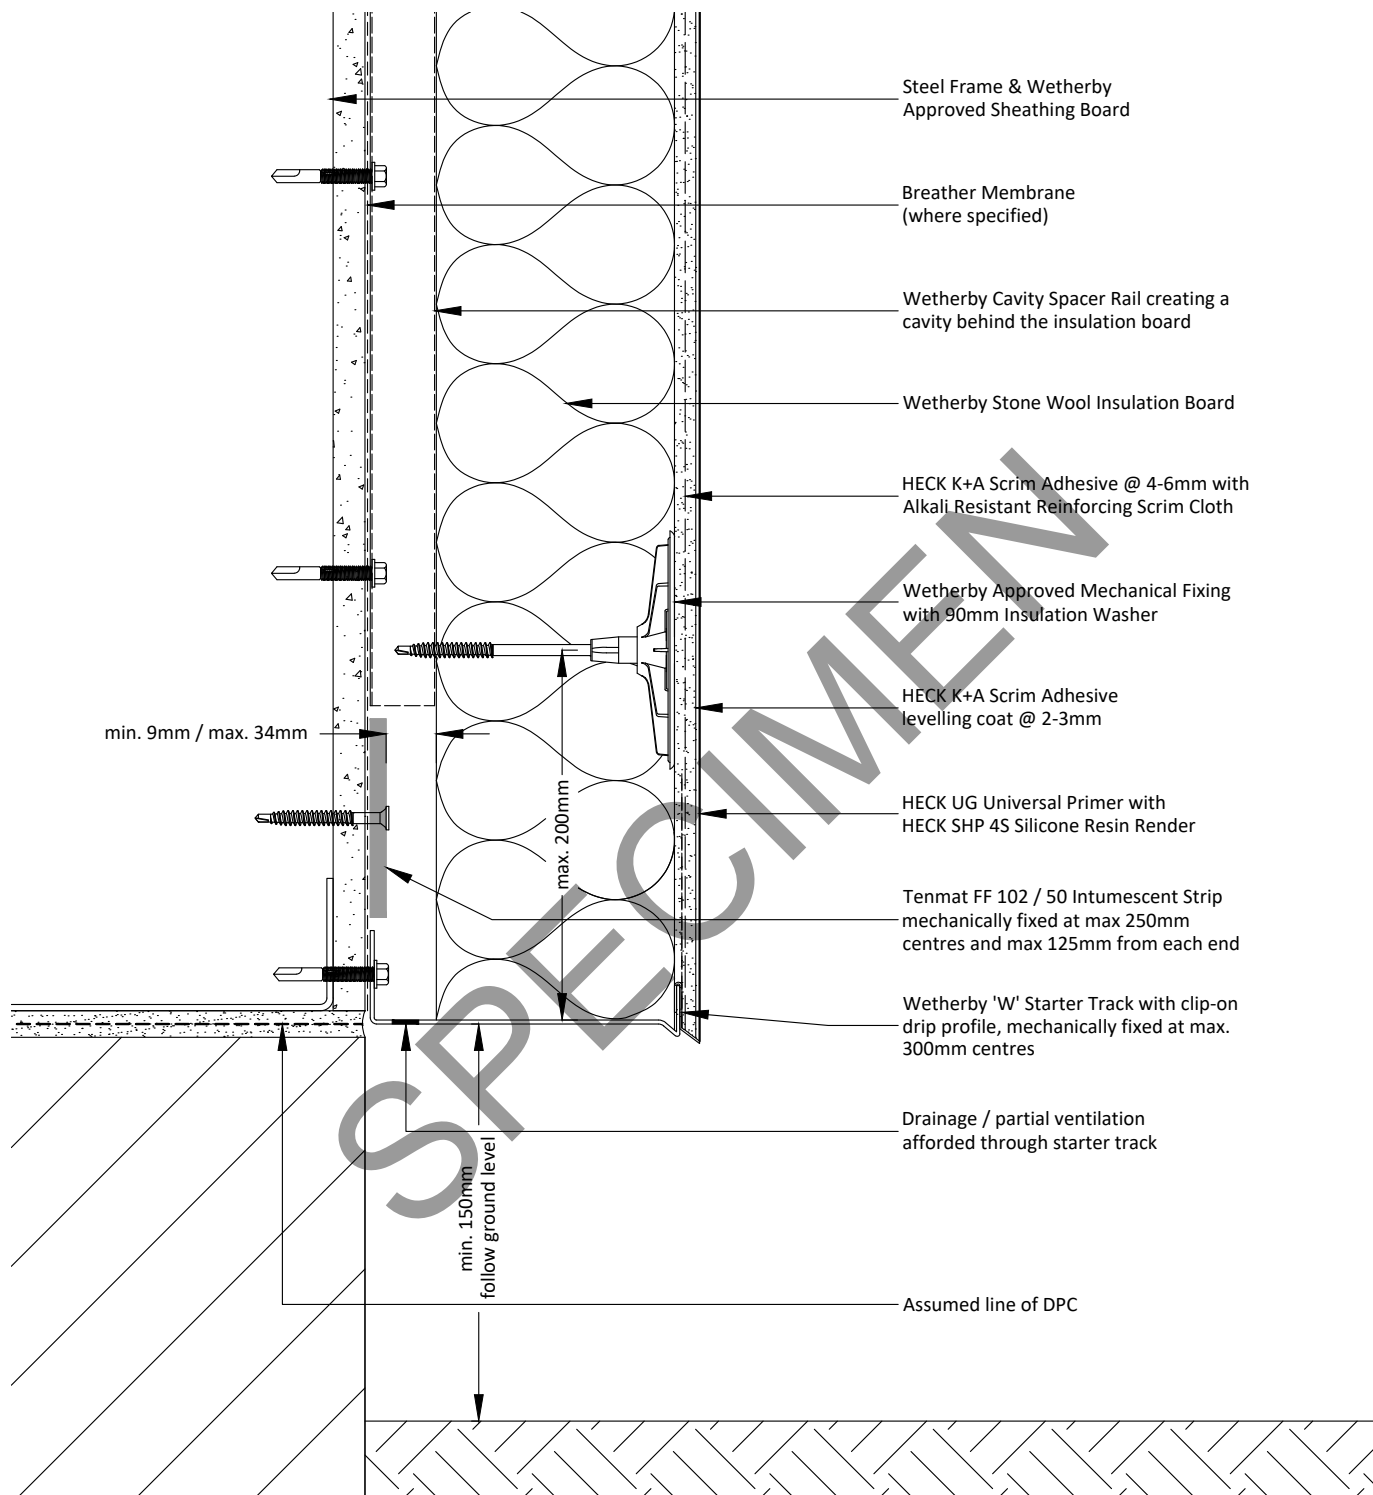

Notes:

- 1 - DPC must not be bridged.
- 2 - Detail creates a potential cold bridge. To be assessed and agreed specific to individual property.
- 3 - Detail may not be acceptable on PAS projects due to potential cold bridge.
- 4 - Intumescent Strip position / requirements to be confirmed subject to project specific detailing. A minimum 9mm and maximum 34mm cavity must be maintained when measured from the front of the intumescent strip and rear of the insulation board. Contact Wetherby Technical Department for further guidance.

Project Name:

Typical Details - Stone Wool with Silicone Render

Drawing Title:

Standard Base Detail (Intumescent Strip)

Drawing No:

WWS-EWI-S-RR-SW-SIL-1000

Drawn by: N.K

Checked by: J.R

Revision: -

Scale: NTS

Date: 20.03.2026

Drawing Set: WWS-24

Wetherby Wall Systems Ltd

WETHERBY
Wall Systems Part of ROCKWOOL Group

1 Kid Glove Road, Golborne, WA3 3GS


Tel: 01942 717100 Fax: 01942 717101

Web: www.wall-systems.co.uk

E-mail: technical@wall-systems.co.uk

© WWS-LTD 1998-2025. All rights reserved

Note: The intent of this drawing is to show the correct application of Wetherby products and systems only. All other building elements are shown for illustrative purposes only and it is not intended to detail the building construction. Detail drawings must be read in conjunction with the Wetherby project specific specification with the specification information taking precedence.

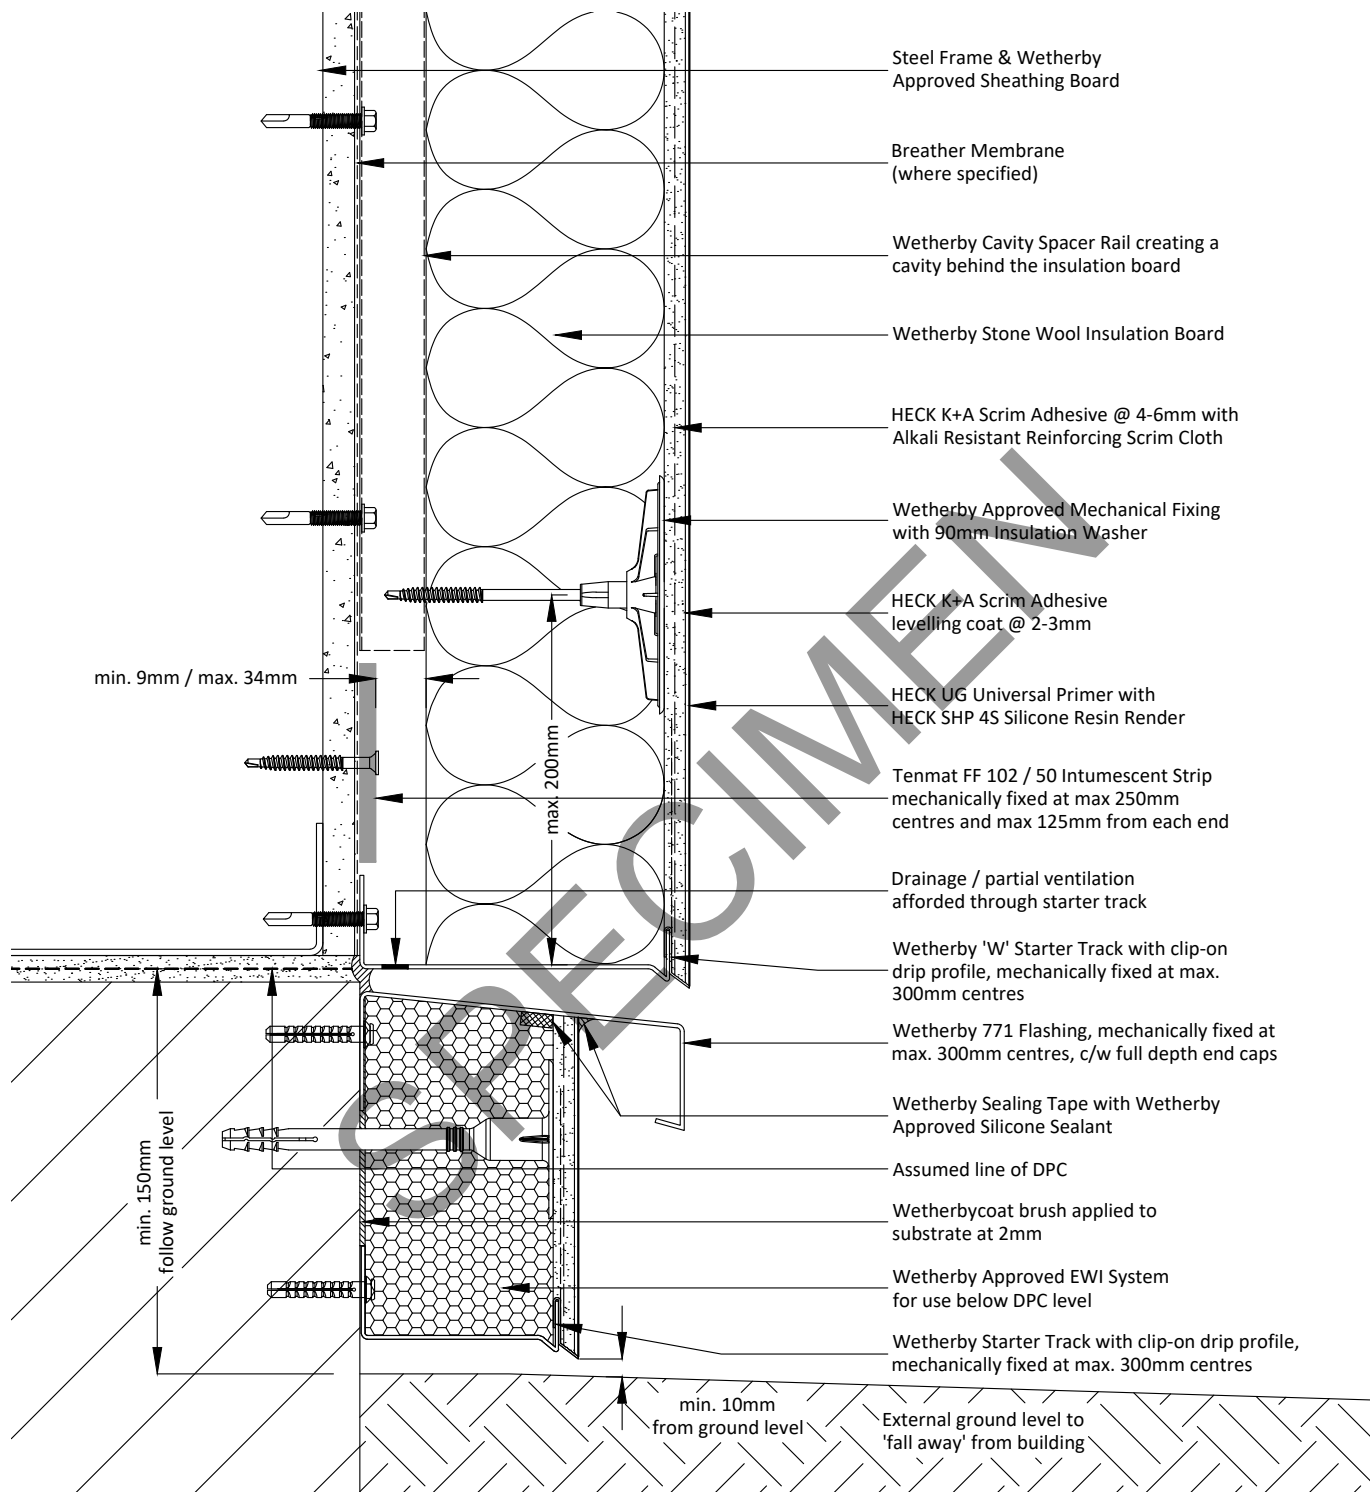

Notes:

- 1 - DPC must not be bridged.
- 2 - Insulation below DPC level should provide a minimum 75% of the thermal resistance of main wall insulation.
- 3 - Below DPC system outside scope of certification/warranty.
- 4 - Intumescent Strip position / requirements to be confirmed subject to project specific detailing. A minimum 9mm and maximum 34mm cavity must be maintained when measured from the front of the intumescent strip and rear of the insulation board. Contact Wetherby Technical Department for further guidance.

Project Name:

Typical Details - Stone Wool with Silicone Render

Drawing Title:

Insulated Base Detail A (Intumescent Strip)

Drawing No:

WWS-EWI-S-RR-SW-SIL-1001

Drawn by: N.K

Checked by: J.R

Revision: -

Scale: NTS

Date: 20.03.2026

Drawing Set: WWS-24

Wetherby Wall Systems Ltd

WETHERBY
Wall Systems Part of ROCKWOOL Group

1 Kid Glove Road, Golborne, WA3 3GS


Tel: 01942 717100 Fax: 01942 717101

Web: www.wall-systems.co.uk

E-mail: technical@wall-systems.co.uk

© WWS-LTD 1998-2025. All rights reserved

Note: The intent of this drawing is to show the correct application of Wetherby products and systems only. All other building elements are shown for illustrative purposes only and it is not intended to detail the building construction. Detail drawings must be read in conjunction with the Wetherby project specific specification with the specification information taking precedence.

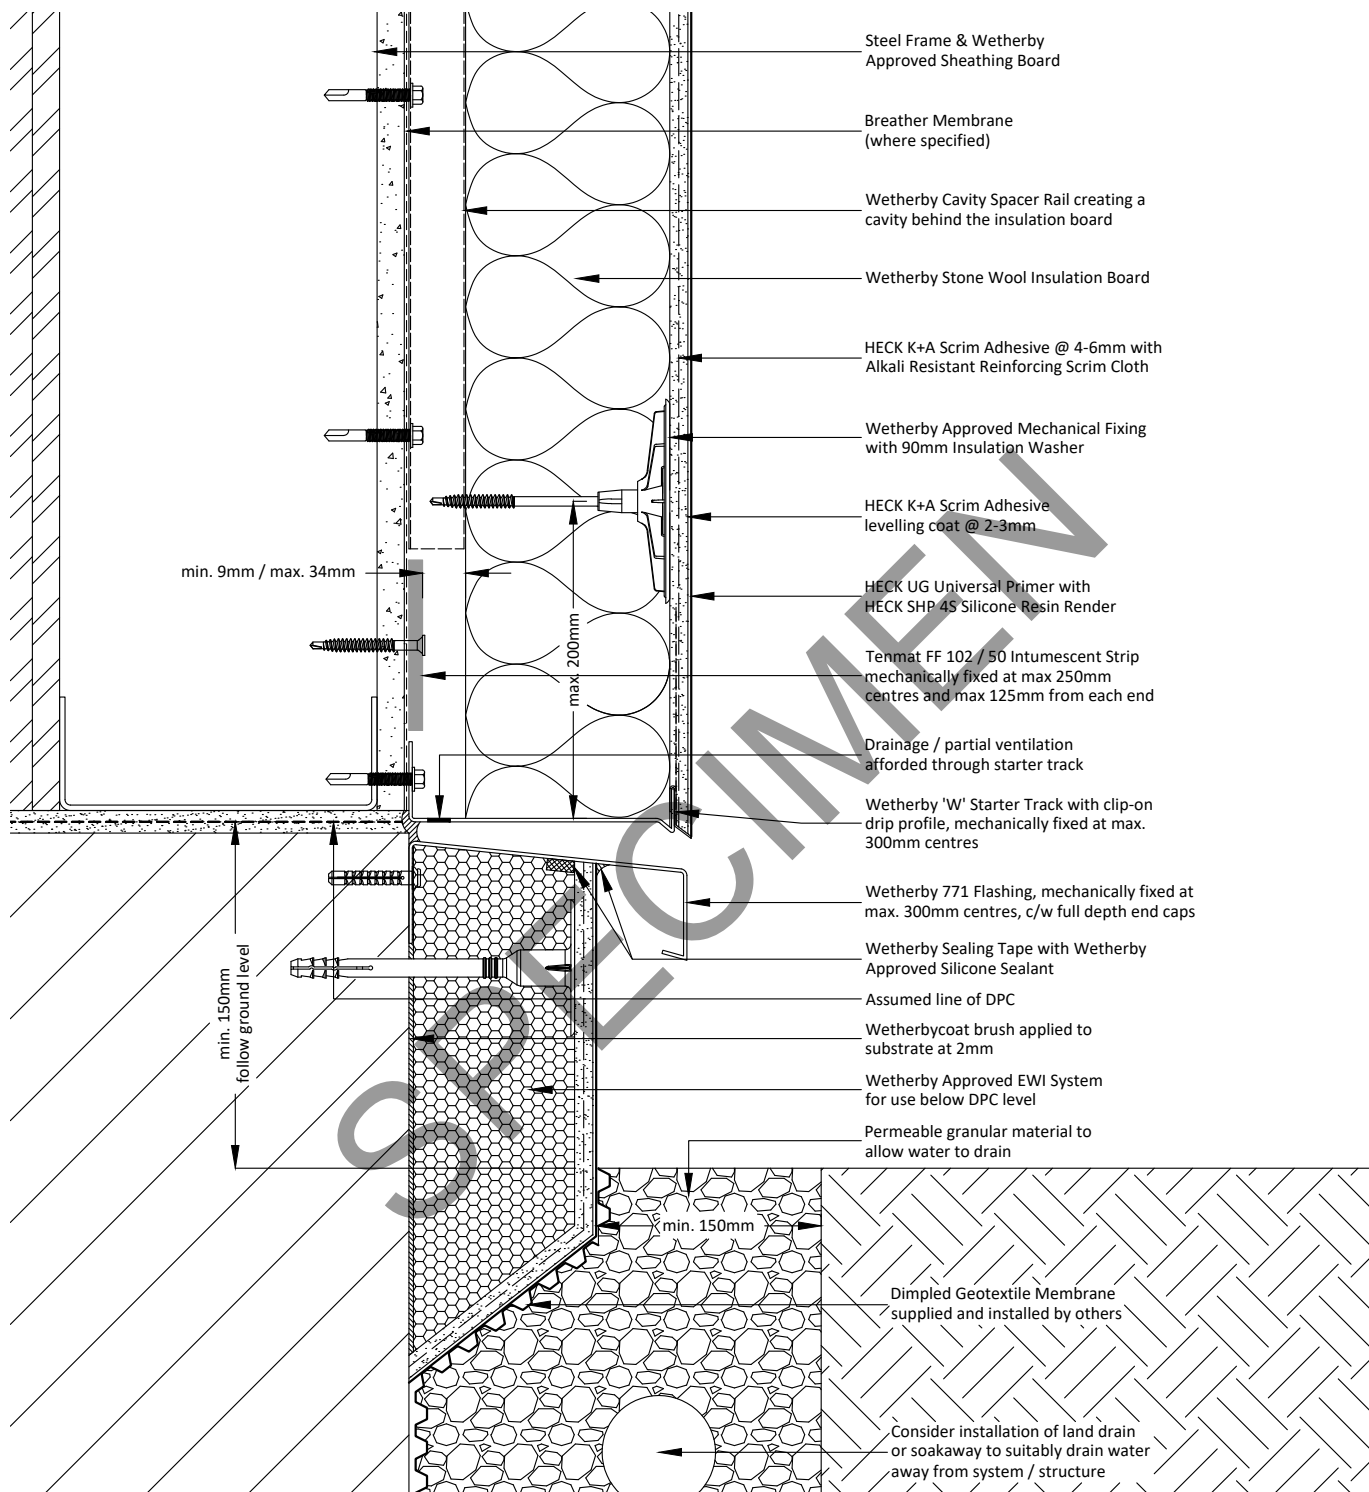

Notes:

- 1 - DPC must not be bridged.
- 2 - Insulation below DPC level should provide a minimum 75% of the thermal resistance of main wall insulation.
- 3 - Below DPC system outside scope of certification/warranty.
- 4 - Intumescent Strip position / requirements to be confirmed subject to project specific detailing. A minimum 9mm and maximum 34mm cavity must be maintained when measured from the front of the intumescent strip and rear of the insulation board. Contact Wetherby Technical Department for further guidance.

Project Name:

Typical Details - Stone Wool with Silicone Render

Drawing Title:

Insulated Base Detail B (Intumescent Strip)

Drawing No:

WWS-EWI-S-RR-SW-SIL-1002

Drawn by: N.K

Checked by: J.R

Revision: -

Scale: NTS

Date: 20.03.2026

Drawing Set: WWS-24

Wetherby Wall Systems Ltd

WETHERBY
Wall Systems Part of ROCKWOOL Group

1 Kid Glove Road, Golborne, WA3 3GS

Tel: 01942 717100 Fax: 01942 717101

Web: www.wall-systems.co.uk


E-mail: technical@wall-systems.co.uk

© WWS-LTD 1998-2025. All rights reserved


Note: The intent of this drawing is to show the correct application of Wetherby products and systems only. All other building elements are shown for illustrative purposes only and it is not intended to detail the building construction. Detail drawings must be read in conjunction with the Wetherby project specific specification with the specification information taking precedence.



Corner bead installed to head and reveal/jamb

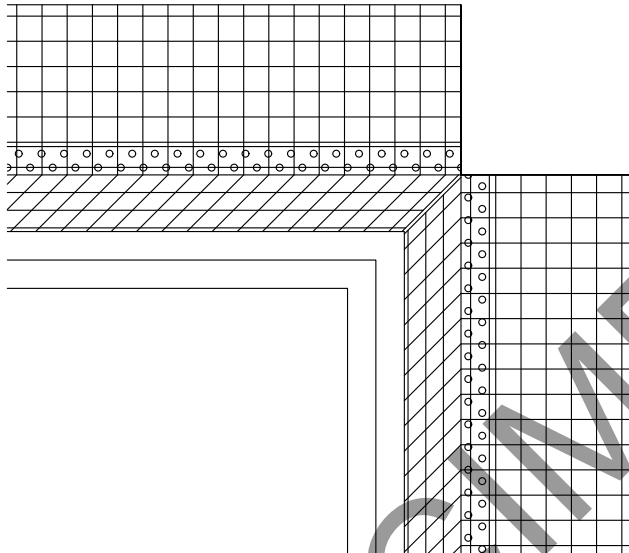

Reinforcing mesh installed and cut tight to the body of the corner bead with additional min. 300 x 250mm reinforcing mesh stress patch applied diagonally across the opening at approx. 45° angle and additional min. 100 x 100mm mesh strip to internal angle of opening

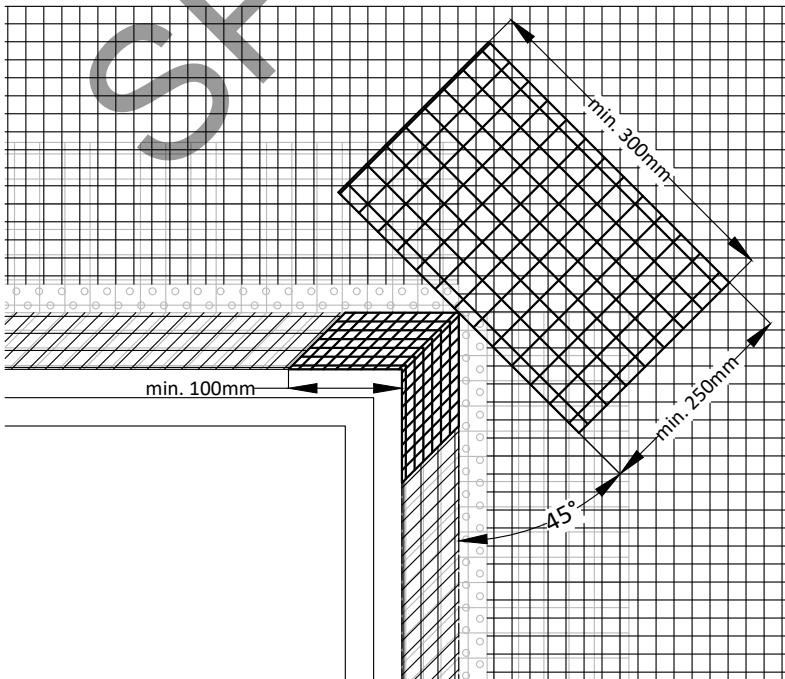

Project Name:

Typical Details - Stone Wool with Silicone Render

Drawing Title:

Stress Patch Detail

Drawing No:

WWS-EWI-S-RR-SW-SIL-2000

Drawn by: N.K

Checked by: J.R

Revision: -

Scale: NTS

Date: 20.03.2026

Drawing Set: WWS-24

Wetherby Wall Systems Ltd

WETHERBY
Wall Systems Part of ROCKWOOL Group

1 Kid Glove Road, Golborne, WA3 3GS


Tel: 01942 717100 Fax: 01942 717101

Web: www.wall-systems.co.uk

E-mail: technical@wall-systems.co.uk

© WWS-LTD 1998-2025. All rights reserved

Note: The intent of this drawing is to show the correct application of Wetherby products and systems only. All other building elements are shown for illustrative purposes only and it is not intended to detail the building construction. Detail drawings must be read in conjunction with the Wetherby project specific specification with the specification information taking precedence.

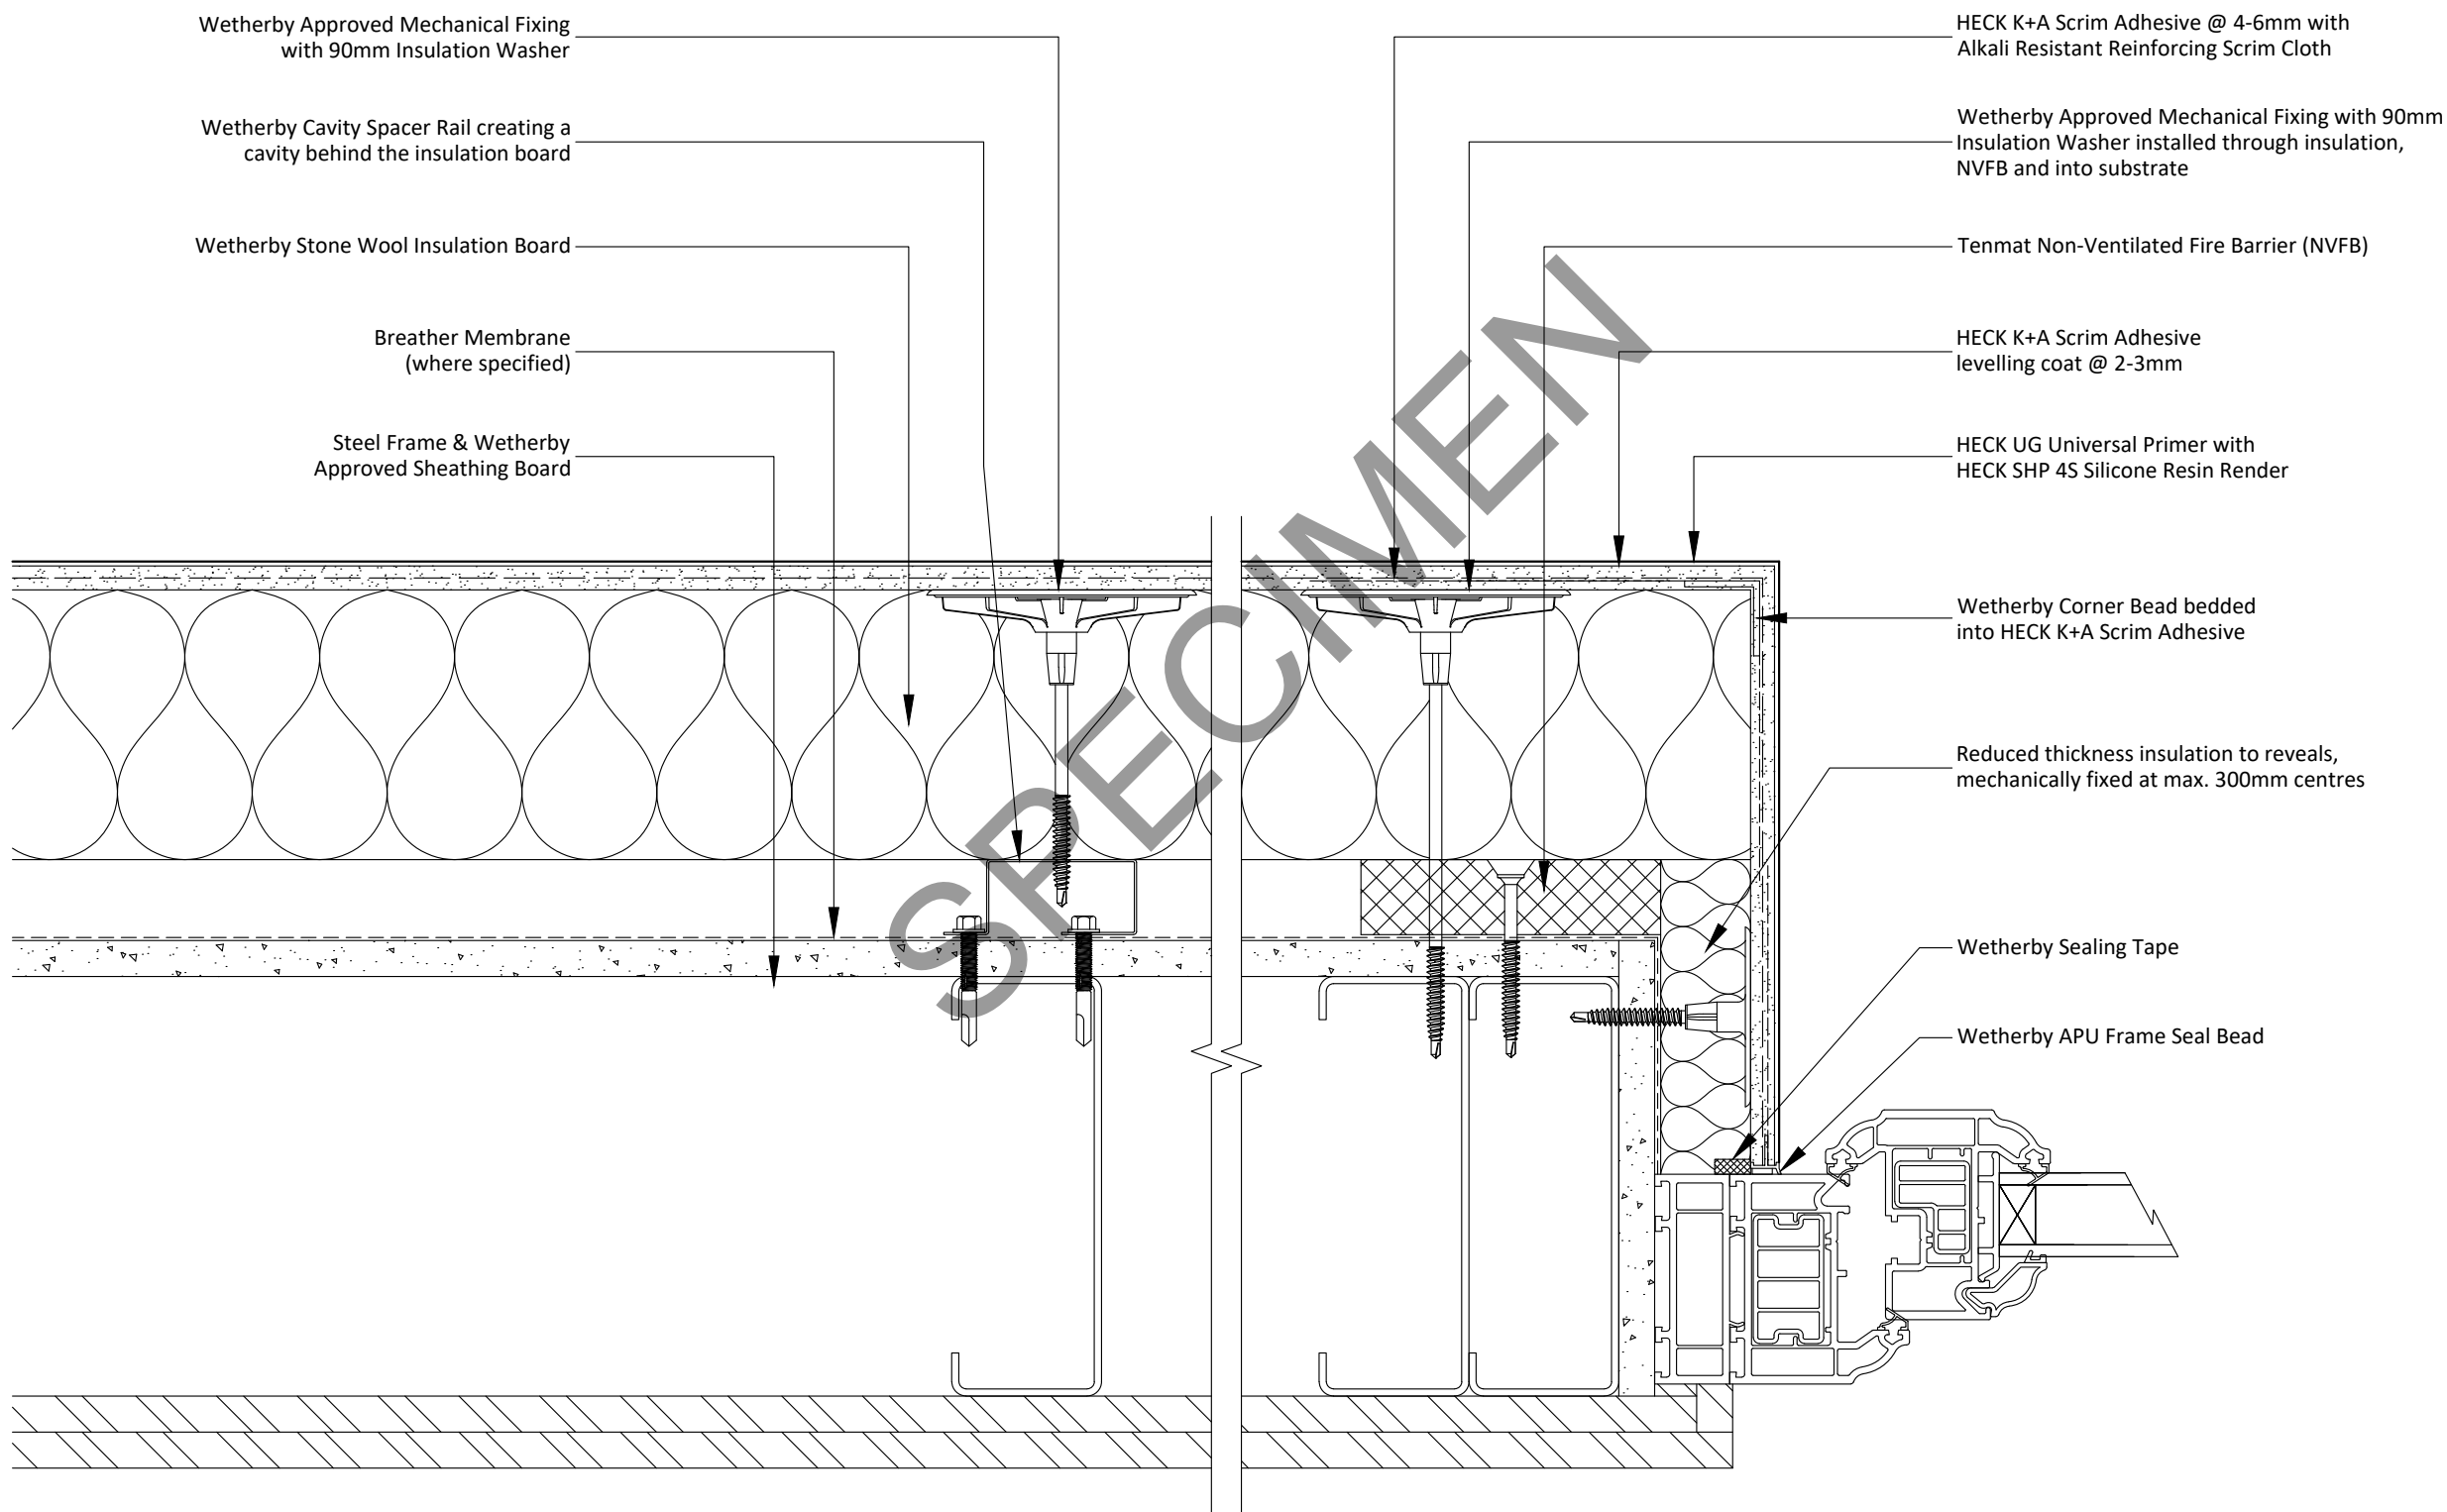

Notes:

- 1 - Tenmat Non-Ventilated Fire Barrier (NVFB) Closed State Cavity Fire Barrier must be installed under min. 2mm compression and must be mechanically fixed at max. 500mm centres and max. 250mm from each end.
- 2 - Wetherby Approved Silicone Sealant can be used as an alternative to Wetherby APU Frame Seal Bead
- 3 - Wetherby Sealing Tape must be installed at the junction between the insulation board and window cill.

Project Name:	Drawn by: N.K
Typical Details - Stone Wool with Silicone Render	Checked by: J.R
Drawing Title:	Revision: -
Reveal Detail A (Insulated)	Scale: NTS
Drawing No:	Date: 20.03.2026
WWS-EWI-S-RR-SW-SIL-2001	Drawing Set: WWS-24


Wetherby Wall Systems Ltd

WETHERBY
Wall Systems

Part of ROCKWOOL Group

1 Kid Glove Road, Golborne, WA3 3GS
Tel: 01942 717100 Fax: 01942 717101
Web: www.wall-systems.co.uk
E-mail: technical@wall-systems.co.uk
© WWS-LTD 1998-2025. All rights reserved

Note: The intent of this drawing is to show the correct application of Wetherby products and systems only. All other building elements are shown for illustrative purposes only and it is not intended to detail the building construction. Detail drawings must be read in conjunction with the Wetherby project specific specification with the specification information taking precedence.

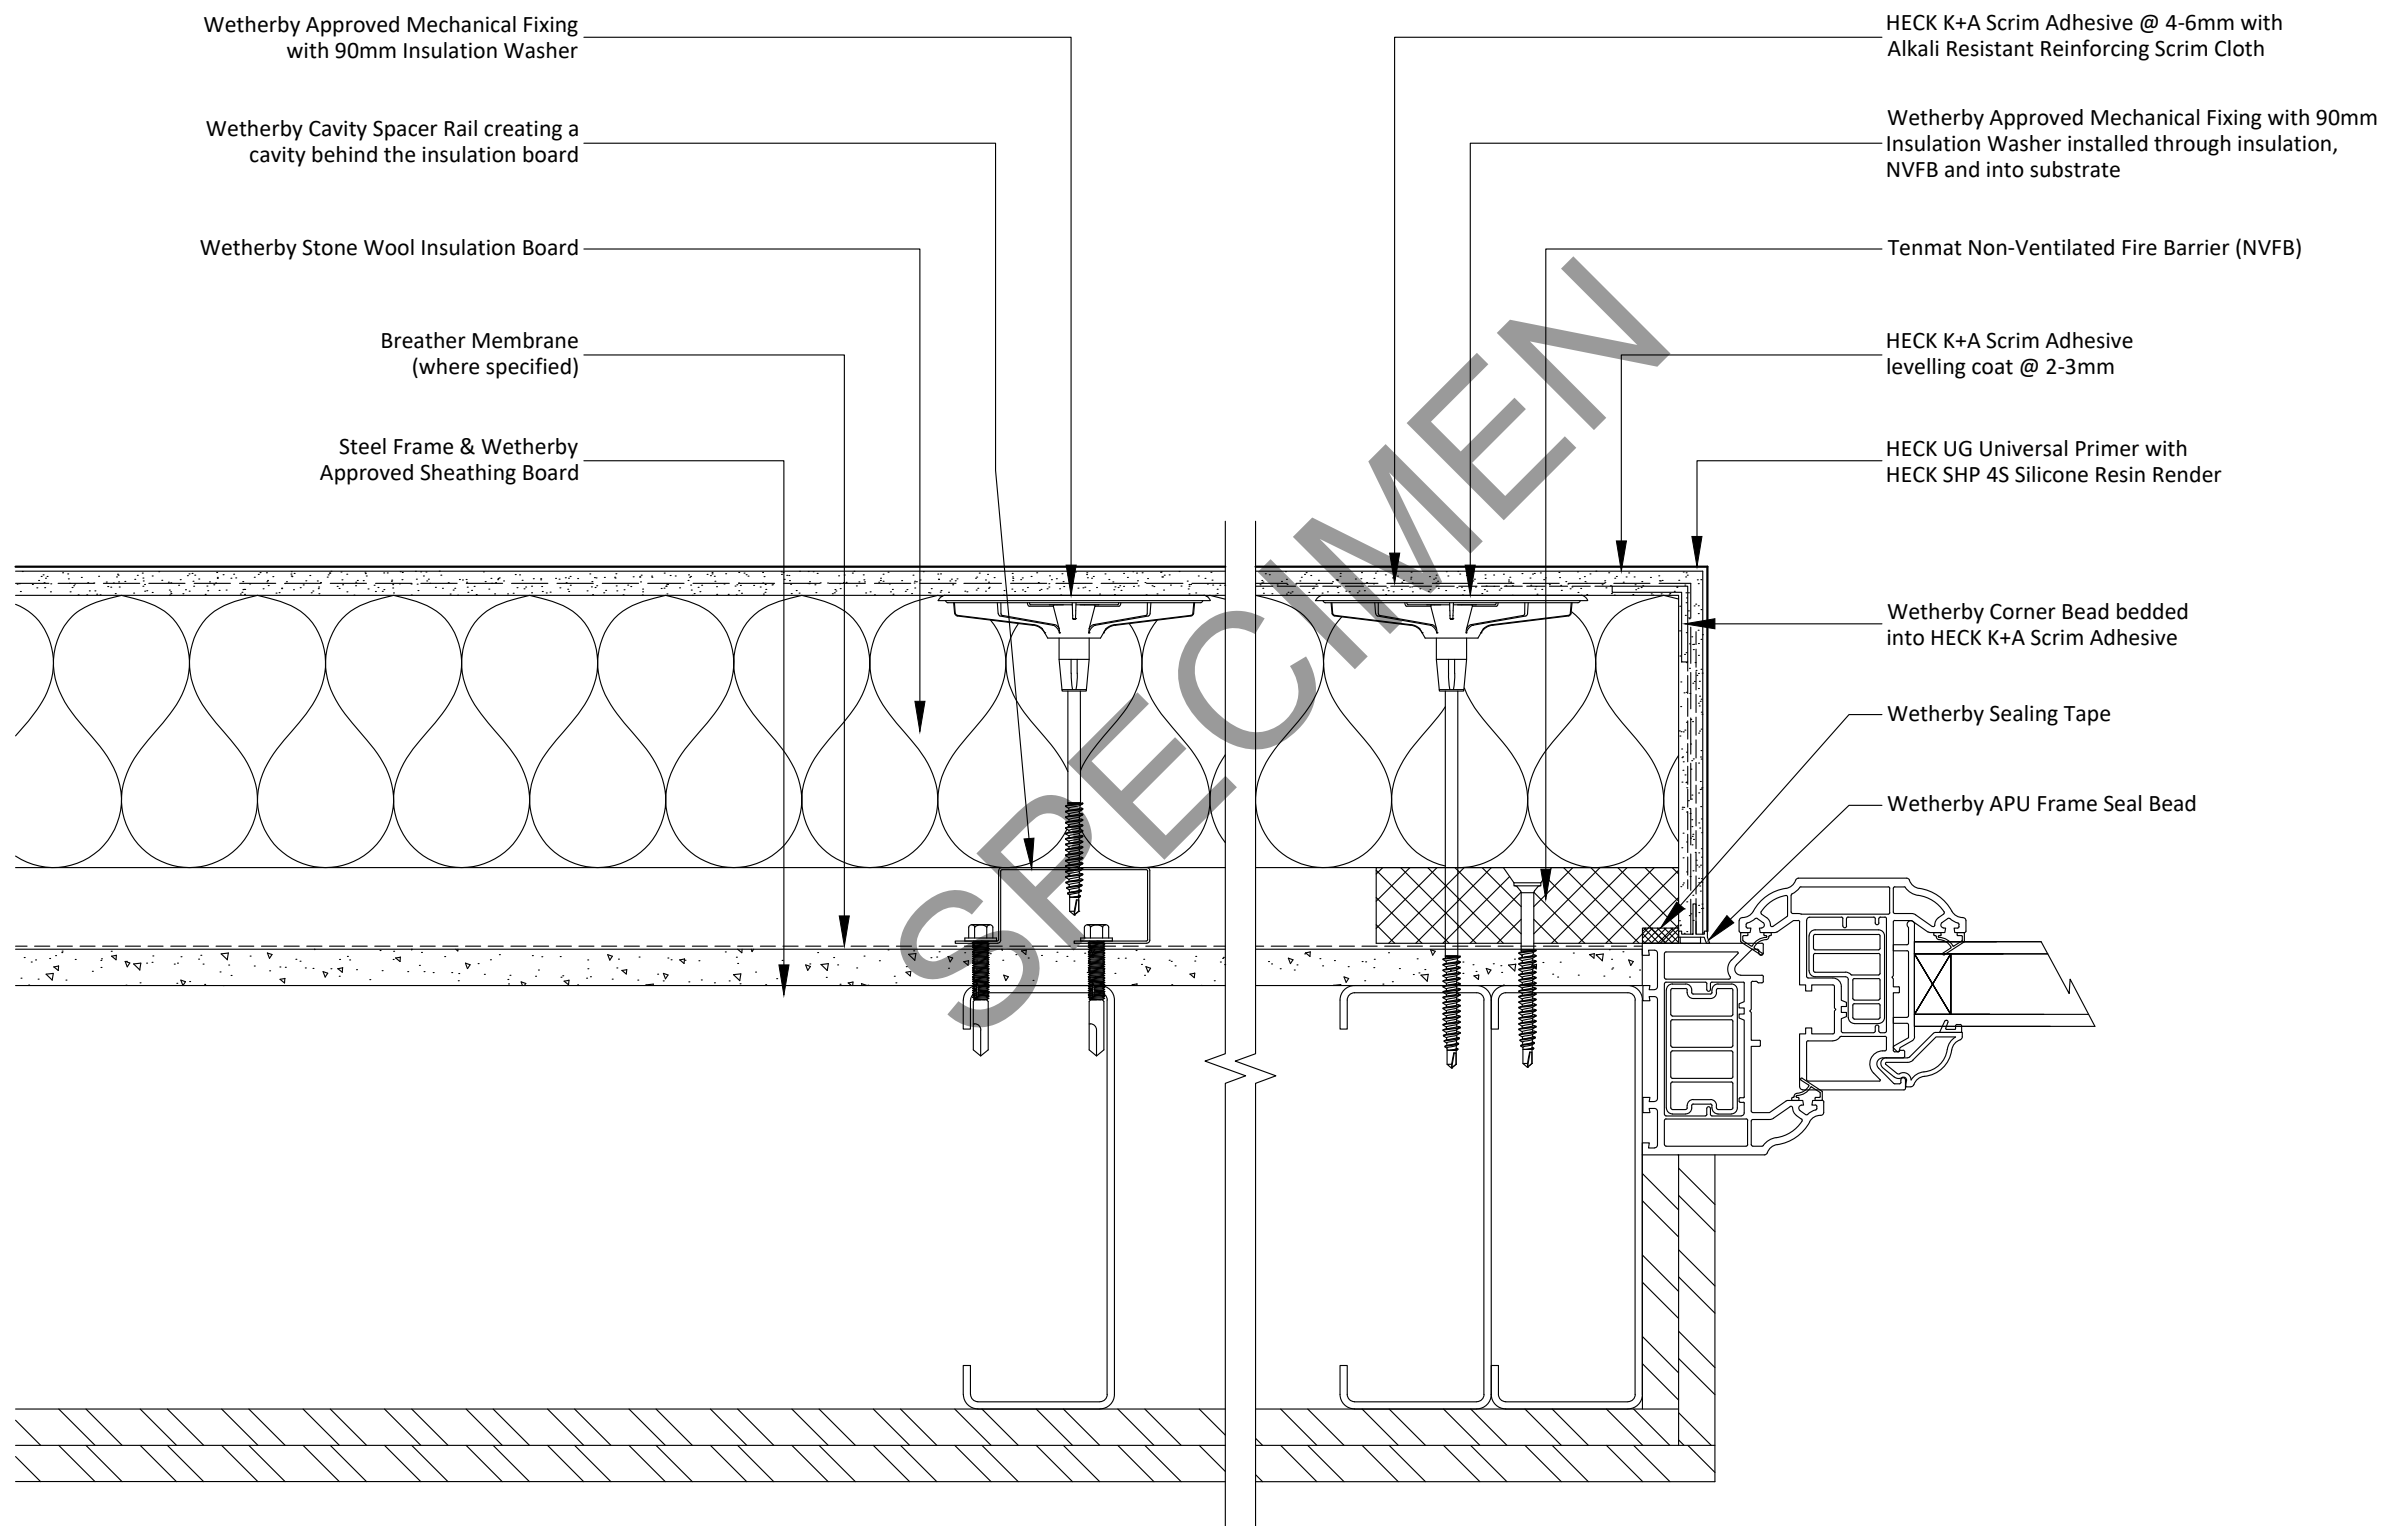


Notes:

- 1 - Tenmat Non-Ventilated Fire Barrier (NVFB) Closed State Cavity Fire Barrier must be installed under min. 2mm compression and must be mechanically fixed at max. 500mm centres and max. 250mm from each end.
- 2 - Wetherby Approved Silicone Sealant can be used as an alternative to Wetherby APU Frame Seal Bead
- 3 - Wetherby Sealing Tape must be installed at the junction between the insulation board and window cill.

Project Name:	Drawn by: N.K	Wetherby Wall Systems Ltd	 1 Kid Glove Road, Golborne, WA3 3GS Tel: 01942 717100 Fax: 01942 717101 Web: www.wall-systems.co.uk E-mail: technical@wall-systems.co.uk © WWS-LTD 1998-2025. All rights reserved
Typical Details - Stone Wool with Silicone Render	Checked by: J.R		
Drawing Title:	Revision: -		
Reveal Detail B (Insulated)	Scale: NTS		
Drawing No:	Date: 20.03.2026		
WWS-EWI-S-RR-SW-SIL-2002	Drawing Set: WWS-24		

Note: The intent of this drawing is to show the correct application of Wetherby products and systems only. All other building elements are shown for illustrative purposes only and it is not intended to detail the building construction. Detail drawings must be read in conjunction with the Wetherby project specific specification with the specification information taking precedence.

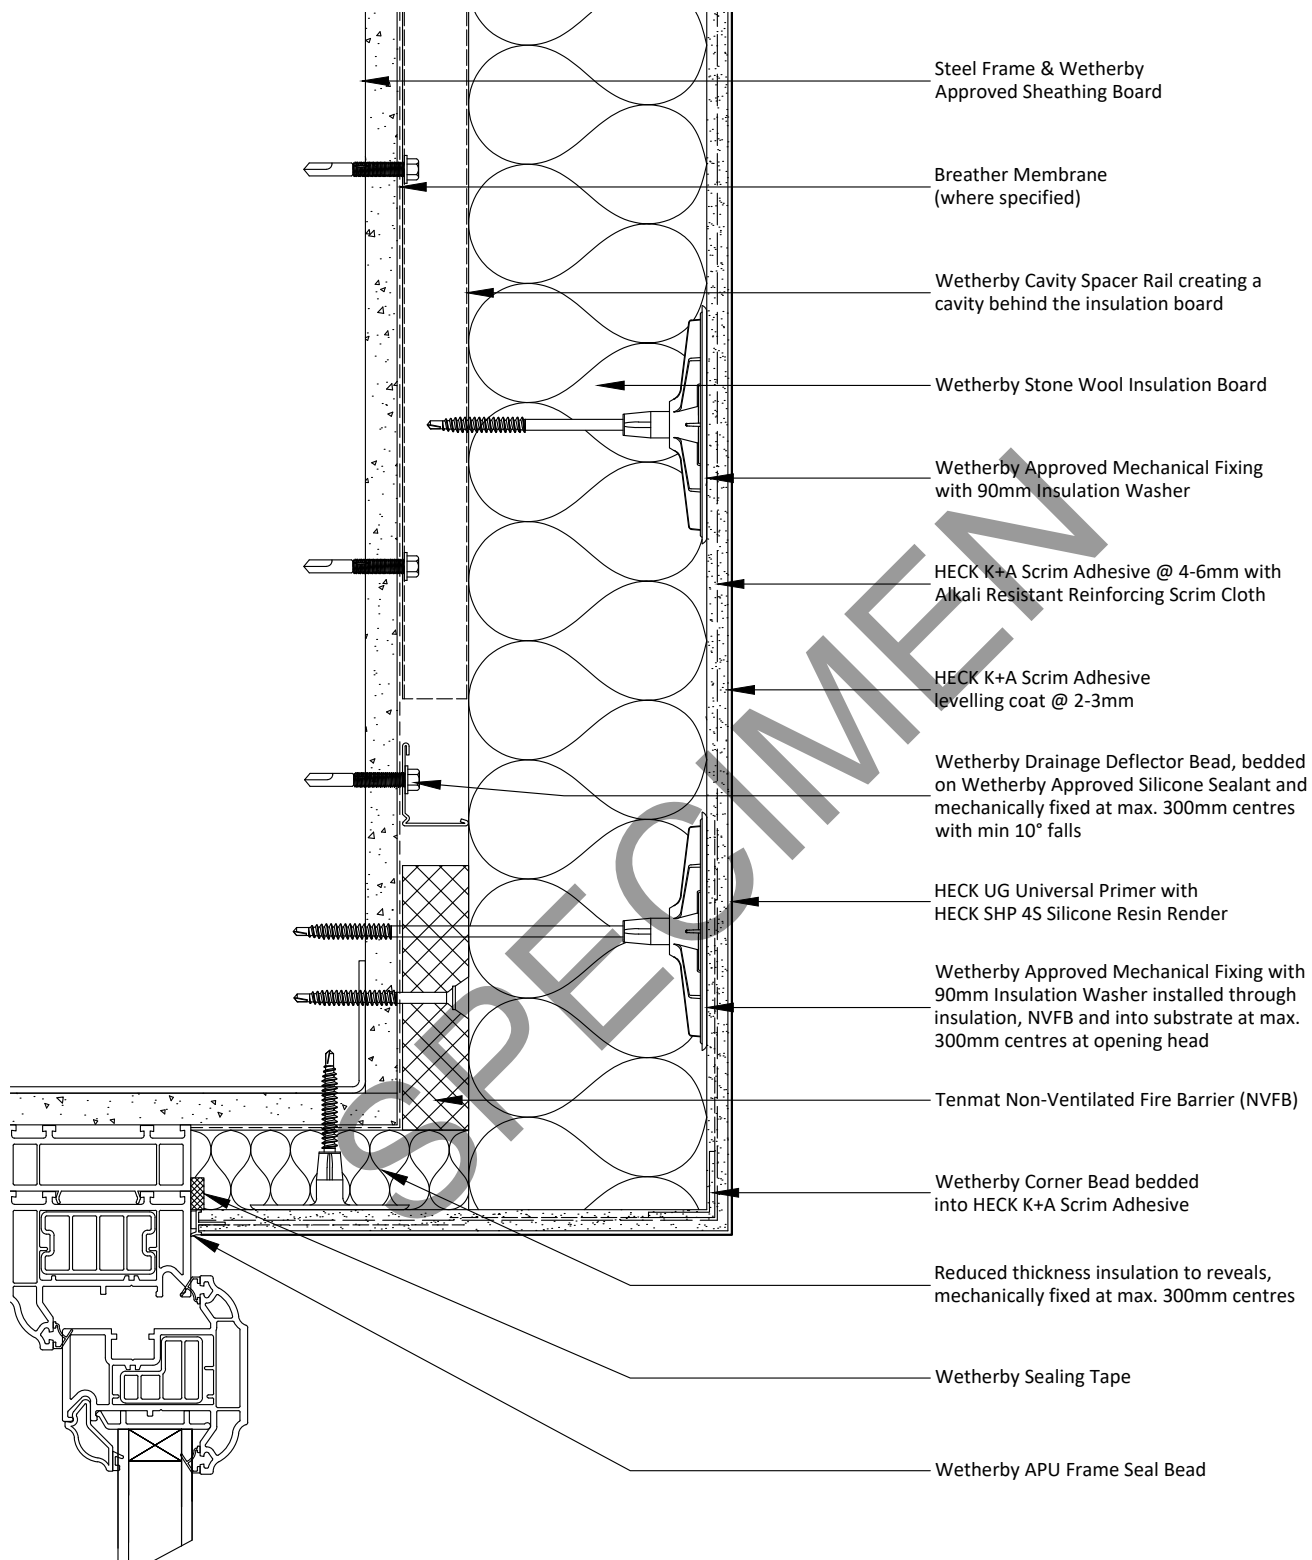


Notes:

- 1 - Tenmat Non-Ventilated Fire Barrier (NVFB) Closed State Cavity Fire Barrier must be installed under min. 2mm compression and must be mechanically fixed at max. 500mm centres and max. 250mm from each end.
- 2 - Additional fixings to be installed at max. 300mm centres at opening head.
- 3 - Wetherby Approved Silicone Sealant can be used as an alternative to Wetherby APU Frame Seal Bead.

Project Name:	Drawn by: N.K	Wetherby Wall Systems Ltd	 1 Kid Glove Road, Golborne, WA3 3GS Tel: 01942 717100 Fax: 01942 717101 Web: www.wall-systems.co.uk E-mail: technical@wall-systems.co.uk © WWS-LTD 1998-2025. All rights reserved
Typical Details - Stone Wool with Silicone Render	Checked by: J.R		
Drawing Title:	Revision: -		
Head Detail A (Insulated)	Scale: NTS		
Drawing No:	Date: 20.03.2026		
WWS-EWI-S-RR-SW-SIL-2003	Drawing Set: WWS-24		

Note: The intent of this drawing is to show the correct application of Wetherby products and systems only. All other building elements are shown for illustrative purposes only and it is not intended to detail the building construction. Detail drawings must be read in conjunction with the Wetherby project specific specification with the specification information taking precedence.

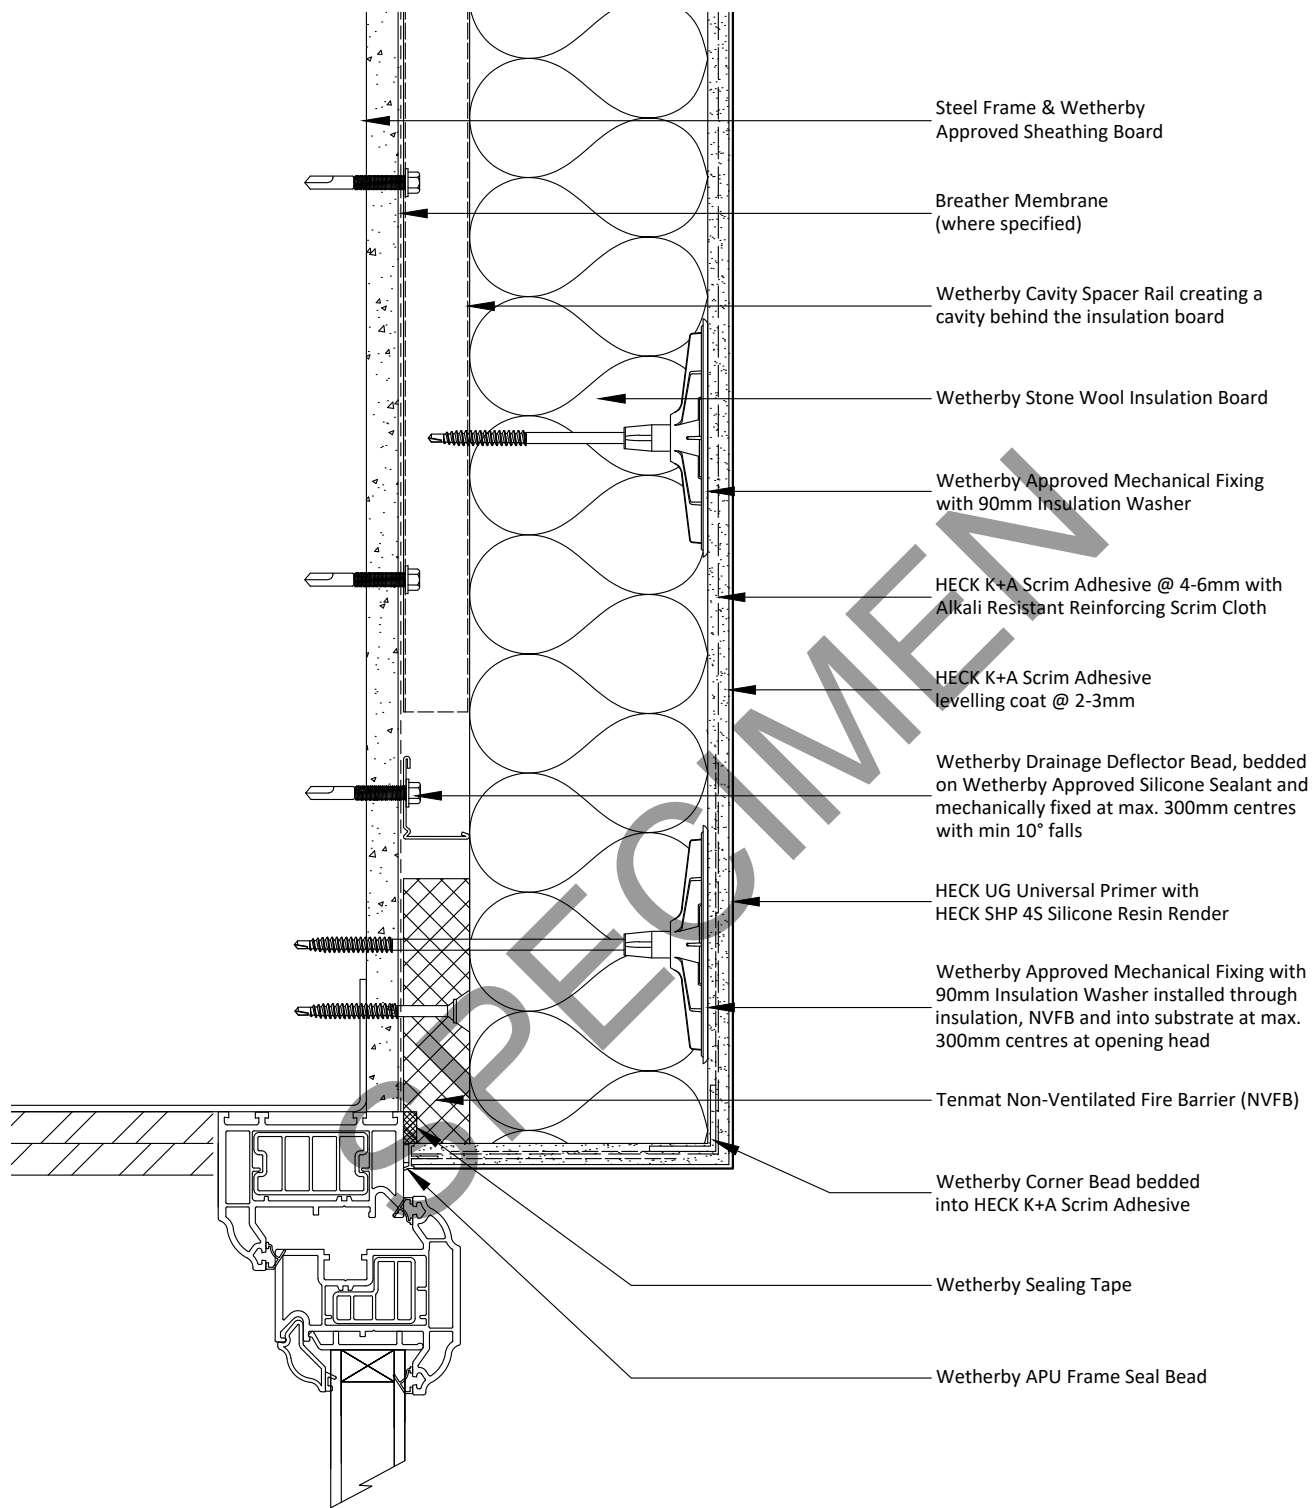

Notes:

- 1 - Tenmat Non-Ventilated Fire Barrier (NVFB) Closed State Cavity Fire Barrier must be installed under min. 2mm compression and must be mechanically fixed at max. 500mm centres and max. 250mm from each end.
- 2 - Additional fixings to be installed at max. 300mm centres at opening head.
- 3 - Wetherby Approved Silicone Sealant can be used as an alternative to Wetherby APU Frame Seal Bead.

Project Name:

Typical Details - Stone Wool with Silicone Render

Drawing Title:

Head Detail B (Insulated)

Drawing No:

WWS-EWI-S-RR-SW-SIL-2004

Drawn by: N.K

Checked by: J.R

Revision: -

Scale: NTS

Date: 20.03.2026

Drawing Set: WWS-24

Wetherby Wall Systems Ltd

WETHERBY
Wall Systems Part of ROCKWOOL Group

1 Kid Glove Road, Golborne, WA3 3GS


Tel: 01942 717100 Fax: 01942 717101

Web: www.wall-systems.co.uk

E-mail: technical@wall-systems.co.uk

© WWS-LTD 1998-2025. All rights reserved

Note: The intent of this drawing is to show the correct application of Wetherby products and systems only. All other building elements are shown for illustrative purposes only and it is not intended to detail the building construction. Detail drawings must be read in conjunction with the Wetherby project specific specification with the specification information taking precedence.

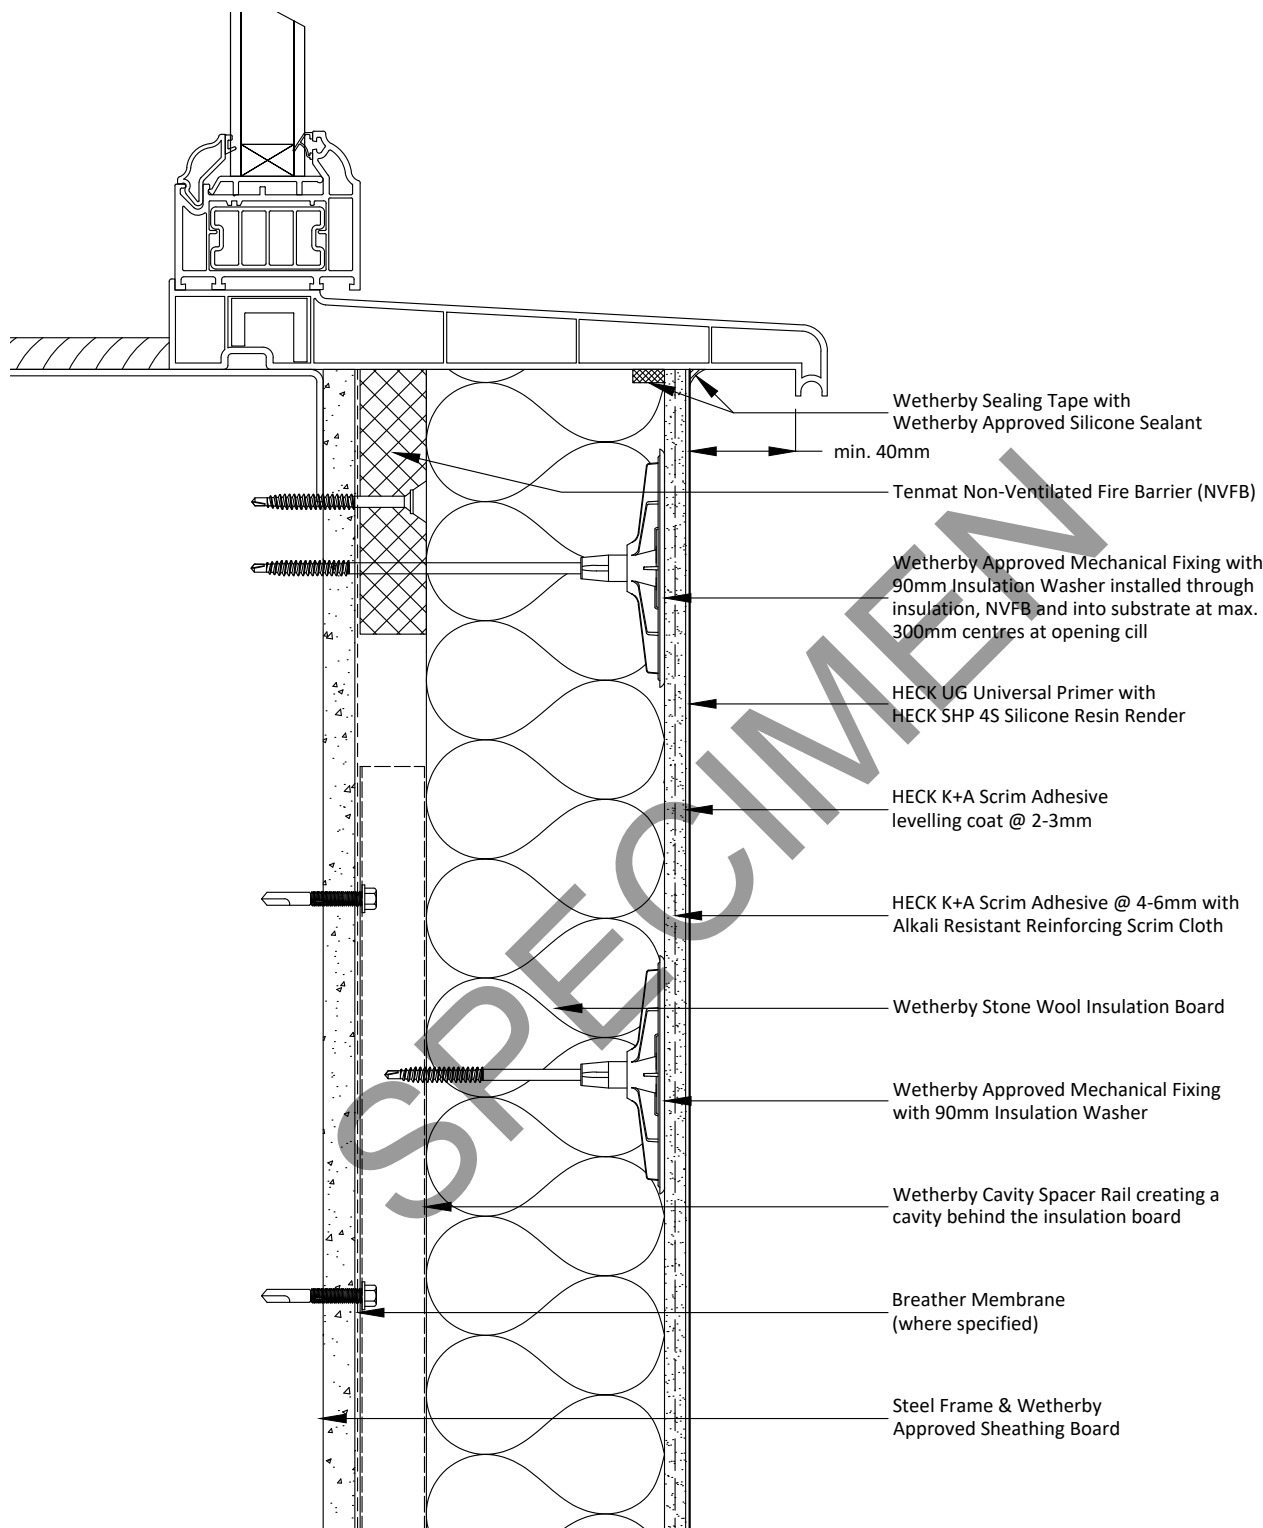


Notes:

- 1 - Tenmat Non-Ventilated Fire Barrier (NVFB) Closed State Cavity Fire Barrier must be installed under min. 2mm compression and must be mechanically fixed at max. 500mm centres and max. 250mm from each end.
- 2 - Additional fixings to be installed at max. 300mm centres at opening cill.
- 3 - Ensure any existing window weep/drainage holes are not blocked, or install new weep/drainage holes.
- 4 - In very severe exposure zones, window cill overhang should be increased to min. 50mm.

Project Name:	Drawn by: N.K	Wetherby Wall Systems Ltd	WETHERBY Wall Systems Part of ROCKWOOL Group 1 Kid Glove Road, Golborne, WA3 3GS Tel: 01942 717100 Fax: 01942 717101 Web: www.wall-systems.co.uk E-mail: technical@wall-systems.co.uk © WWS-LTD 1998-2025. All rights reserved
Typical Details - Stone Wool with Silicone Render	Checked by: J.R		
Drawing Title:	Revision: -		
Window Cill Detail	Scale: NTS		
Drawing No:	Date: 20.03.2026		
WWS-EWI-S-RR-SW-SIL-2005	Drawing Set: WWS-24		

Note: The intent of this drawing is to show the correct application of Wetherby products and systems only. All other building elements are shown for illustrative purposes only and it is not intended to detail the building construction. Detail drawings must be read in conjunction with the Wetherby project specific specification with the specification information taking precedence.

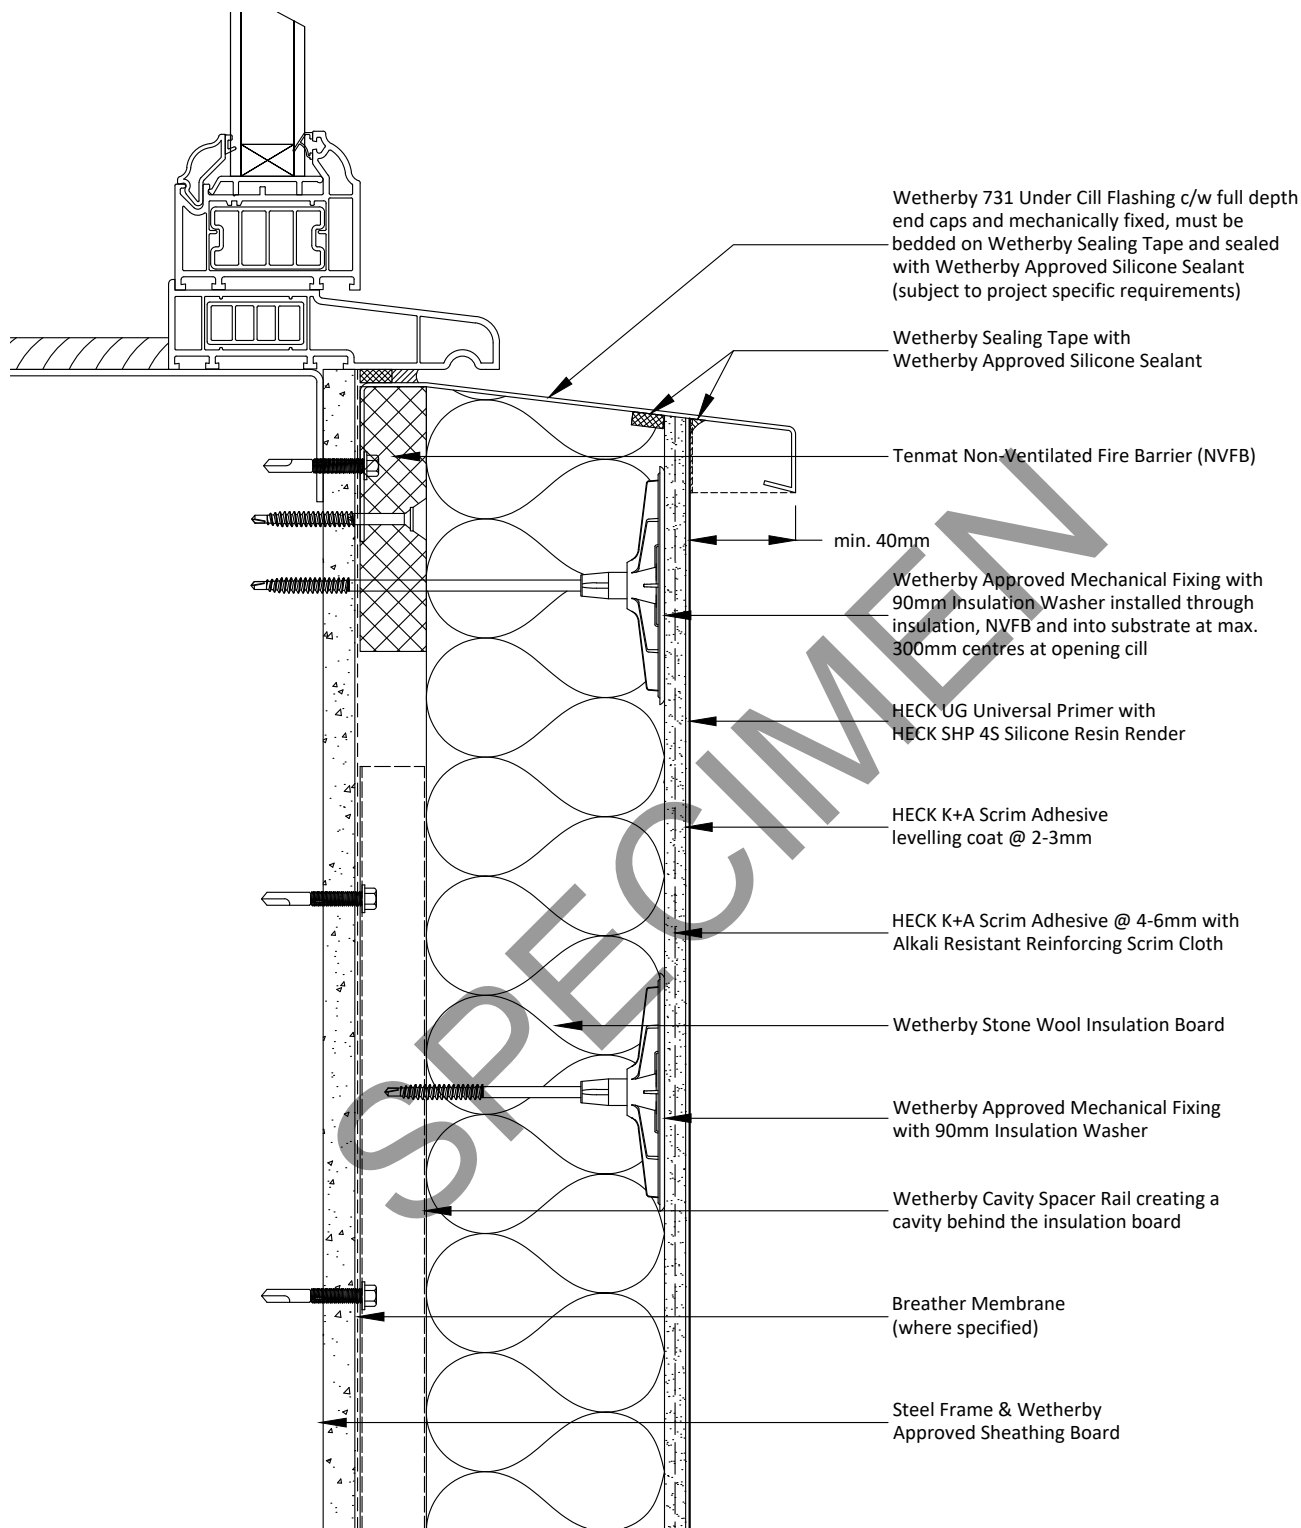

Notes:

- 1 - Tenmat Non-Ventilated Fire Barrier (NVFB) Closed State Cavity Fire Barrier must be installed under min. 2mm compression and must be mechanically fixed at max. 500mm centres and max. 250mm from each end.
- 2 - Additional fixings to be installed at max. 300mm centres at opening cill.
- 3 - Ensure any existing window weep/drainage holes are not blocked, or install new weep/drainage holes.
- 4 - In very severe exposure zones, window cill overhang should be increased to min. 50mm.

Project Name:

Typical Details - Stone Wool with Silicone Render

Drawing Title:

Under Cill Detail

Drawing No:

WWS-EWI-S-RR-SW-SIL-2006

Drawn by: N.K

Checked by: J.R

Revision: -

Scale: NTS

Date: 20.03.2026

Drawing Set: WWS-24

Wetherby Wall Systems Ltd

WETHERBY
Wall Systems Part of ROCKWOOL Group

1 Kid Glove Road, Golborne, WA3 3GS


Tel: 01942 717100 Fax: 01942 717101

Web: www.wall-systems.co.uk

E-mail: technical@wall-systems.co.uk

© WWS-LTD 1998-2025. All rights reserved

Note: The intent of this drawing is to show the correct application of Wetherby products and systems only. All other building elements are shown for illustrative purposes only and it is not intended to detail the building construction. Detail drawings must be read in conjunction with the Wetherby project specific specification with the specification information taking precedence.

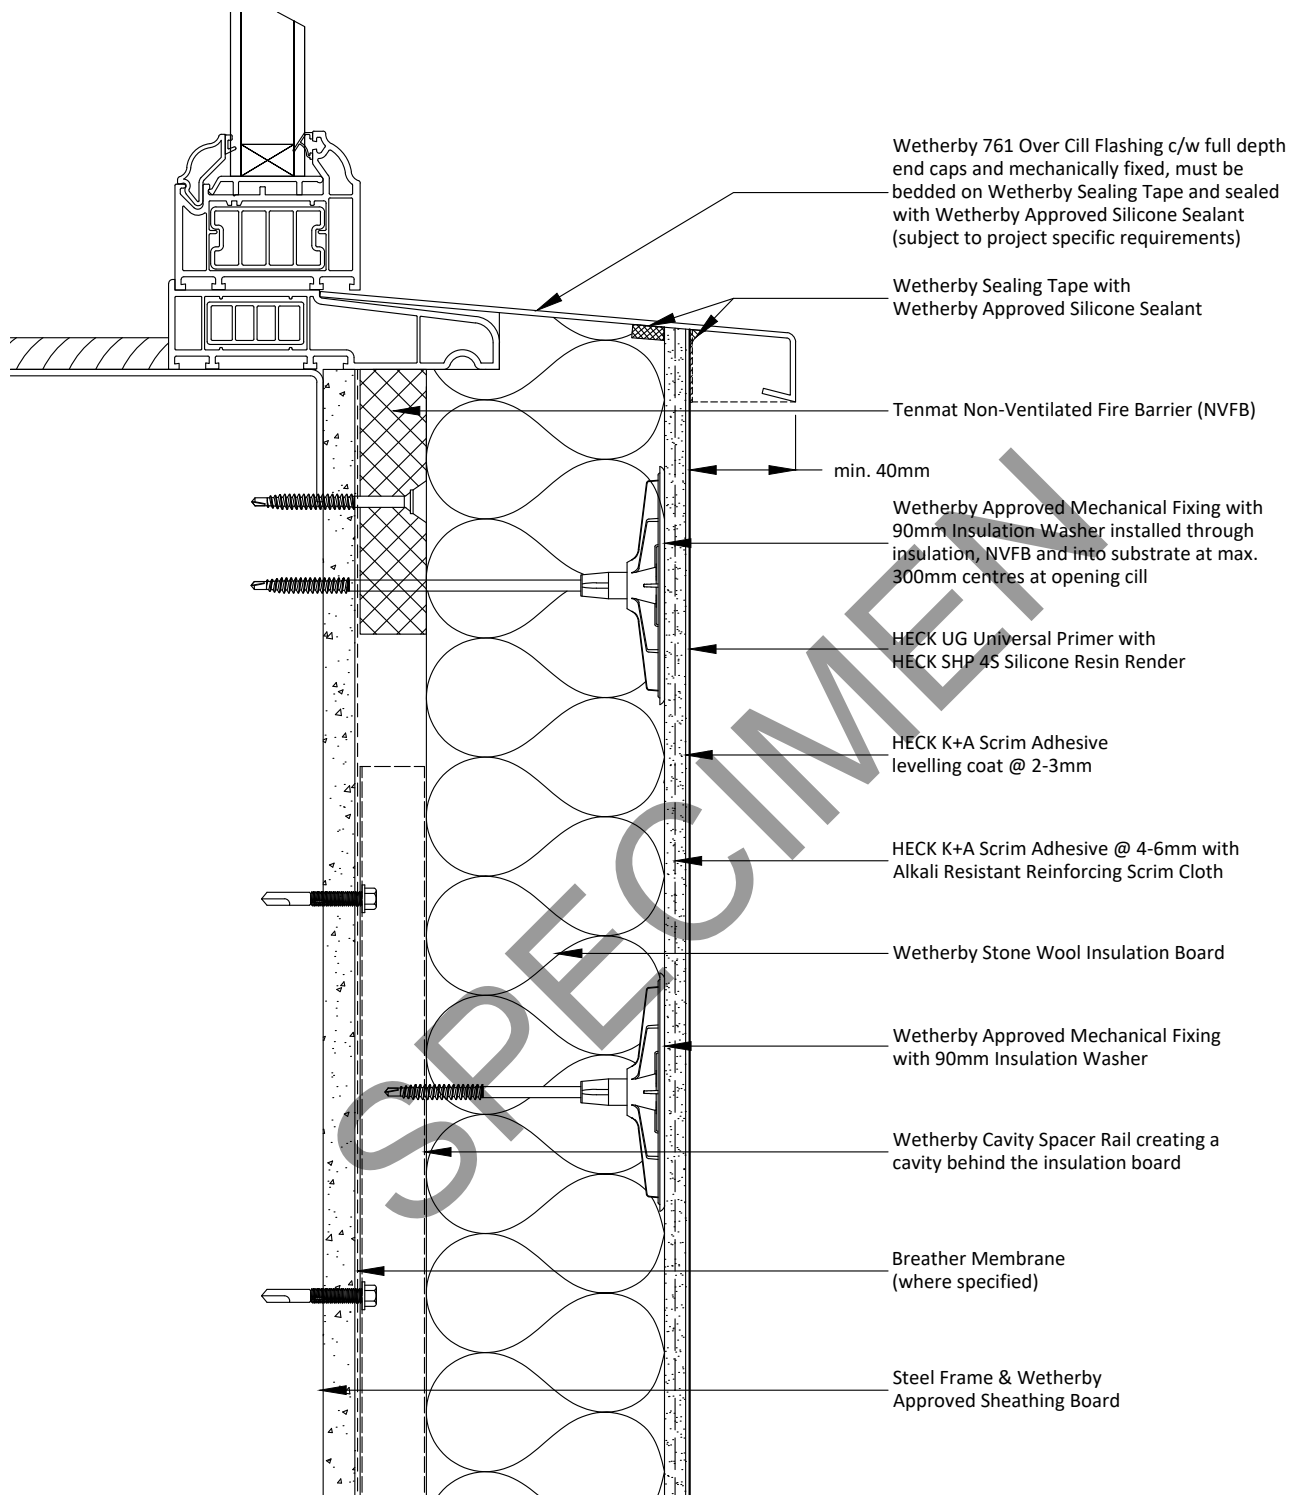


Notes:

- 1 - Tenmat Non-Ventilated Fire Barrier (NVFB) Closed State Cavity Fire Barrier must be installed under min. 2mm compression and must be mechanically fixed at max. 500mm centres and max. 250mm from each end.
- 2 - Additional fixings to be installed at max. 300mm centres at opening cill.
- 3 - Ensure any existing window weep/drainage holes are not blocked, or install new weep/drainage holes.
- 4 - In very severe exposure zones, window cill overhang should be increased to min. 50mm.
- 5 - Minimum 50mm horns required for new over cill flashing.

Project Name:	Drawn by: N.K	Wetherby Wall Systems Ltd	 1 Kid Glove Road, Golborne, WA3 3GS Tel: 01942 717100 Fax: 01942 717101 Web: www.wall-systems.co.uk E-mail: technical@wall-systems.co.uk © WWS-LTD 1998-2025. All rights reserved
Typical Details - Stone Wool with Silicone Render	Checked by: J.R		
Drawing Title:	Revision: -		
Over Cill Detail	Scale: NTS		
Drawing No:	Date: 20.03.2026		
WWS-EWI-S-RR-SW-SIL-2007	Drawing Set: WWS-24		

Note: The intent of this drawing is to show the correct application of Wetherby products and systems only. All other building elements are shown for illustrative purposes only and it is not intended to detail the building construction. Detail drawings must be read in conjunction with the Wetherby project specific specification with the specification information taking precedence.

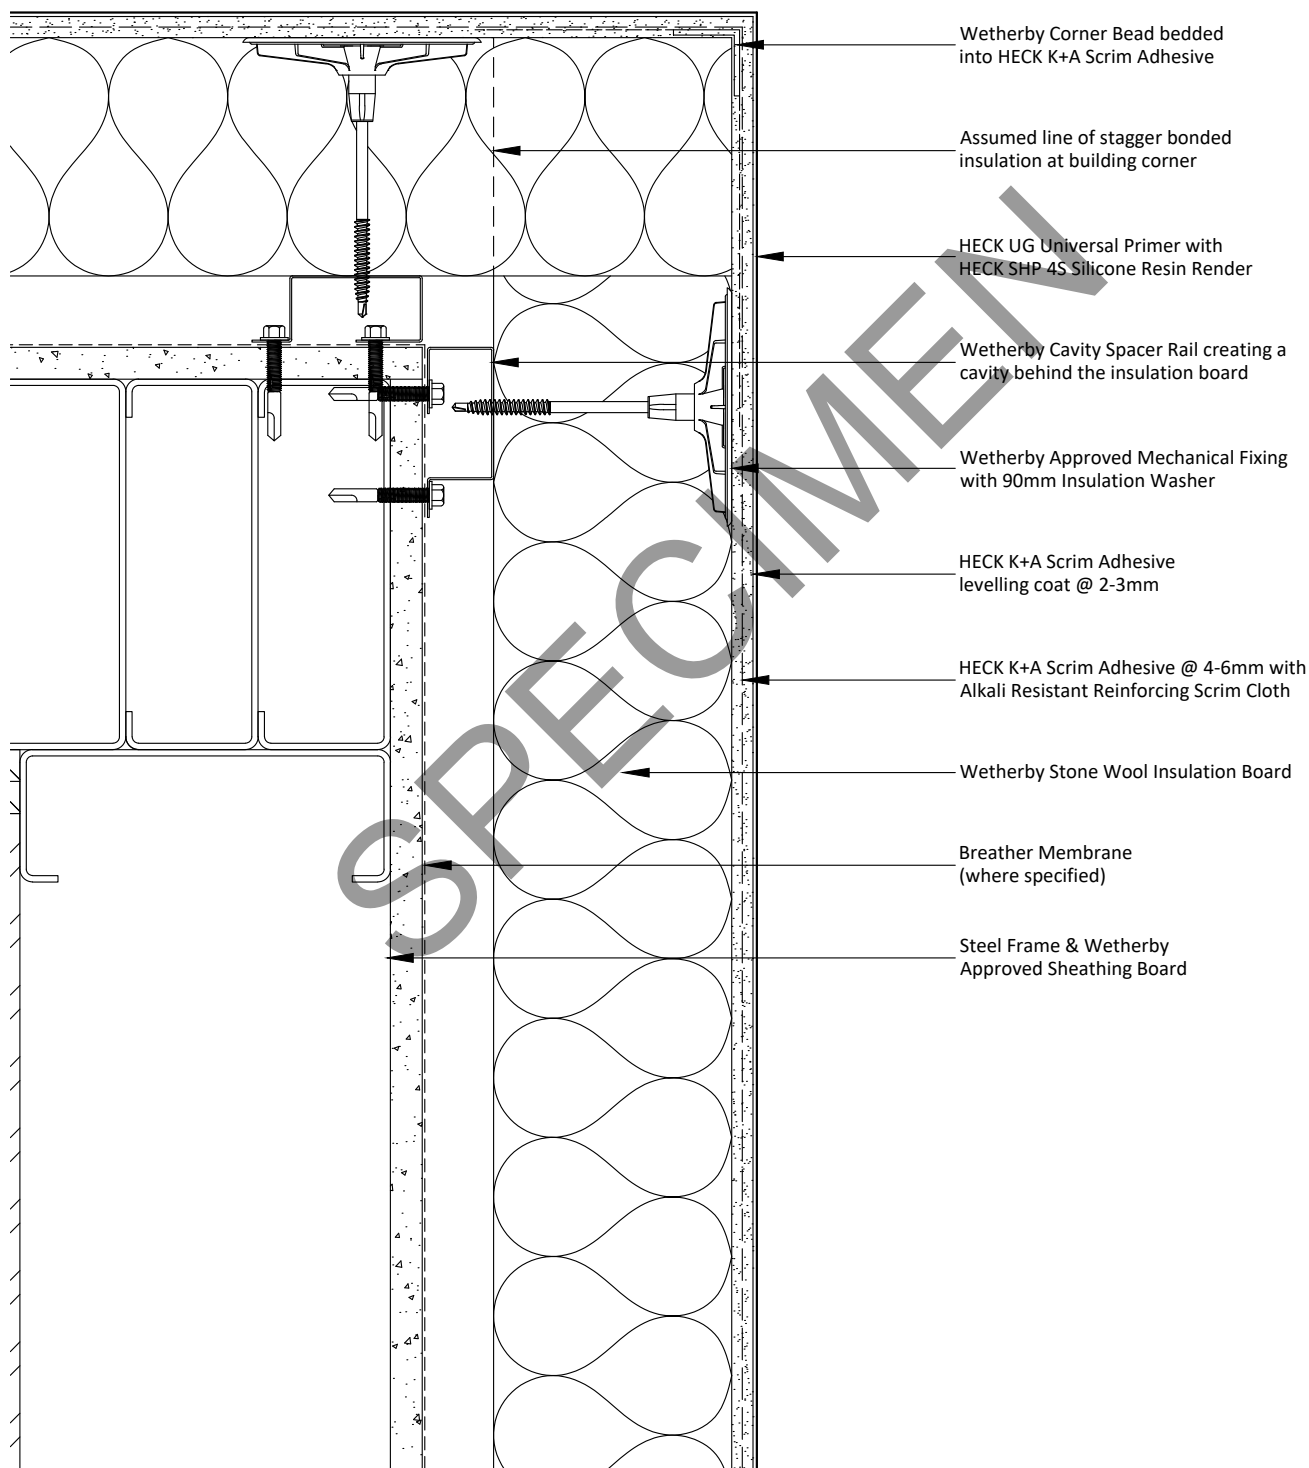

Project Name:

Typical Details - Stone Wool with Silicone Render

Drawing Title:

External Corner Detail

Drawing No:

WWS-EWI-S-RR-SW-SIL-3000

Drawn by: N.K

Checked by: J.R

Revision: -

Scale: NTS

Date: 20.03.2026

Drawing Set: WWS-24

Wetherby Wall Systems Ltd

WETHERBY
Wall Systems Part of ROCKWOOL Group

1 Kid Glove Road, Golborne, WA3 3GS


Tel: 01942 717100 Fax: 01942 717101

Web: www.wall-systems.co.uk

E-mail: technical@wall-systems.co.uk

© WWS-LTD 1998-2025. All rights reserved

Note: The intent of this drawing is to show the correct application of Wetherby products and systems only. All other building elements are shown for illustrative purposes only and it is not intended to detail the building construction. Detail drawings must be read in conjunction with the Wetherby project specific specification with the specification information taking precedence.

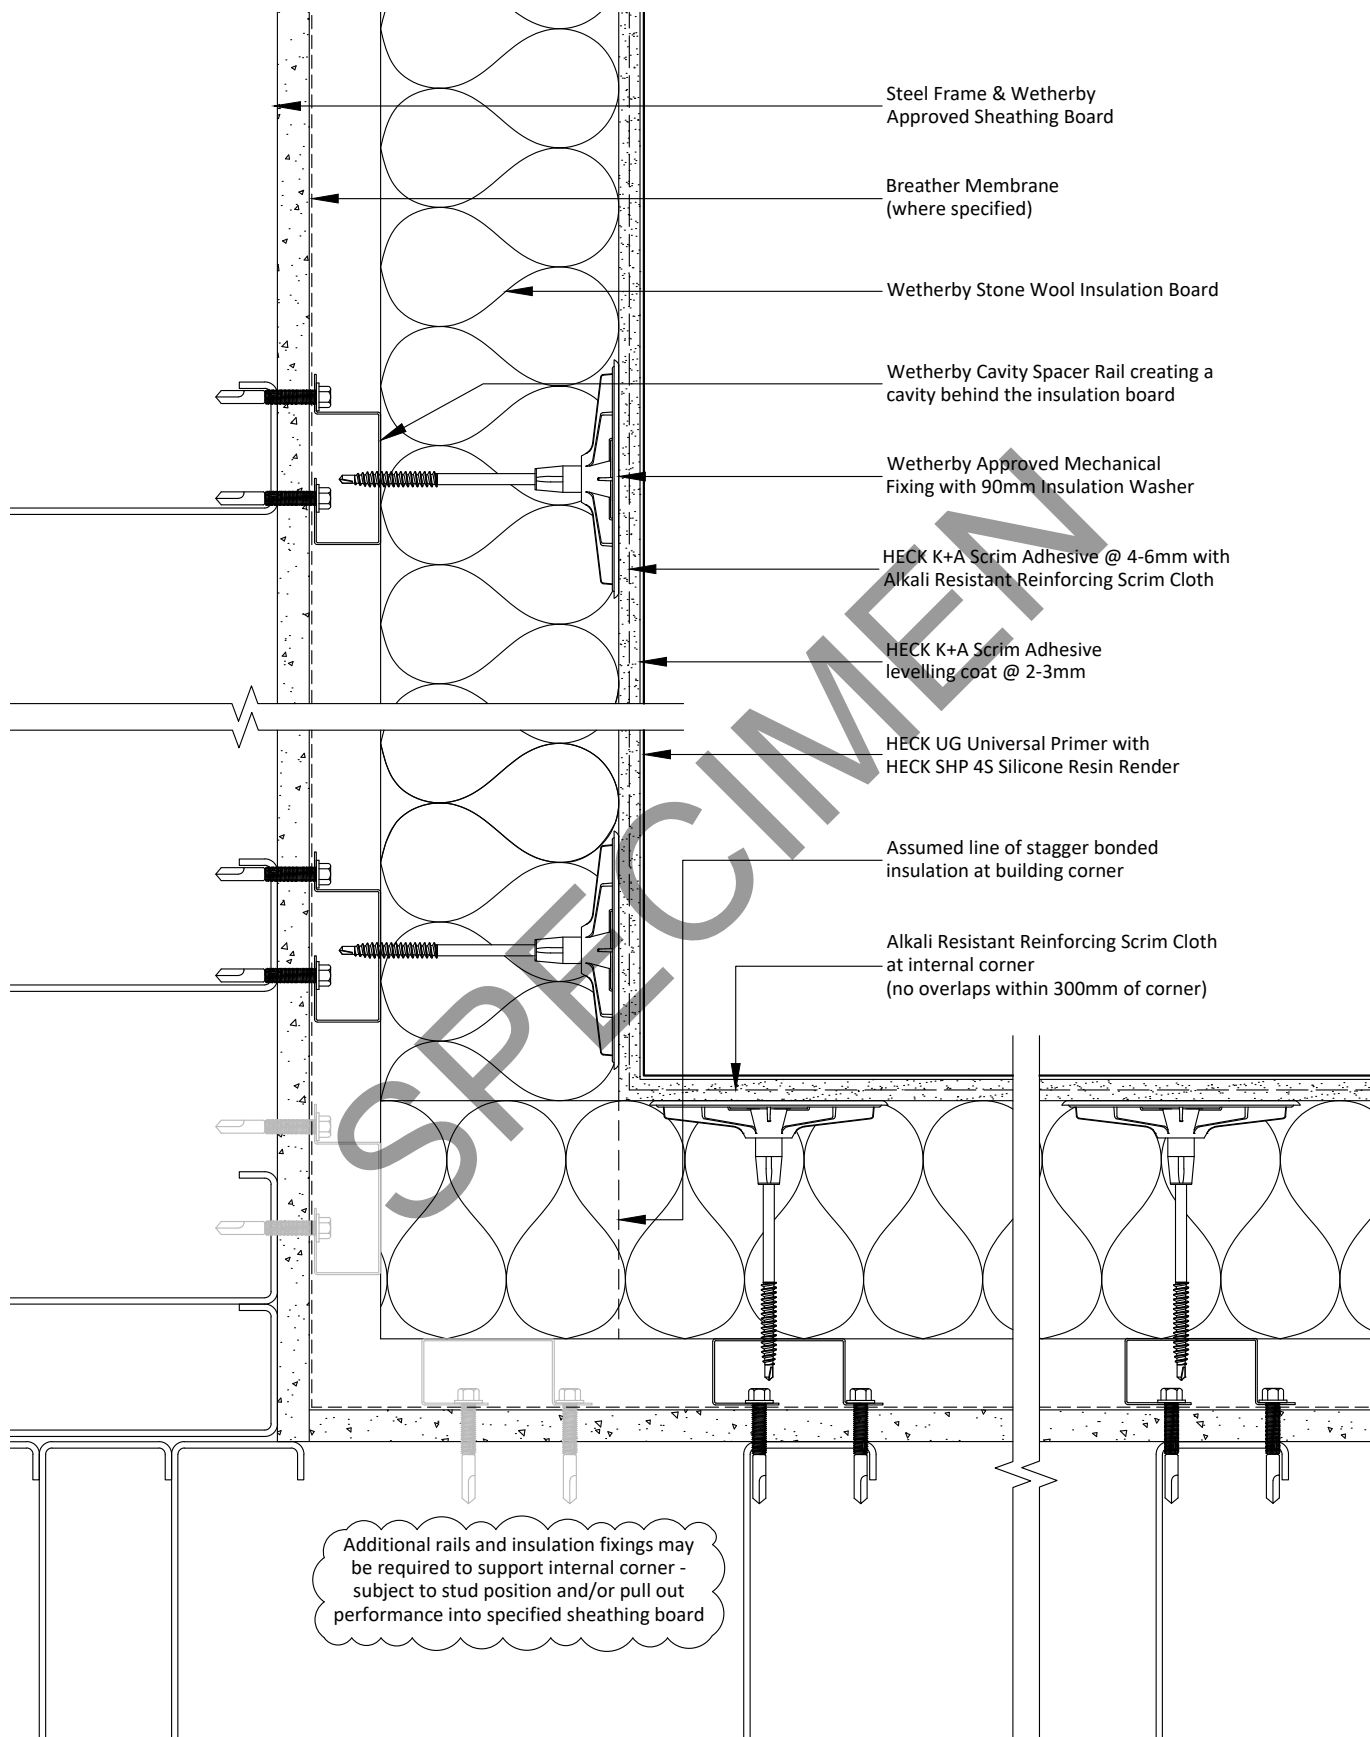

Project Name:

Typical Details - Stone Wool with Silicone Render

Drawing Title:

Internal Corner Detail

Drawing No:

WWS-EWI-S-RR-SW-SIL-3001

Drawn by: N.K

Checked by: J.R

Revision: -

Scale: NTS

Date: 20.03.2026

Drawing Set: WWS-24

Wetherby Wall Systems Ltd

WETHERBY
Wall Systems Part of ROCKWOOL Group

1 Kid Glove Road, Golborne, WA3 3GS


Tel: 01942 717100 Fax: 01942 717101

Web: www.wall-systems.co.uk

E-mail: technical@wall-systems.co.uk

© WWS-LTD 1998-2025. All rights reserved


Note: The intent of this drawing is to show the correct application of Wetherby products and systems only. All other building elements are shown for illustrative purposes only and it is not intended to detail the building construction. Detail drawings must be read in conjunction with the Wetherby project specific specification with the specification information taking precedence.

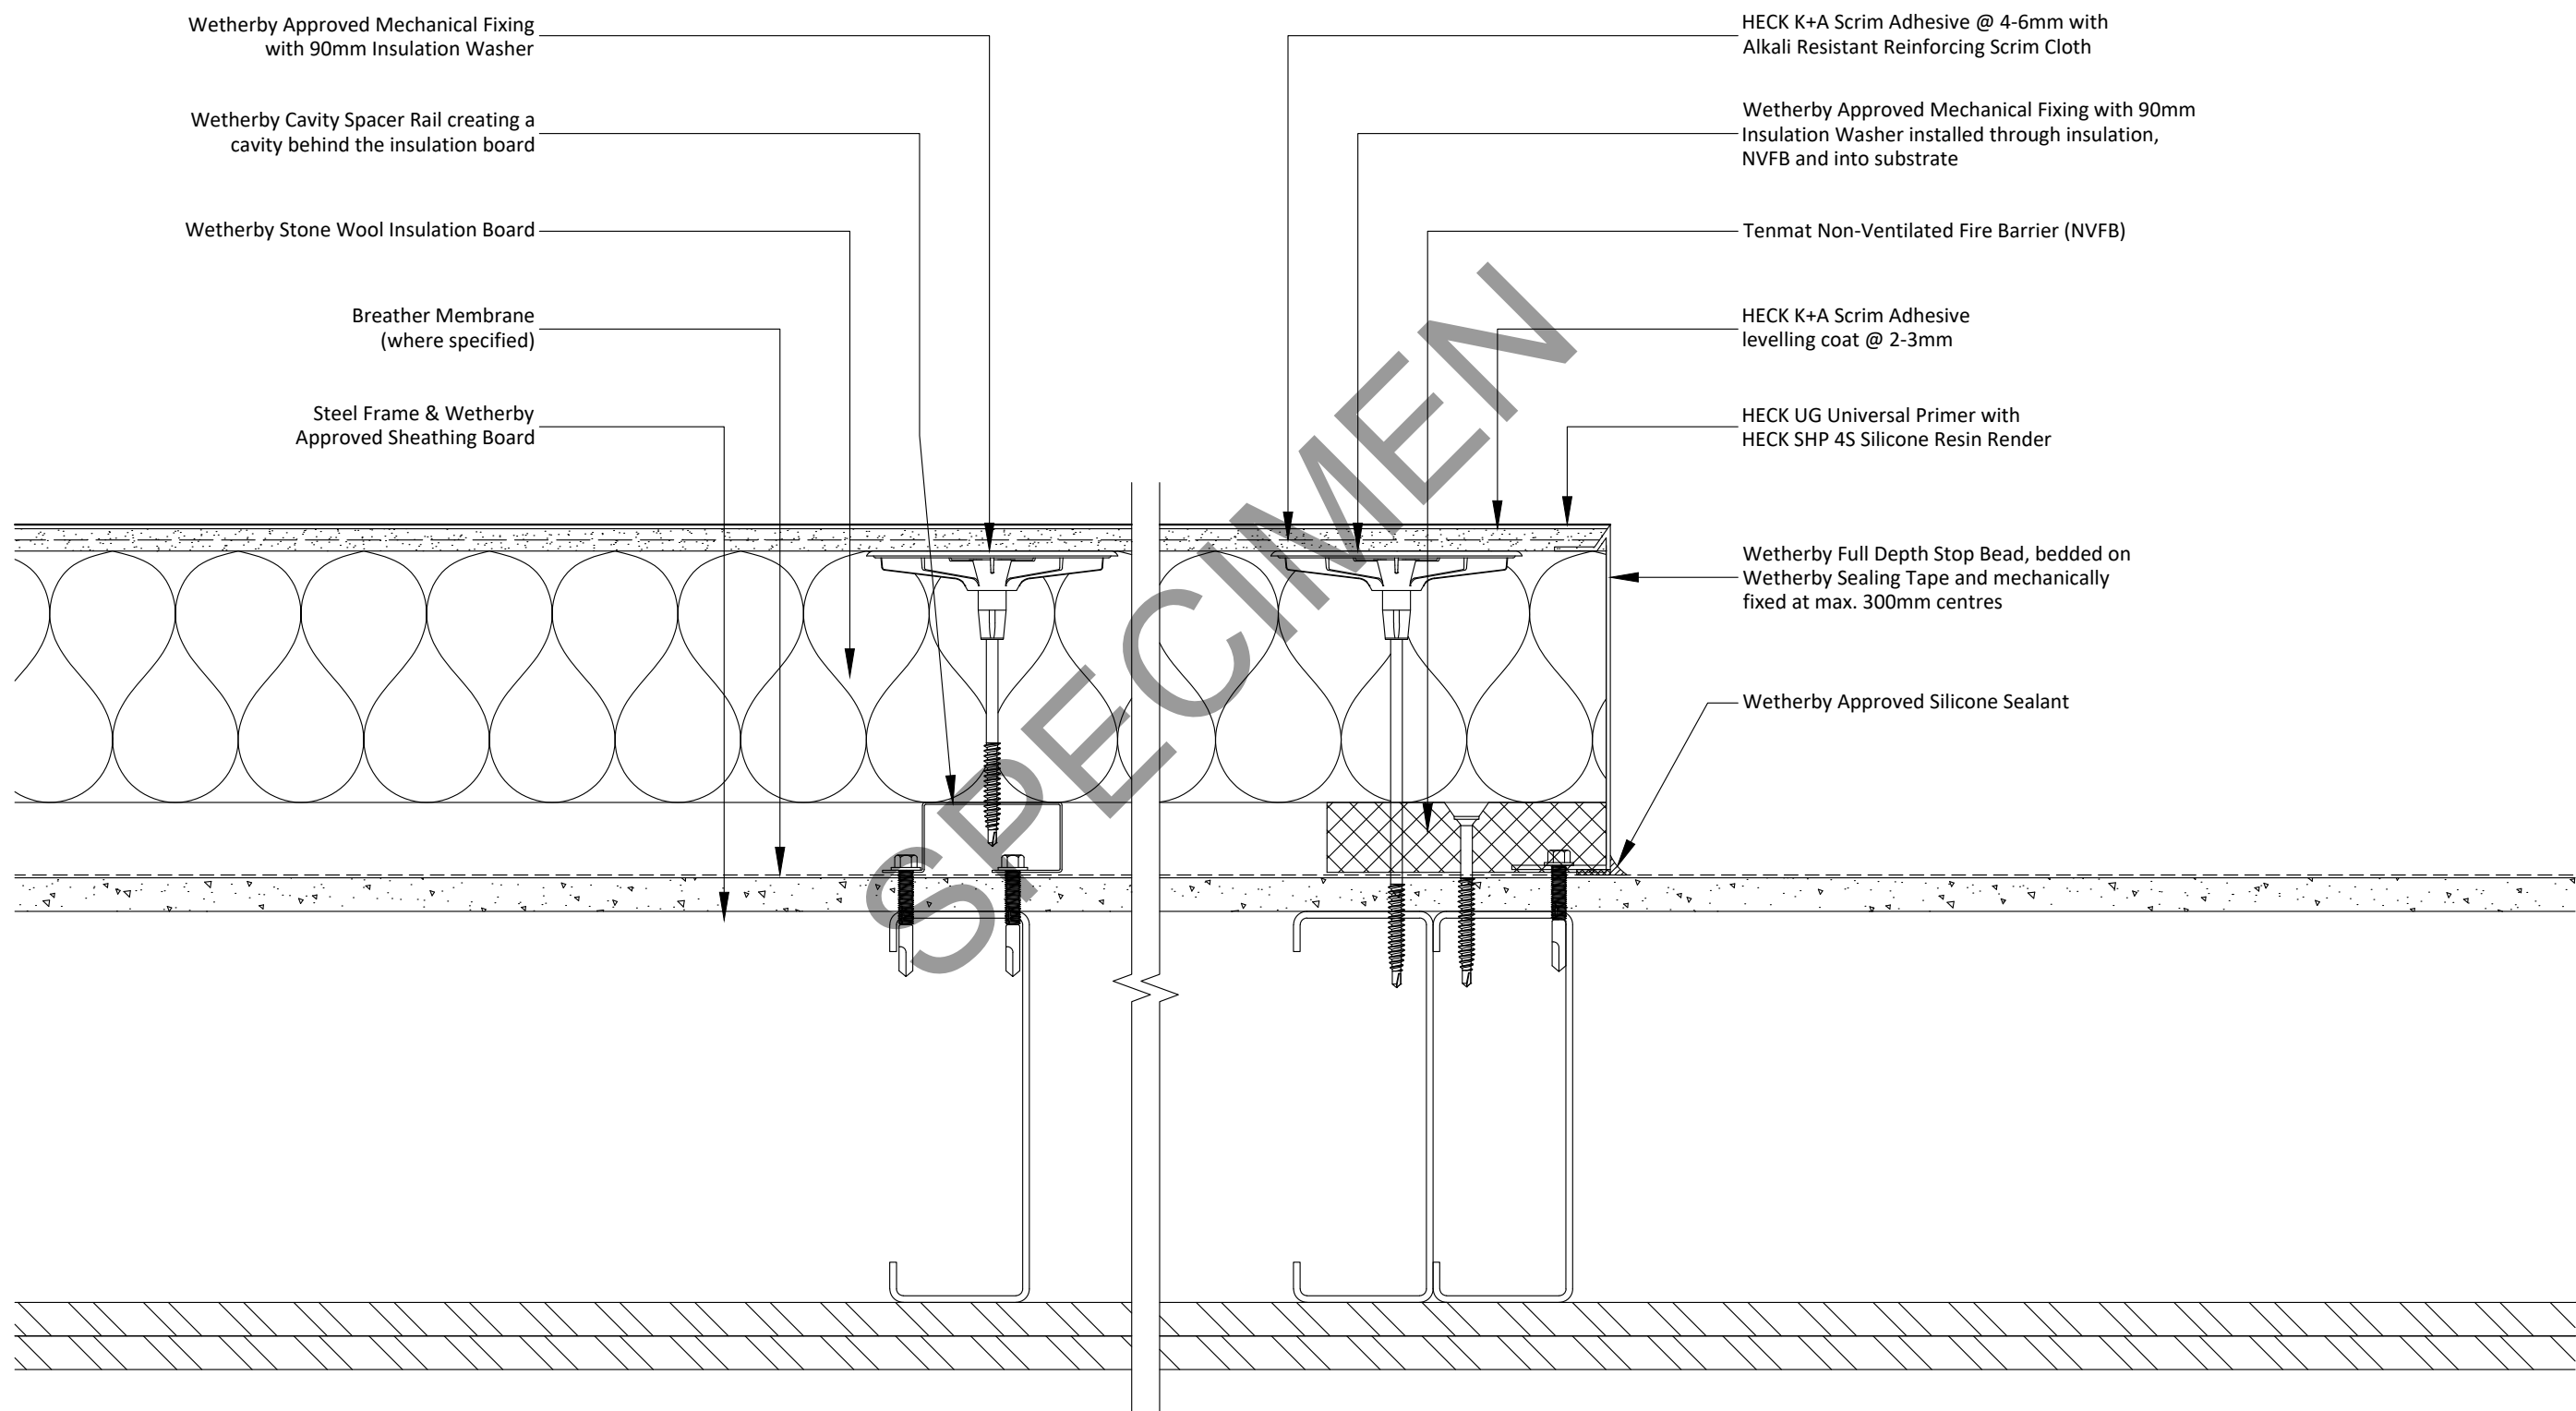

Notes:
1 - Tenmat Non-Ventilated Fire Barrier (NVFB) Closed State Cavity Fire Barrier must be installed under min. 2mm compression and must be mechanically fixed at max. 500mm centres and max. 250mm from each end.
2 - Detail creates a potential cold bridge. To be assessed and agreed specific to individual property.

Project Name:	Drawn by: N.K	Wetherby Wall Systems Ltd	WETHERBY Wall Systems 1 Kid Glove Road, Golborne, WA3 3GS Tel: 01942 717100 Fax: 01942 717101 Web: www.wall-systems.co.uk E-mail: technical@wall-systems.co.uk © WWS-LTD 1998-2025. All rights reserved
Typical Details - Stone Wool with Silicone Render	Checked by: J.R		
Drawing Title:	Revision: -		
Vertical Termination Detail A (Stop Bead)	Scale: NTS		
Drawing No:	Date: 20.03.2026		
WWS-EWI-S-RR-SW-SIL-3002	Drawing Set: WWS-24		


Note: The intent of this drawing is to show the correct application of Wetherby products and systems only. All other building elements are shown for illustrative purposes only and it is not intended to detail the building construction. Detail drawings must be read in conjunction with the Wetherby project specific specification with the specification information taking precedence.

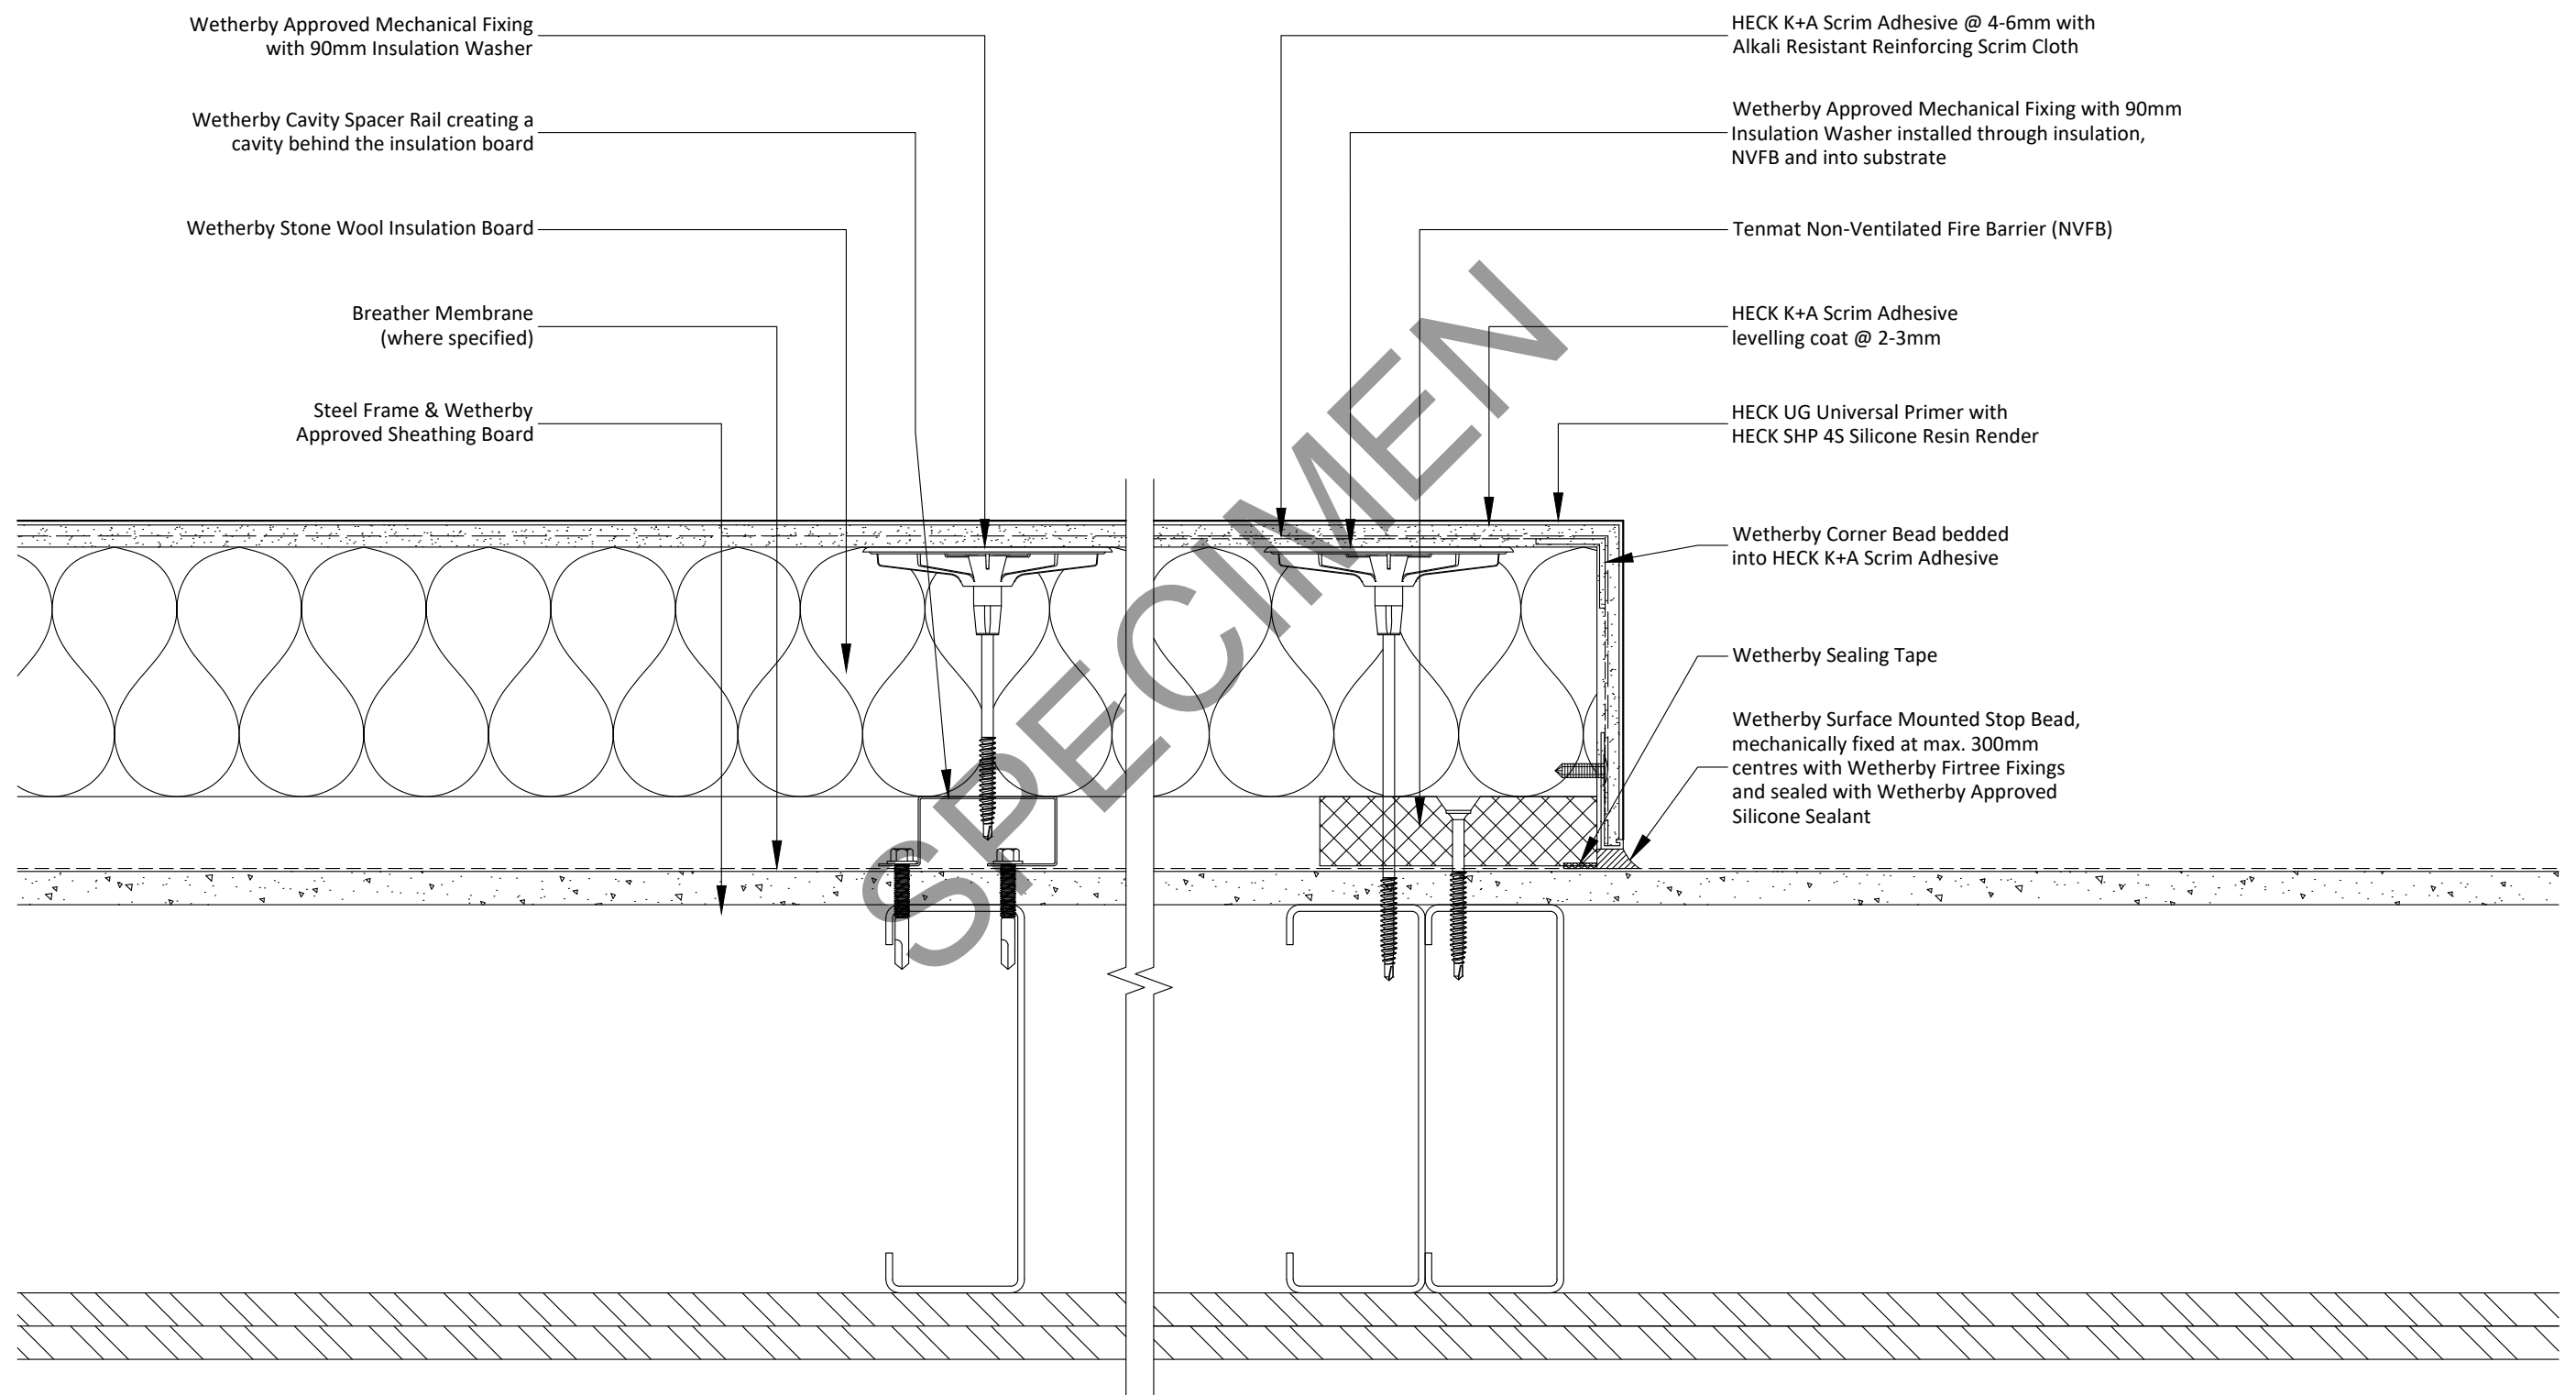

- Notes:**
- 1 - Tenmat Non-Ventilated Fire Barrier (NVFB) Closed State Cavity Fire Barrier must be installed under min. 2mm compression and must be mechanically fixed at max. 500mm centres and max. 250mm from each end.
 - 2 - Detail creates a potential cold bridge. To be assessed and agreed specific to individual property.

Project Name:	Drawn by: N.K	Wetherby Wall Systems Ltd	WETHERBY Wall Systems Part of ROCKWOOL Group 1 Kid Glove Road, Golborne, WA3 3GS Tel: 01942 717100 Fax: 01942 717101 Web: www.wall-systems.co.uk E-mail: technical@wall-systems.co.uk © WWS-LTD 1998-2025. All rights reserved
Typical Details - Stone Wool with Silicone Render	Checked by: J.R		
Drawing Title:	Revision: -		
Vertical Termination Detail B (Render Return)	Scale: NTS		
Drawing No:	Date: 20.03.2026		
WWS-EWI-S-RR-SW-SIL-3003	Drawing Set: WWS-24		

Note: The intent of this drawing is to show the correct application of Wetherby products and systems only. All other building elements are shown for illustrative purposes only and it is not intended to detail the building construction. Detail drawings must be read in conjunction with the Wetherby project specific specification with the specification information taking precedence.

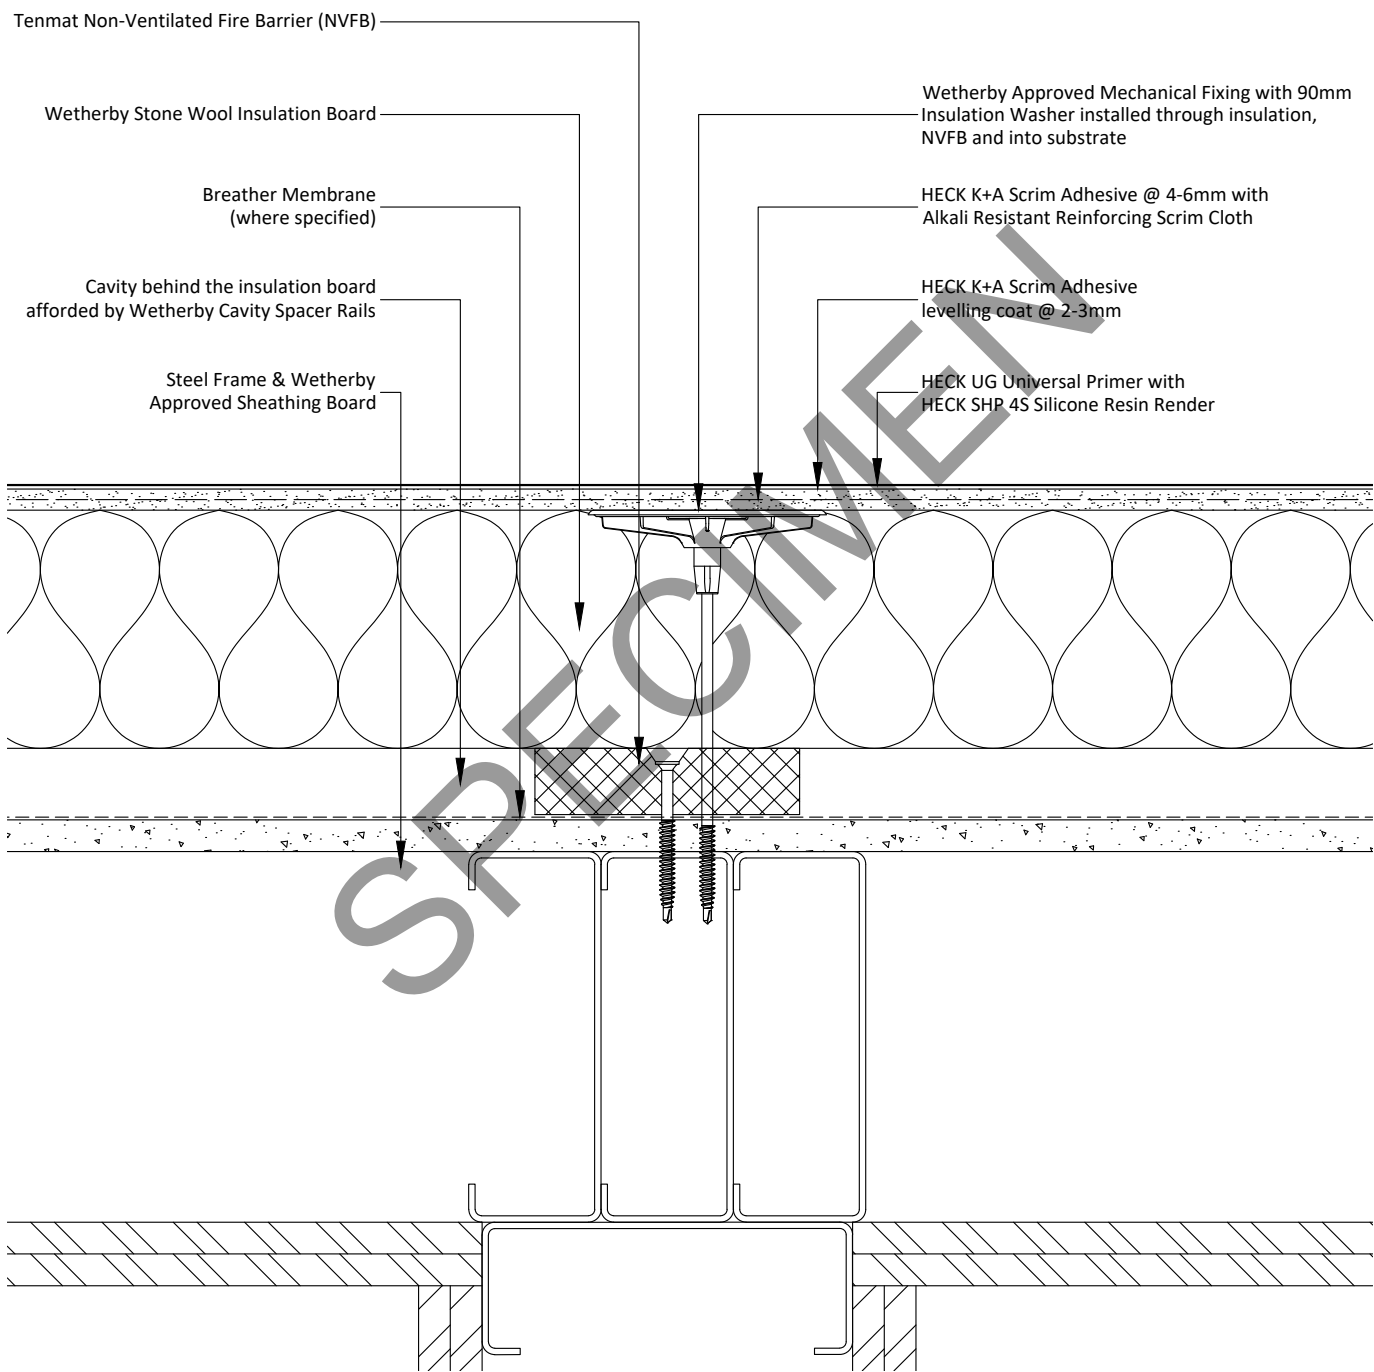


Notes:

- 1 - Tenmat Non-Ventilated Fire Barrier (NVFB) Closed State Cavity Fire Barrier must be installed under min. 2mm compression and must be mechanically fixed at max. 500mm centres and max. 250mm from each end.

Project Name:	Drawn by: N.K	Wetherby Wall Systems Ltd	WETHERBY Wall Systems Part of ROCKWOOL Group 1 Kid Glove Road, Golborne, WA3 3GS Tel: 01942 717100 Fax: 01942 717101 Web: www.wall-systems.co.uk E-mail: technical@wall-systems.co.uk © WWS-LTD 1998-2025. All rights reserved
Typical Details - Stone Wool with Silicone Render	Checked by: J.R		
Drawing Title:	Revision: -		
Vertical Fire Barrier Detail	Scale: NTS		
Drawing No:	Date: 20.03.2026		
WWS-EWI-S-RR-SW-SIL-3004	Drawing Set: WWS-24		

Note: The intent of this drawing is to show the correct application of Wetherby products and systems only. All other building elements are shown for illustrative purposes only and it is not intended to detail the building construction. Detail drawings must be read in conjunction with the Wetherby project specific specification with the specification information taking precedence.

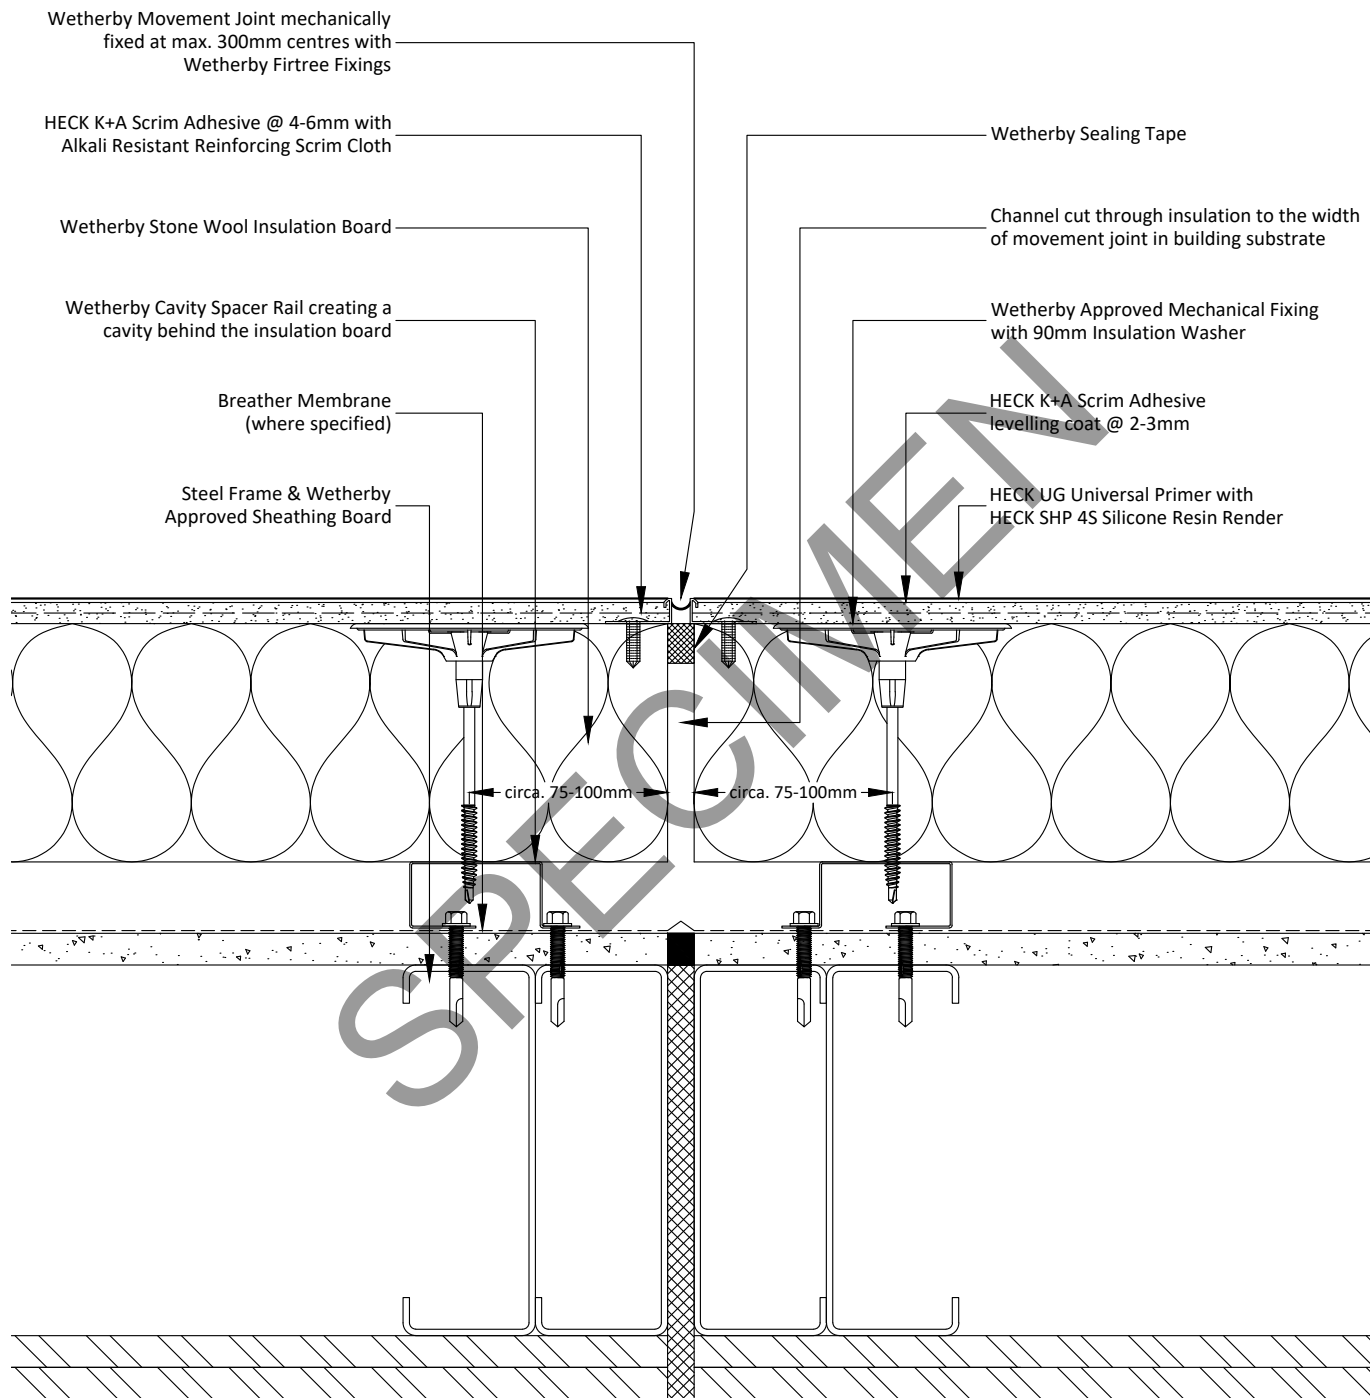

Notes:

- 1 - All existing structural movement must be replicated in the EWI system.
- 2 - If movement joint is located at compartment walls, Tenmat Non-Ventilated Fire Barrier (NVFB) Closed State Cavity Fire Barriers will be required in lieu of the Wetherby Cavity Spacer Rails. Contact Wetherby Technical Department for further guidance.

Project Name:

Typical Details - Stone Wool with Silicone Render

Drawing Title:

Vertical Movement Joint Detail

Drawing No:

WWS-EWI-S-RR-SW-SIL-4000

Drawn by: N.K

Checked by: J.R

Revision: -

Scale: NTS

Date: 20.03.2026

Drawing Set: WWS-24

Wetherby Wall Systems Ltd

WETHERBY
Wall Systems Part of ROCKWOOL Group

1 Kid Glove Road, Golborne, WA3 3GS


Tel: 01942 717100 Fax: 01942 717101

Web: www.wall-systems.co.uk

E-mail: technical@wall-systems.co.uk

© WWS-LTD 1998-2025. All rights reserved

Note: The intent of this drawing is to show the correct application of Wetherby products and systems only. All other building elements are shown for illustrative purposes only and it is not intended to detail the building construction. Detail drawings must be read in conjunction with the Wetherby project specific specification with the specification information taking precedence.

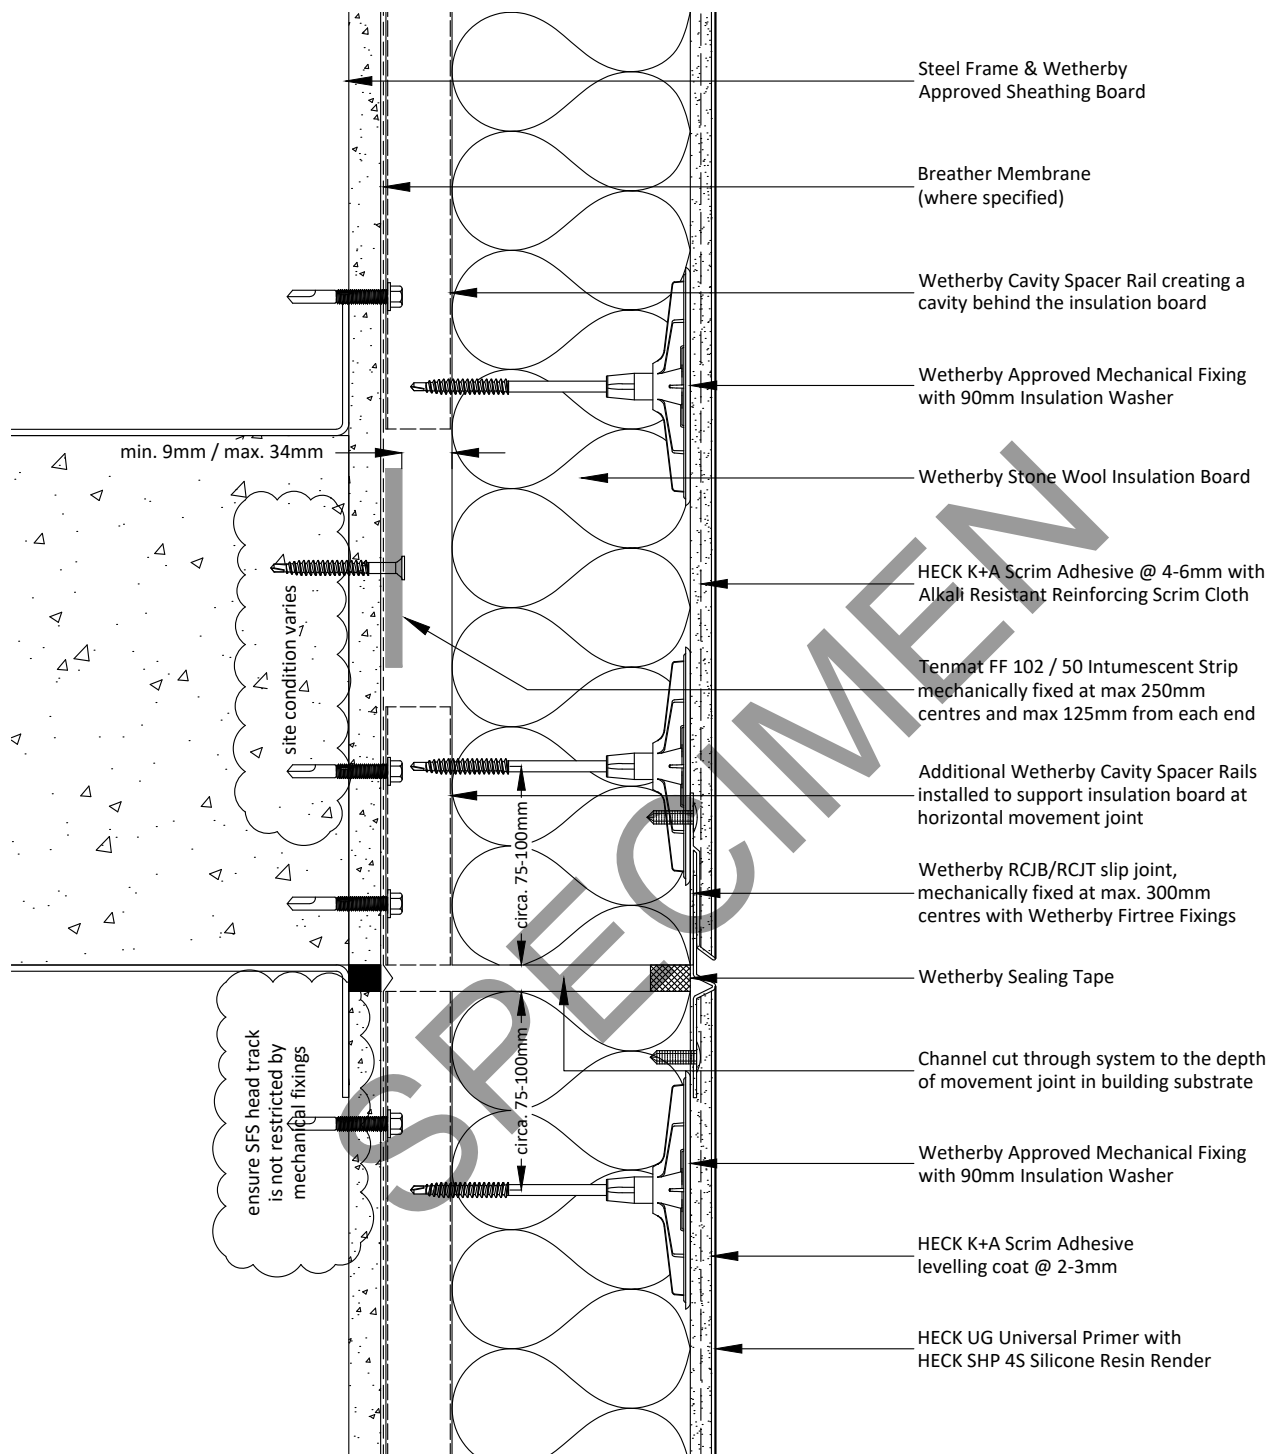

Notes:

- 1 - All existing structural movement must be replicated in the EWI system.
- 2 - Concrete floor slab position shown indicatively only, positioning to be confirmed by site survey.
- 3 - Intumescent Strip position / requirements to be confirmed subject to project specific detailing. A minimum 9mm and maximum 34mm cavity must be maintained when measured from the front of the intumescent strip and rear of the insulation board. Contact Wetherby Technical Department for further guidance.
- 4 - Min. 100mm wide jointing pieces must to be installed at connections between adjacent lengths of RCJB horizontal movement joint profiles and at connections with any pre-welded internal or external corner profiles.

Project Name:

Typical Details - Stone Wool with Silicone Render

Drawing Title:

Horizontal Movement Joint Detail

Drawing No:

WWS-EWI-S-RR-SW-SIL-4001

Drawn by: N.K

Checked by: J.R

Revision: -

Scale: NTS

Date: 20.03.2026

Drawing Set: WWS-24

Wetherby Wall Systems Ltd

WETHERBY
Wall Systems Part of ROCKWOOL Group

1 Kid Glove Road, Golborne, WA3 3GS


Tel: 01942 717100 Fax: 01942 717101

Web: www.wall-systems.co.uk

E-mail: technical@wall-systems.co.uk

© WWS-LTD 1998-2025. All rights reserved

Note: The intent of this drawing is to show the correct application of Wetherby products and systems only. All other building elements are shown for illustrative purposes only and it is not intended to detail the building construction. Detail drawings must be read in conjunction with the Wetherby project specific specification with the specification information taking precedence.

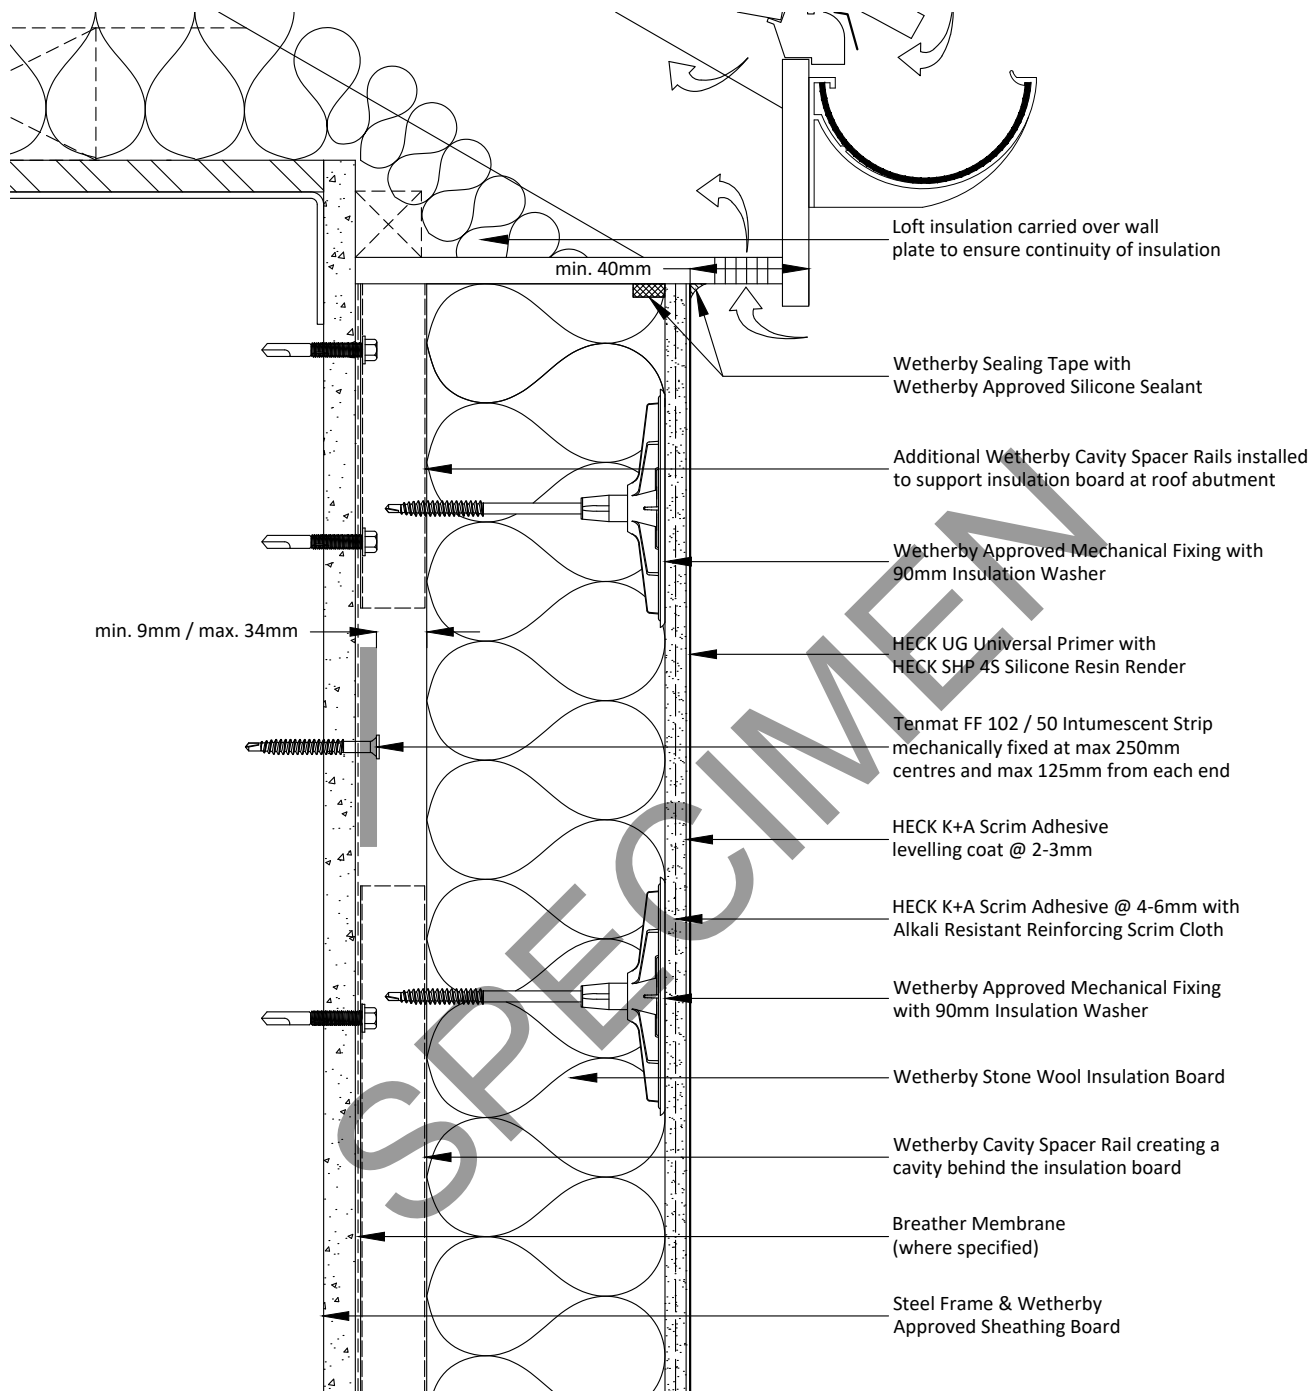


Notes:

- 1 - Intumescent Strip position / requirements to be confirmed subject to project specific detailing. A minimum 9mm and maximum 34mm cavity must be maintained when measured from the front of the intumescent strip and rear of the insulation board. Contact Wetherby Technical Department for further guidance.
- 2 - Tenmat Non-Ventilated Fire Barrier (NVFB) Closed State Cavity Fire Barriers can also be used as an alternative to the FF 102 / 50 Intumescent Strip. Contact Wetherby Technical Department for alternative detail.
- 3 - Loft insulation must be present to reduce cold bridging and to maintain continuity of insulation.
- 4 - In severe/very severe exposure zones, roof overhang should be increased to min. 50mm.
- 5 - Existing ventilation must not be obstructed or must be re-positioned.
(existing soffit to have sufficient ventilation retained or check for over fascia ventilation)

Project Name:	Drawn by: N.K	Wetherby Wall Systems Ltd	 1 Kid Glove Road, Golborne, WA3 3GS Tel: 01942 717100 Fax: 01942 717101 Web: www.wall-systems.co.uk E-mail: technical@wall-systems.co.uk © WWS-LTD 1998-2025. All rights reserved
Typical Details - Stone Wool with Silicone Render	Checked by: J.R		
Drawing Title:	Revision: -		
Eaves Detail (Intumescent Strip)	Scale: NTS		
Drawing No:	Date: 20.03.2026		
WWS-EWI-S-RR-SW-SIL-5000	Drawing Set: WWS-24		

Note: The intent of this drawing is to show the correct application of Wetherby products and systems only. All other building elements are shown for illustrative purposes only and it is not intended to detail the building construction. Detail drawings must be read in conjunction with the Wetherby project specific specification with the specification information taking precedence.

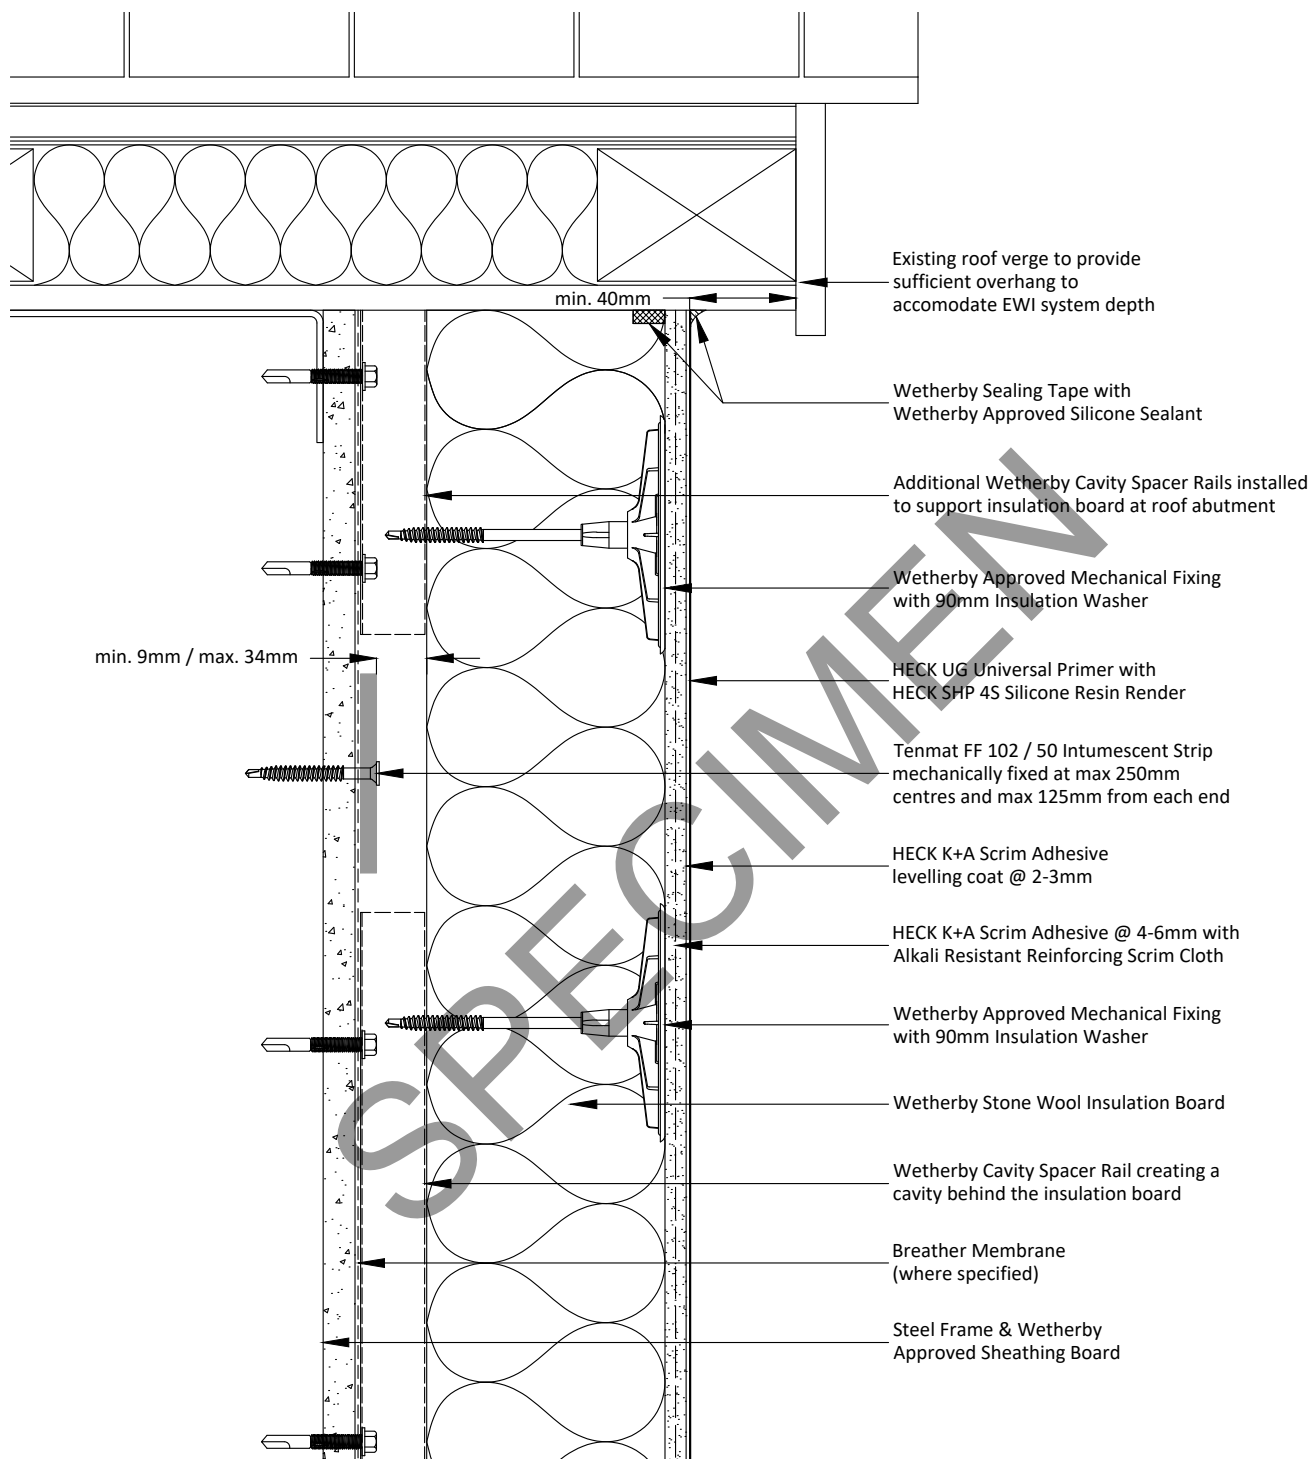

Notes:

- 1 - Intumescent Strip position / requirements to be confirmed subject to project specific detailing. A minimum 9mm and maximum 34mm cavity must be maintained when measured from the front of the intumescent strip and rear of the insulation board. Contact Wetherby Technical Department for further guidance.
- 2 - Tenmat Non-Ventilated Fire Barrier (NVFB) Closed State Cavity Fire Barriers can also be used as an alternative to the FF 102 / 50 Intumescent Strip. Contact Wetherby Technical Department for alternative detail.
- 3 - Loft insulation must be present to reduce cold bridging and to maintain continuity of insulation.
- 4 - In severe/very severe exposure zones, roof overhang should be increased to min. 50mm.

Project Name:

Typical Details - Stone Wool with Silicone Render

Drawing Title:

Verge Detail (Intumescent Strip)

Drawing No:

WWS-EWI-S-RR-SW-SIL-5001

Drawn by: N.K

Checked by: J.R

Revision: -

Scale: NTS

Date: 20.03.2026

Drawing Set: WWS-24

Wetherby Wall Systems Ltd

WETHERBY
Wall Systems Part of ROCKWOOL Group

1 Kid Glove Road, Golborne, WA3 3GS


Tel: 01942 717100 Fax: 01942 717101

Web: www.wall-systems.co.uk

E-mail: technical@wall-systems.co.uk

© WWS-LTD 1998-2025. All rights reserved

Note: The intent of this drawing is to show the correct application of Wetherby products and systems only. All other building elements are shown for illustrative purposes only and it is not intended to detail the building construction. Detail drawings must be read in conjunction with the Wetherby project specific specification with the specification information taking precedence.

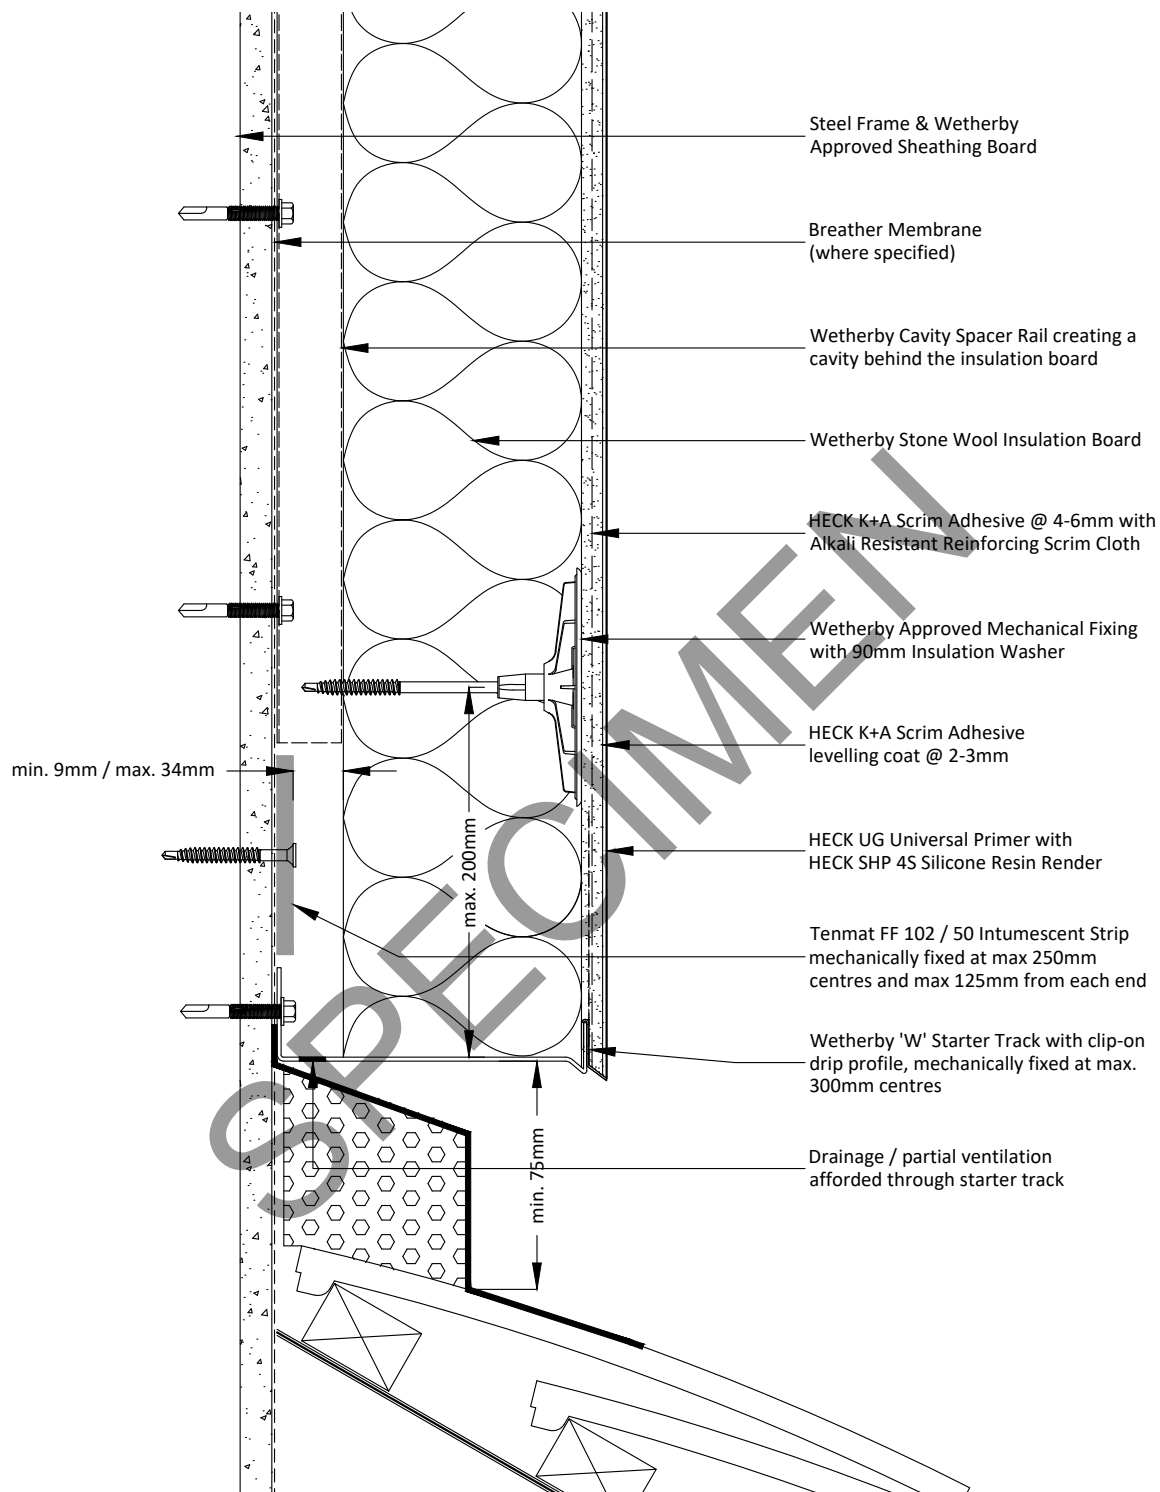

Notes:

- 1 - Intumescent Strip position / requirements to be confirmed subject to project specific detailing. A minimum 9mm and maximum 34mm cavity must be maintained when measured from the front of the intumescent strip and rear of the insulation board. Contact Wetherby Technical Department for further guidance.
- 2 - Insulation within roof upstand must be present to reduce cold bridging.
- 3 - Insulation at roof upstand should provide a minimum 75% of the thermal resistance of main wall insulation.
- 4 - Roof flashing/membrane can also be located behind Wetherby Starter Track and dressed into the wall.

Project Name:

Typical Details - Stone Wool with Silicone Render

Drawing Title:

Pitched Roof Abutment Detail

Drawing No:

WWS-EWI-S-RR-SW-SIL-5002

Drawn by: N.K

Checked by: J.R

Revision: -

Scale: NTS

Date: 20.03.2026

Drawing Set: WWS-24

Wetherby Wall Systems Ltd

WETHERBY
Wall Systems Part of ROCKWOOL Group

1 Kid Glove Road, Golborne, WA3 3GS


Tel: 01942 717100 Fax: 01942 717101

Web: www.wall-systems.co.uk

E-mail: technical@wall-systems.co.uk

© WWS-LTD 1998-2025. All rights reserved

Note: The intent of this drawing is to show the correct application of Wetherby products and systems only. All other building elements are shown for illustrative purposes only and it is not intended to detail the building construction. Detail drawings must be read in conjunction with the Wetherby project specific specification with the specification information taking precedence.

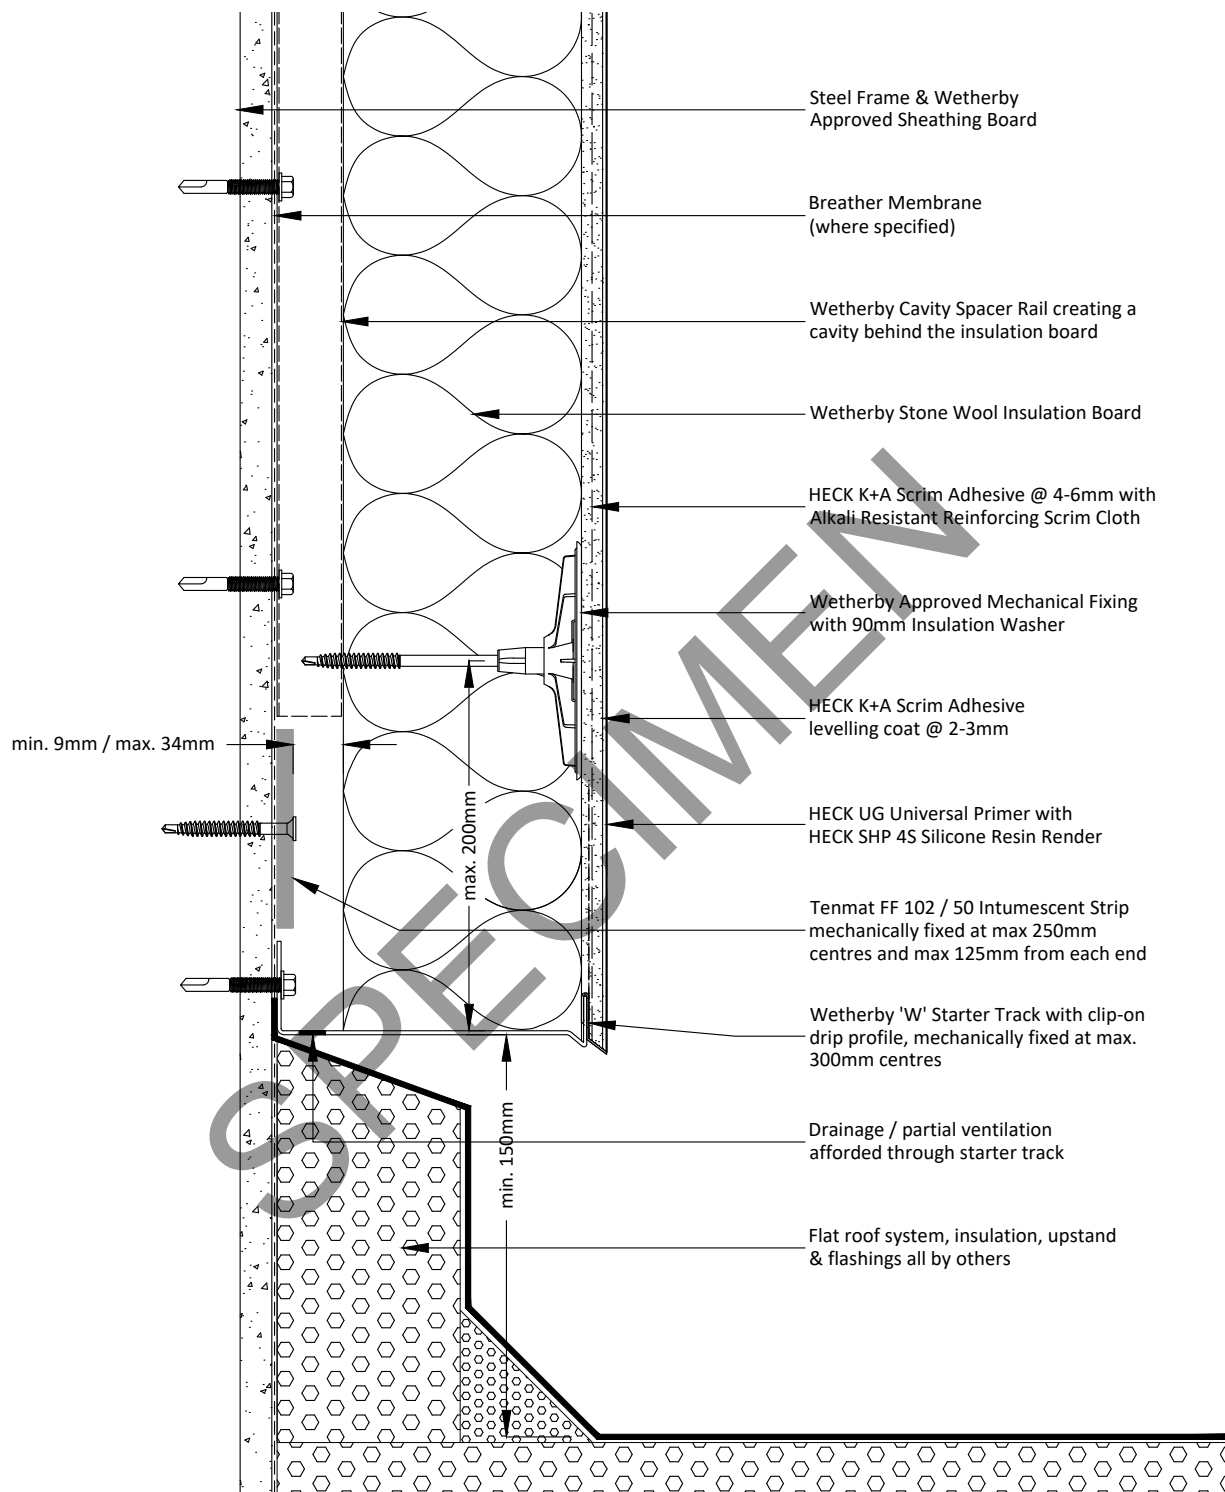

Notes:

- 1 - Intumescent Strip position / requirements to be confirmed subject to project specific detailing. A minimum 9mm and maximum 34mm cavity must be maintained when measured from the front of the intumescent strip and rear of the insulation board. Contact Wetherby Technical Department for further guidance.
- 2 - Insulation within roof upstand must be present to reduce cold bridging.
- 3 - Insulation at roof upstand should provide a minimum 75% of the thermal resistance of main wall insulation.
- 4 - Roof flashing/membrane can also be located behind Wetherby Starter Track and dressed into the wall.

Project Name:

Typical Details - Stone Wool with Silicone Render

Drawing Title:

Flat Roof Abutment Detail

Drawing No:

WWS-EWI-S-RR-SW-SIL-5003

Drawn by: N.K

Checked by: J.R

Revision: -

Scale: NTS

Date: 20.03.2026

Drawing Set: WWS-24

Wetherby Wall Systems Ltd

WETHERBY
Wall Systems Part of ROCKWOOL Group

1 Kid Glove Road, Golborne, WA3 3GS


Tel: 01942 717100 Fax: 01942 717101

Web: www.wall-systems.co.uk

E-mail: technical@wall-systems.co.uk

© WWS-LTD 1998-2025. All rights reserved

Note: The intent of this drawing is to show the correct application of Wetherby products and systems only. All other building elements are shown for illustrative purposes only and it is not intended to detail the building construction. Detail drawings must be read in conjunction with the Wetherby project specific specification with the specification information taking precedence.

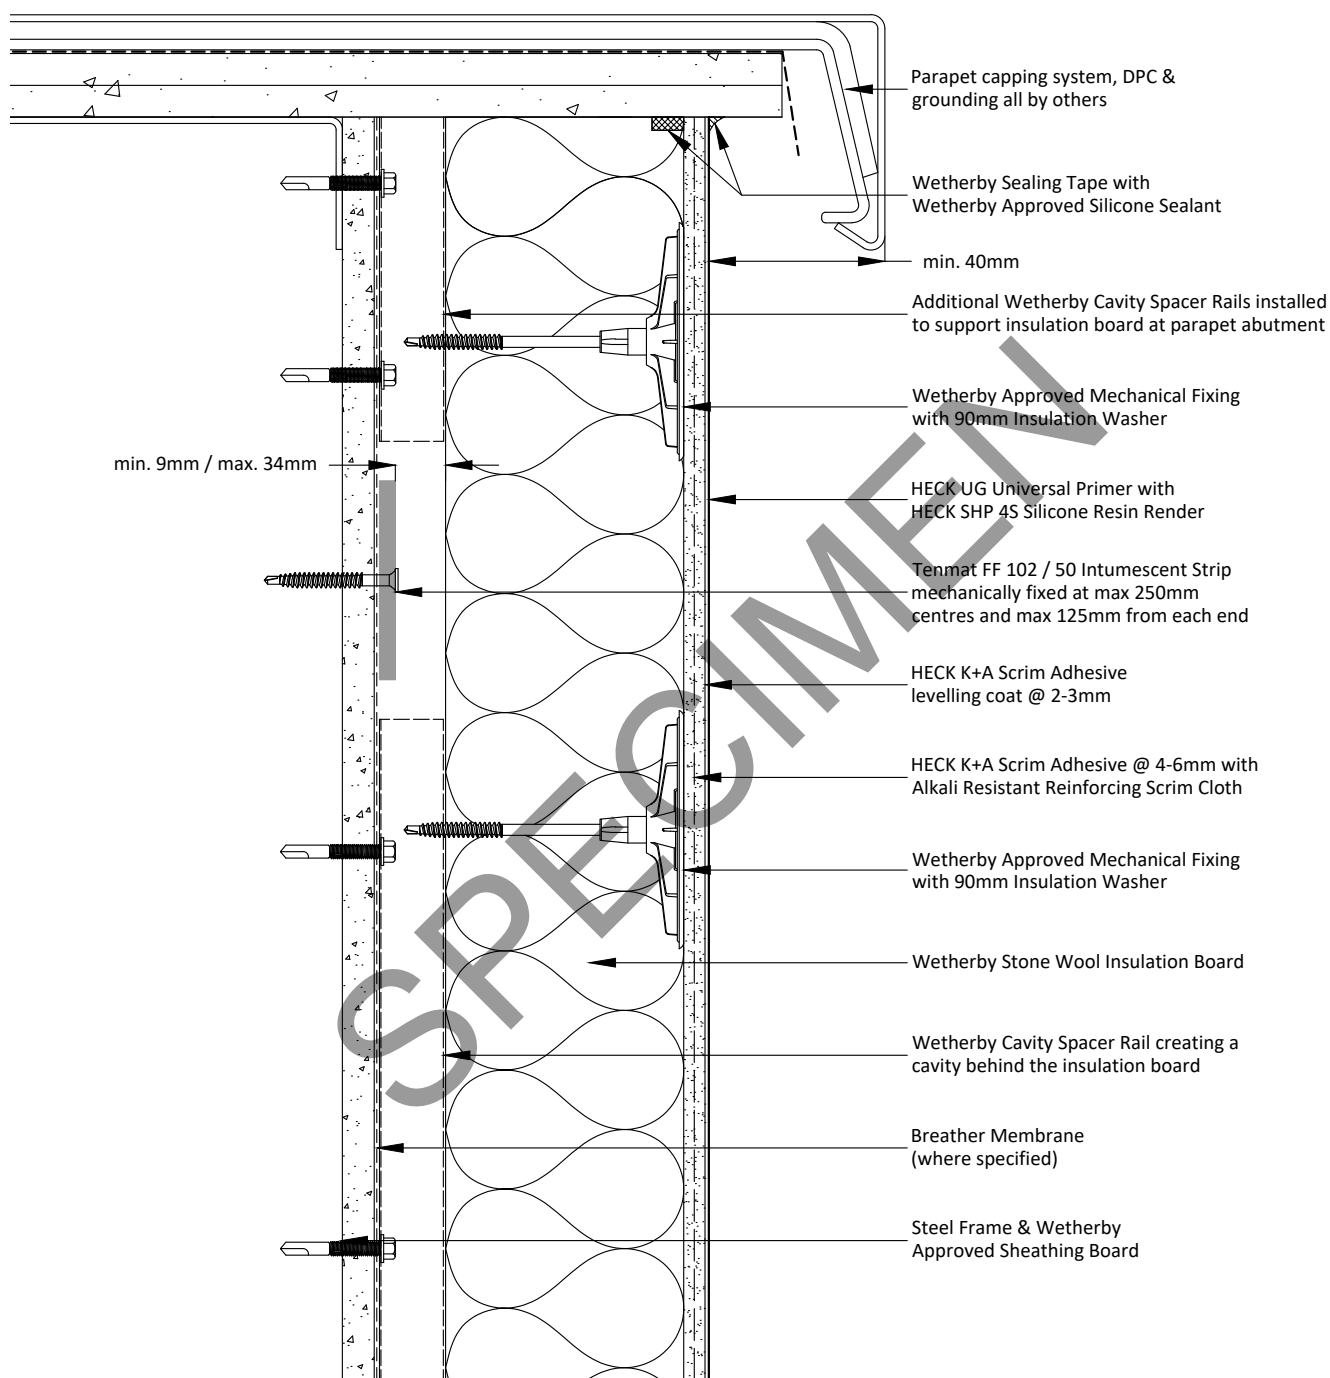


Notes:

- 1 - Intumescent Strip position / requirements to be confirmed subject to project specific detailing. A minimum 9mm and maximum 34mm cavity must be maintained when measured from the front of the intumescent strip and rear of the insulation board. Contact Wetherby Technical Department for further guidance.
- 2 - Tenmat Non-Ventilated Fire Barrier (NVFB) Closed State Cavity Fire Barriers can also be used as an alternative to the FF 102 / 50 Intumescent Strip. Contact Wetherby Technical Department for alternative detail.
- 3 - In severe/very severe exposure zones, roof overhang should be increased to min. 50mm.

Project Name:	Drawn by: N.K	Wetherby Wall Systems Ltd	 1 Kid Glove Road, Golborne, WA3 3GS Tel: 01942 717100 Fax: 01942 717101 Web: www.wall-systems.co.uk E-mail: technical@wall-systems.co.uk © WWS-LTD 1998-2025. All rights reserved
Typical Details - Stone Wool with Silicone Render	Checked by: J.R		
Drawing Title:	Revision: -		
Parapet Detail (Intumescent Strip)	Scale: NTS		
Drawing No:	Date: 20.03.2026		
WWS-EWI-S-RR-SW-SIL-5004	Drawing Set: WWS-24		

Note: The intent of this drawing is to show the correct application of Wetherby products and systems only. All other building elements are shown for illustrative purposes only and it is not intended to detail the building construction. Detail drawings must be read in conjunction with the Wetherby project specific specification with the specification information taking precedence.

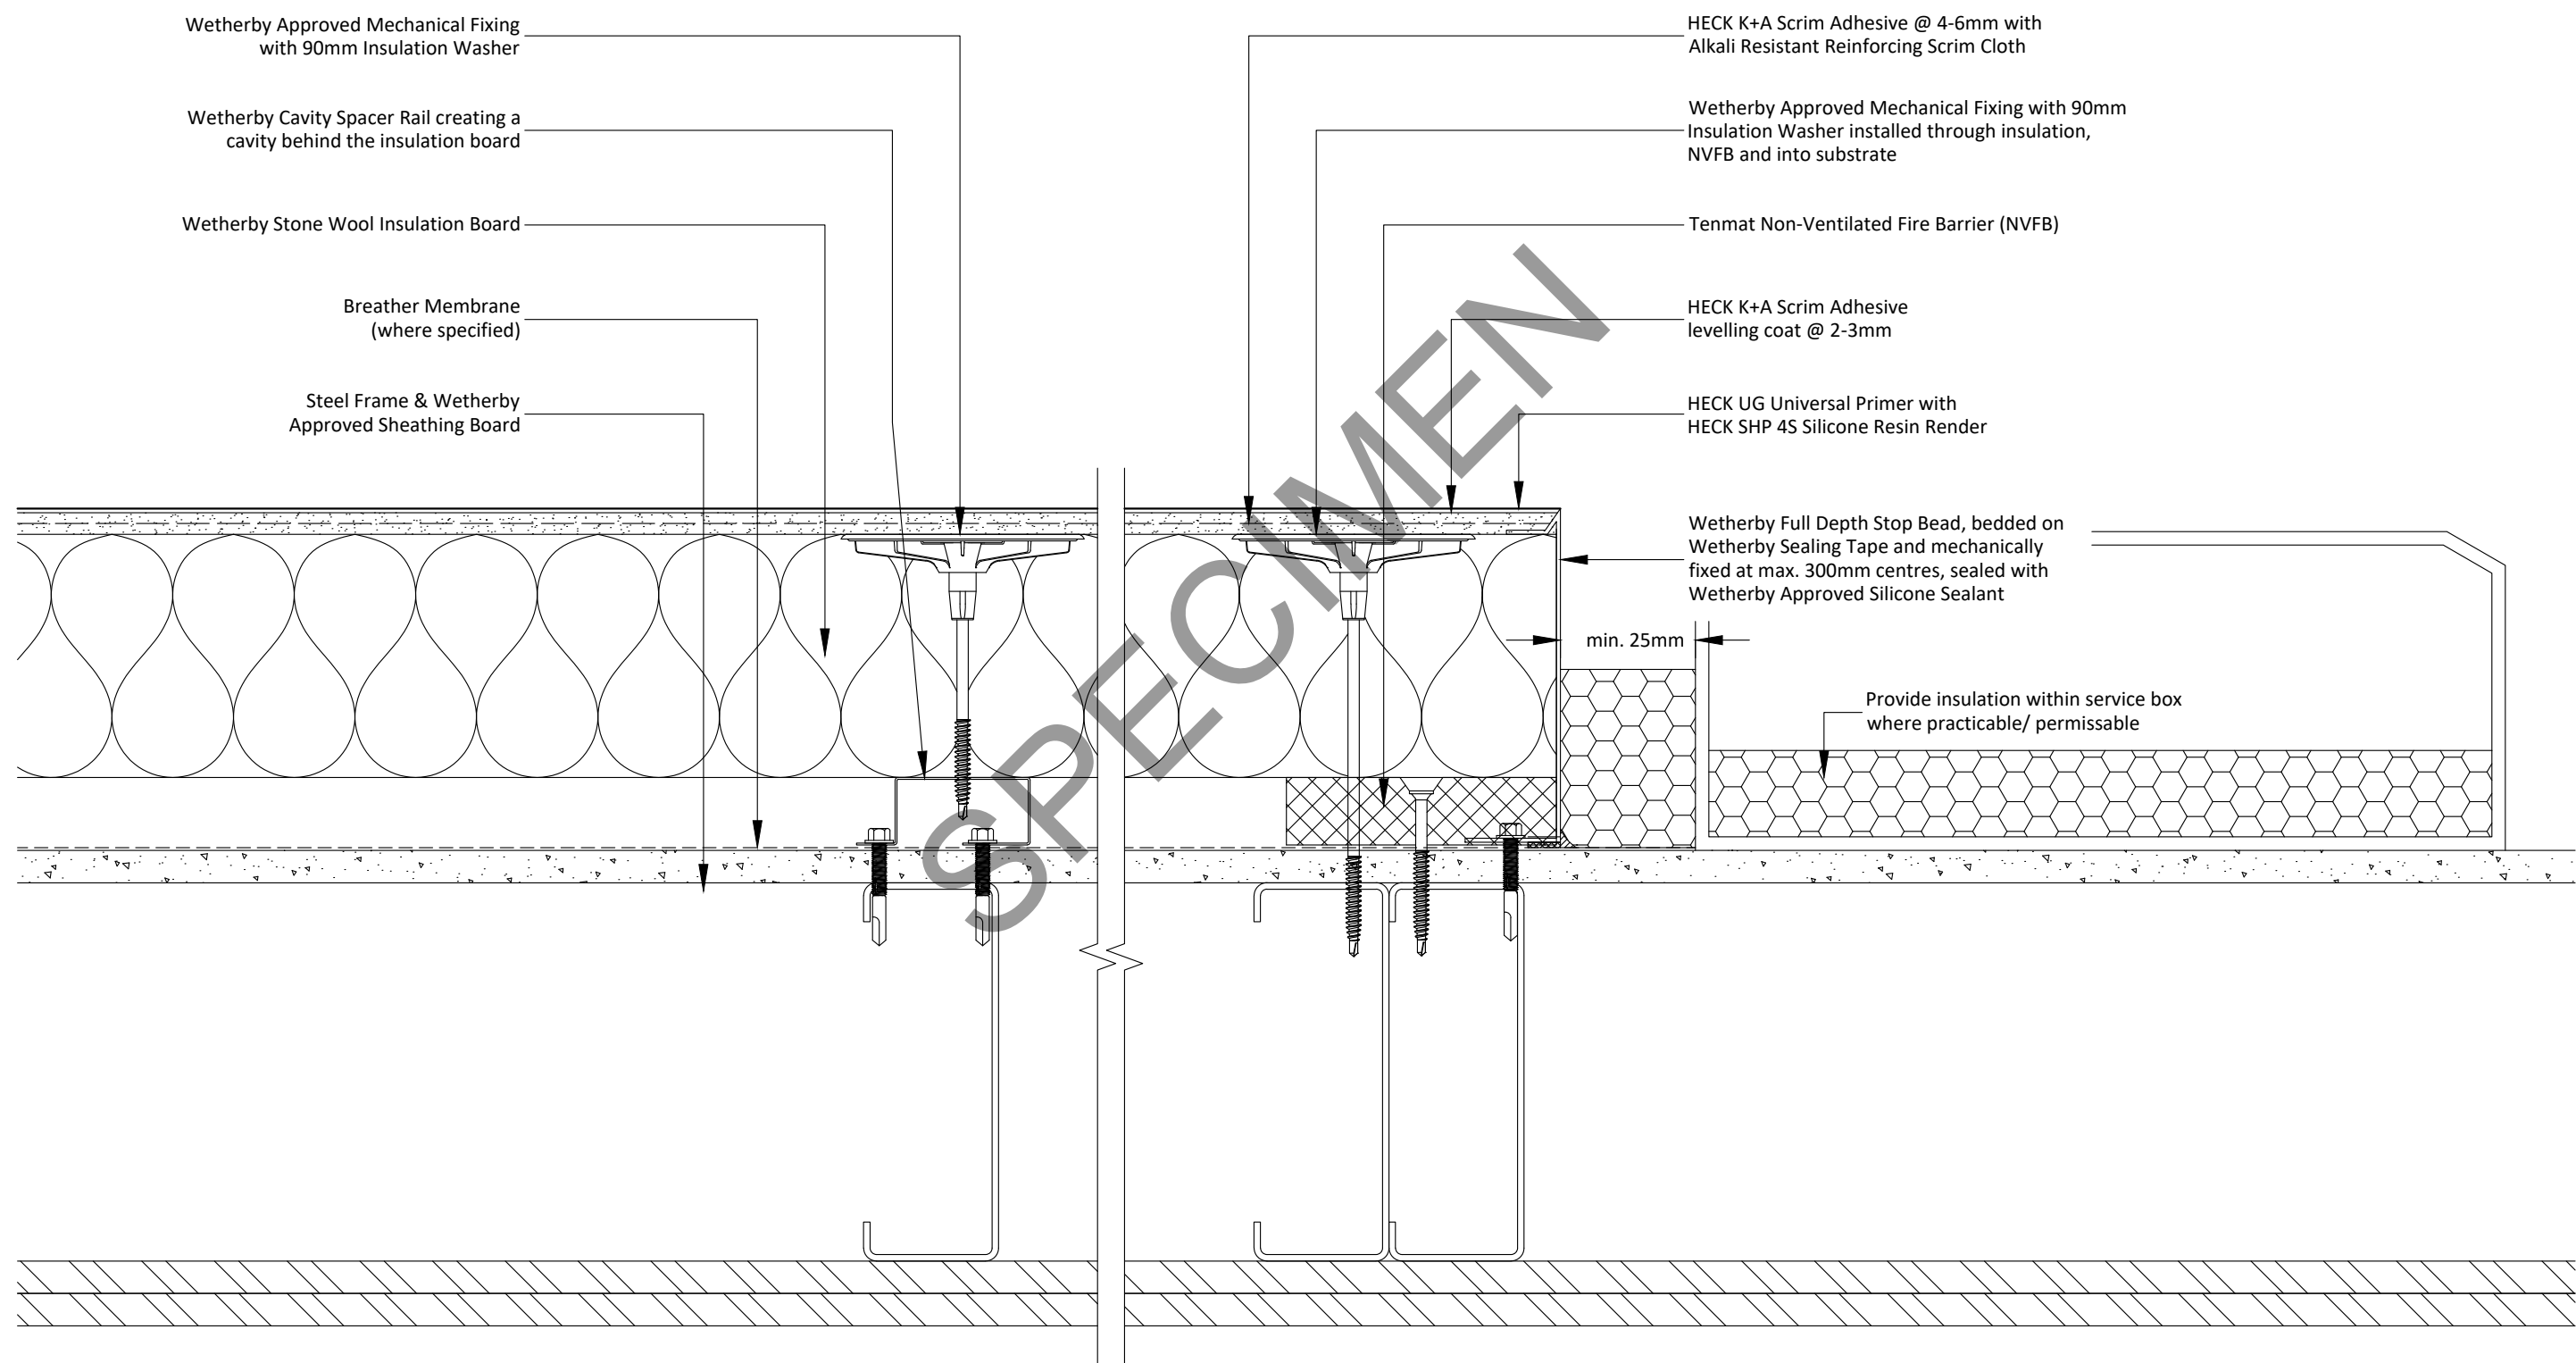


Notes:

- 1 - Tenmat Non-Ventilated Fire Barrier (NVFB) Closed State Cavity Fire Barrier must be installed under min. 2mm compression and must be mechanically fixed at max. 500mm centres and max. 250mm from each end.
- 2 - Detail creates a potential cold bridge. To be assessed and agreed specific to individual property.
- 3 - Existing service box must be in good condition.
- 4 - Refer to specification for the installation of external wall insulation ensuring safety and operation of fuel burning appliances V.1.0 31st March 2017'. Surface mounted gas meter boxes require a min. clearance of 25 mm for access and maintenance.
- 5 - This drawing indicates the minimum clearance dimensions. Actual clearance may require to be significantly more to facilitate maintenance, removal & replacement of the meter, including opening of the lid.

Project Name:	Drawn by: N.K	Wetherby Wall Systems Ltd	 1 Kid Glove Road, Golborne, WA3 3GS Tel: 01942 717100 Fax: 01942 717101 Web: www.wall-systems.co.uk E-mail: technical@wall-systems.co.uk © WWS-LTD 1998-2025. All rights reserved
Typical Details - Stone Wool with Silicone Render	Checked by: J.R		
Drawing Title:	Revision: -		
Service Box Abutment Detail - Removable Box	Scale: NTS		
Drawing No:	Date: 20.03.2026		
WWS-EWI-S-RR-SW-SIL-6000	Drawing Set: WWS-24		

Note: The intent of this drawing is to show the correct application of Wetherby products and systems only. All other building elements are shown for illustrative purposes only and it is not intended to detail the building construction. Detail drawings must be read in conjunction with the Wetherby project specific specification with the specification information taking precedence.

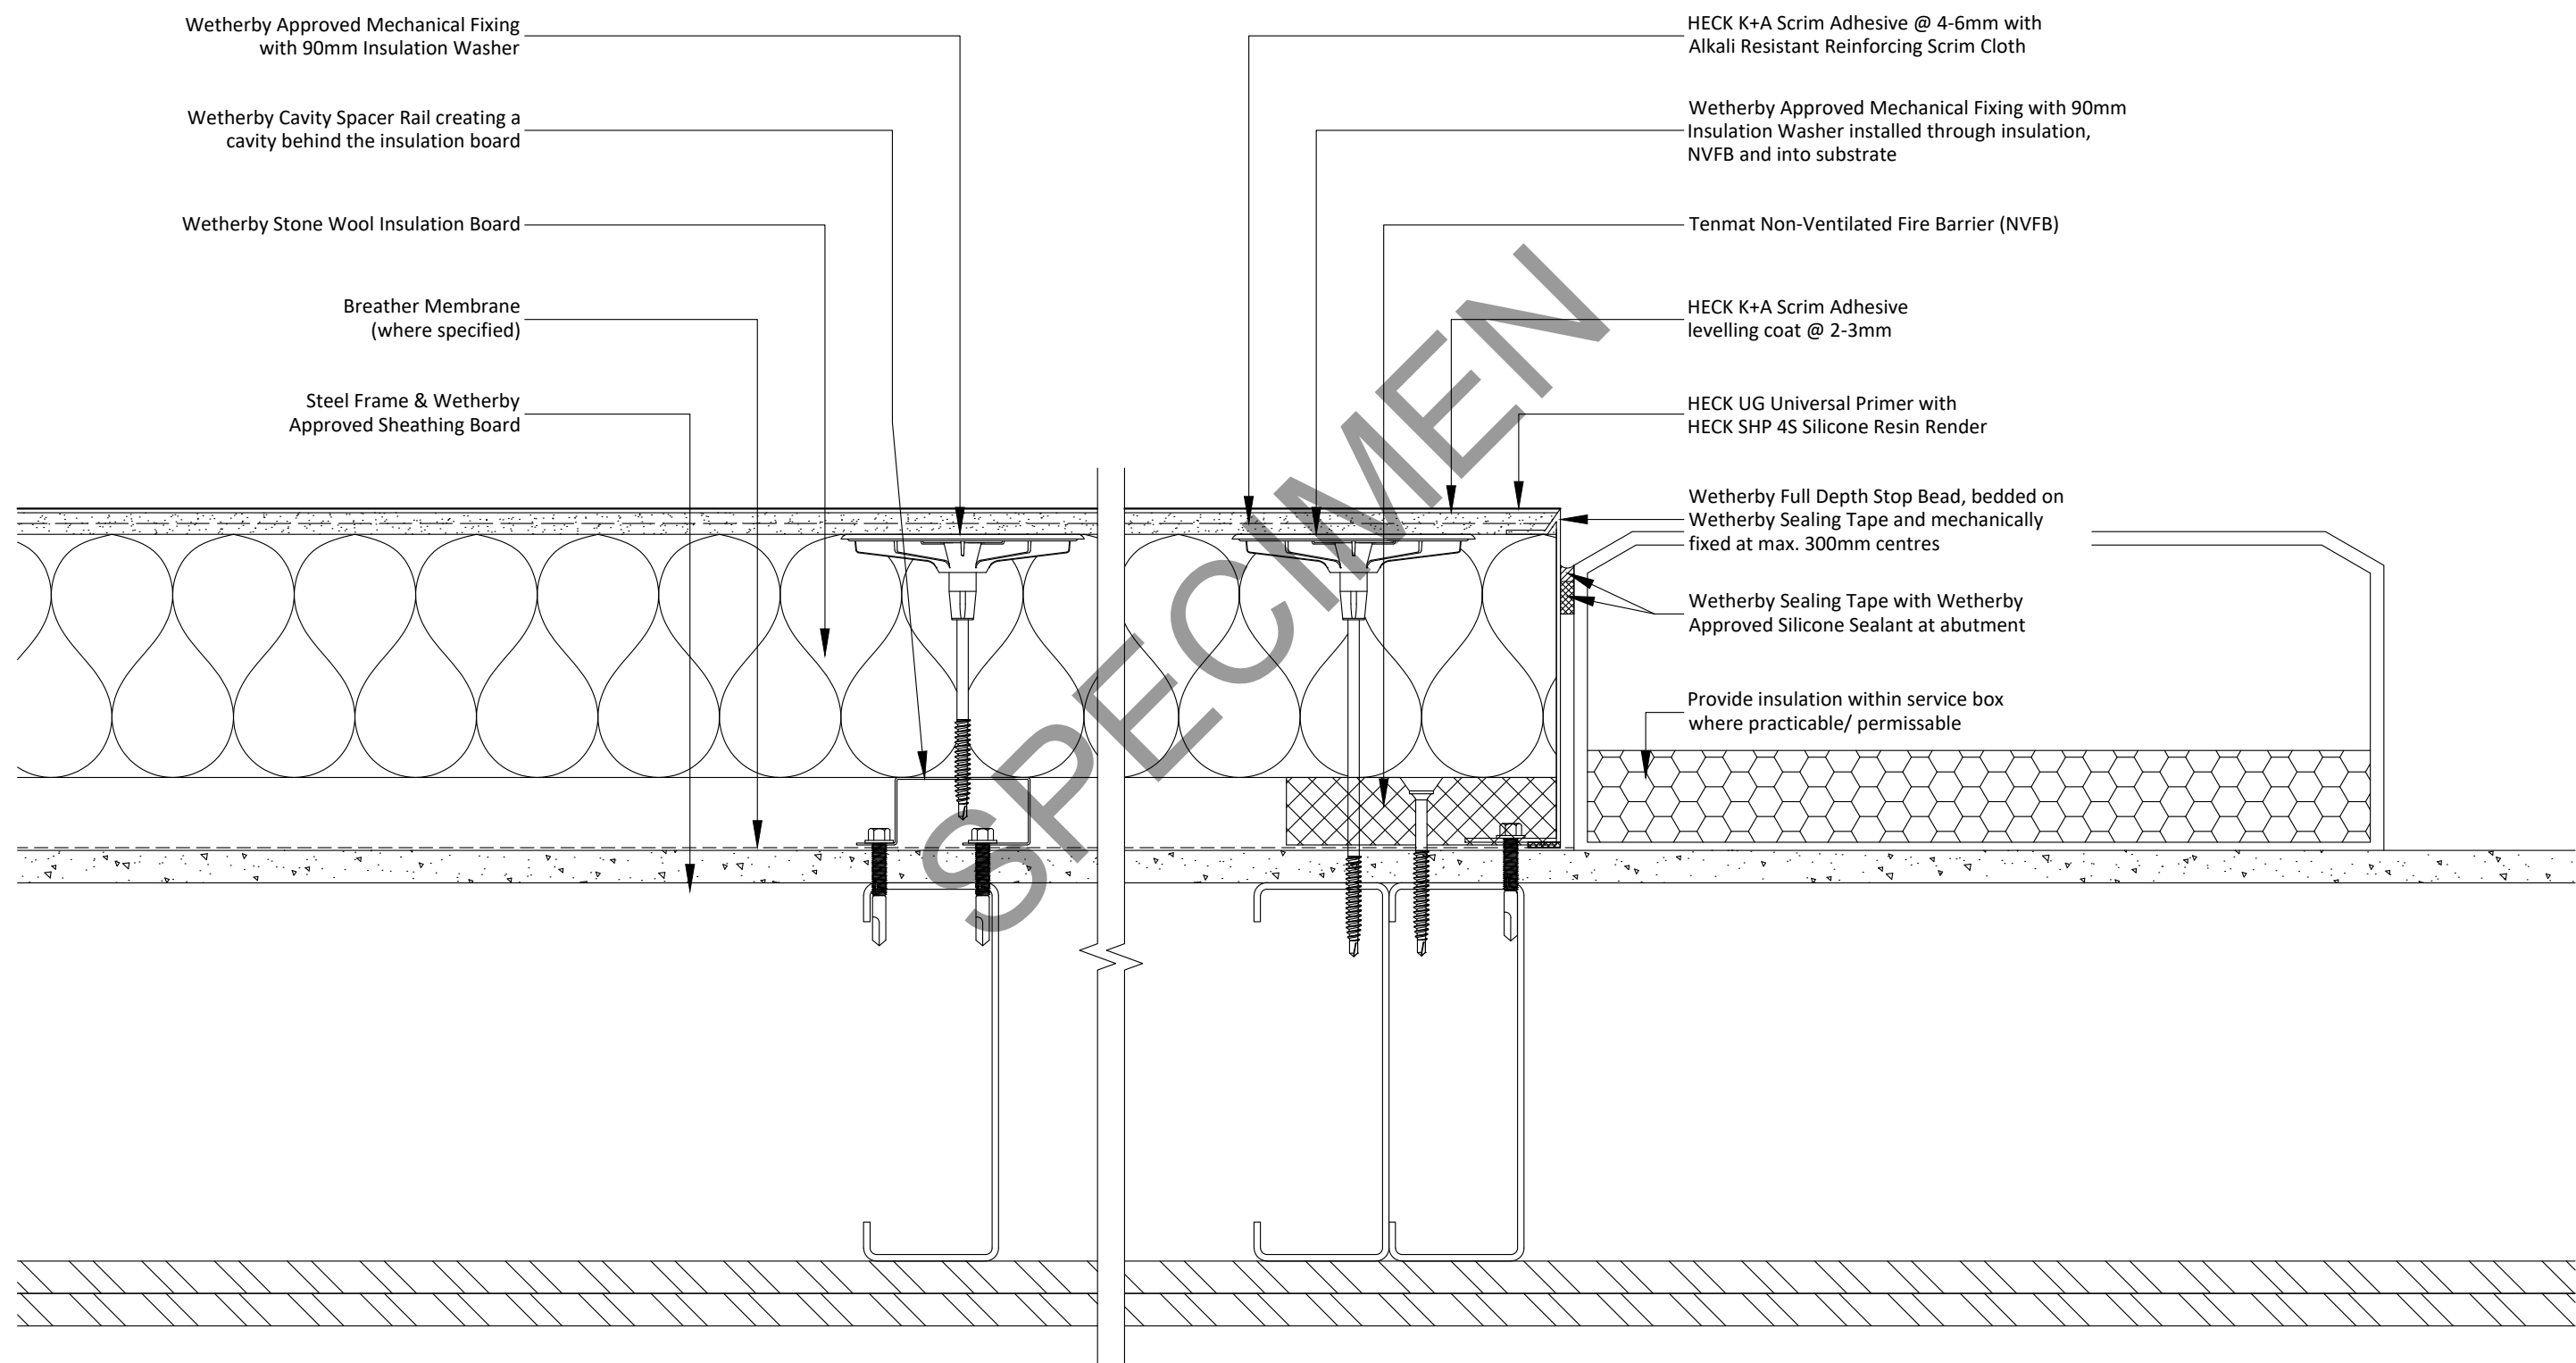


Notes:

- 1 - Tenmat Non-Ventilated Fire Barrier (NVFB) Closed State Cavity Fire Barrier must be installed under min. 2mm compression and must be mechanically fixed at max. 500mm centres and max. 250mm from each end.
- 2 - Detail creates a potential cold bridge. To be assessed and agreed specific to individual property.
- 3 - Existing service box must be in good condition.
- 4 - Refer to specification for the installation of external wall insulation ensuring safety and operation of fuel burning appliances V.1.0 31st March 2017'.
- 5 - Permission from the utility company may be required to allow the EWI system to be sealed against the service box.

Project Name:	Drawn by: N.K	Wetherby Wall Systems Ltd	WETHERBY Wall Systems 1 Kid Glove Road, Golborne, WA3 3GS Tel: 01942 717100 Fax: 01942 717101 Web: www.wall-systems.co.uk E-mail: technical@wall-systems.co.uk © WWS-LTD 1998-2025. All rights reserved
Typical Details - Stone Wool with Silicone Render	Checked by: J.R		
Drawing Title:	Revision: -		
Service Box Abutment Detail - Front Access	Scale: NTS		
Drawing No:	Date: 20.03.2026		
WWS-EWI-S-RR-SW-SIL-6001	Drawing Set: WWS-24		

Note: The intent of this drawing is to show the correct application of Wetherby products and systems only. All other building elements are shown for illustrative purposes only and it is not intended to detail the building construction. Detail drawings must be read in conjunction with the Wetherby project specific specification with the specification information taking precedence.

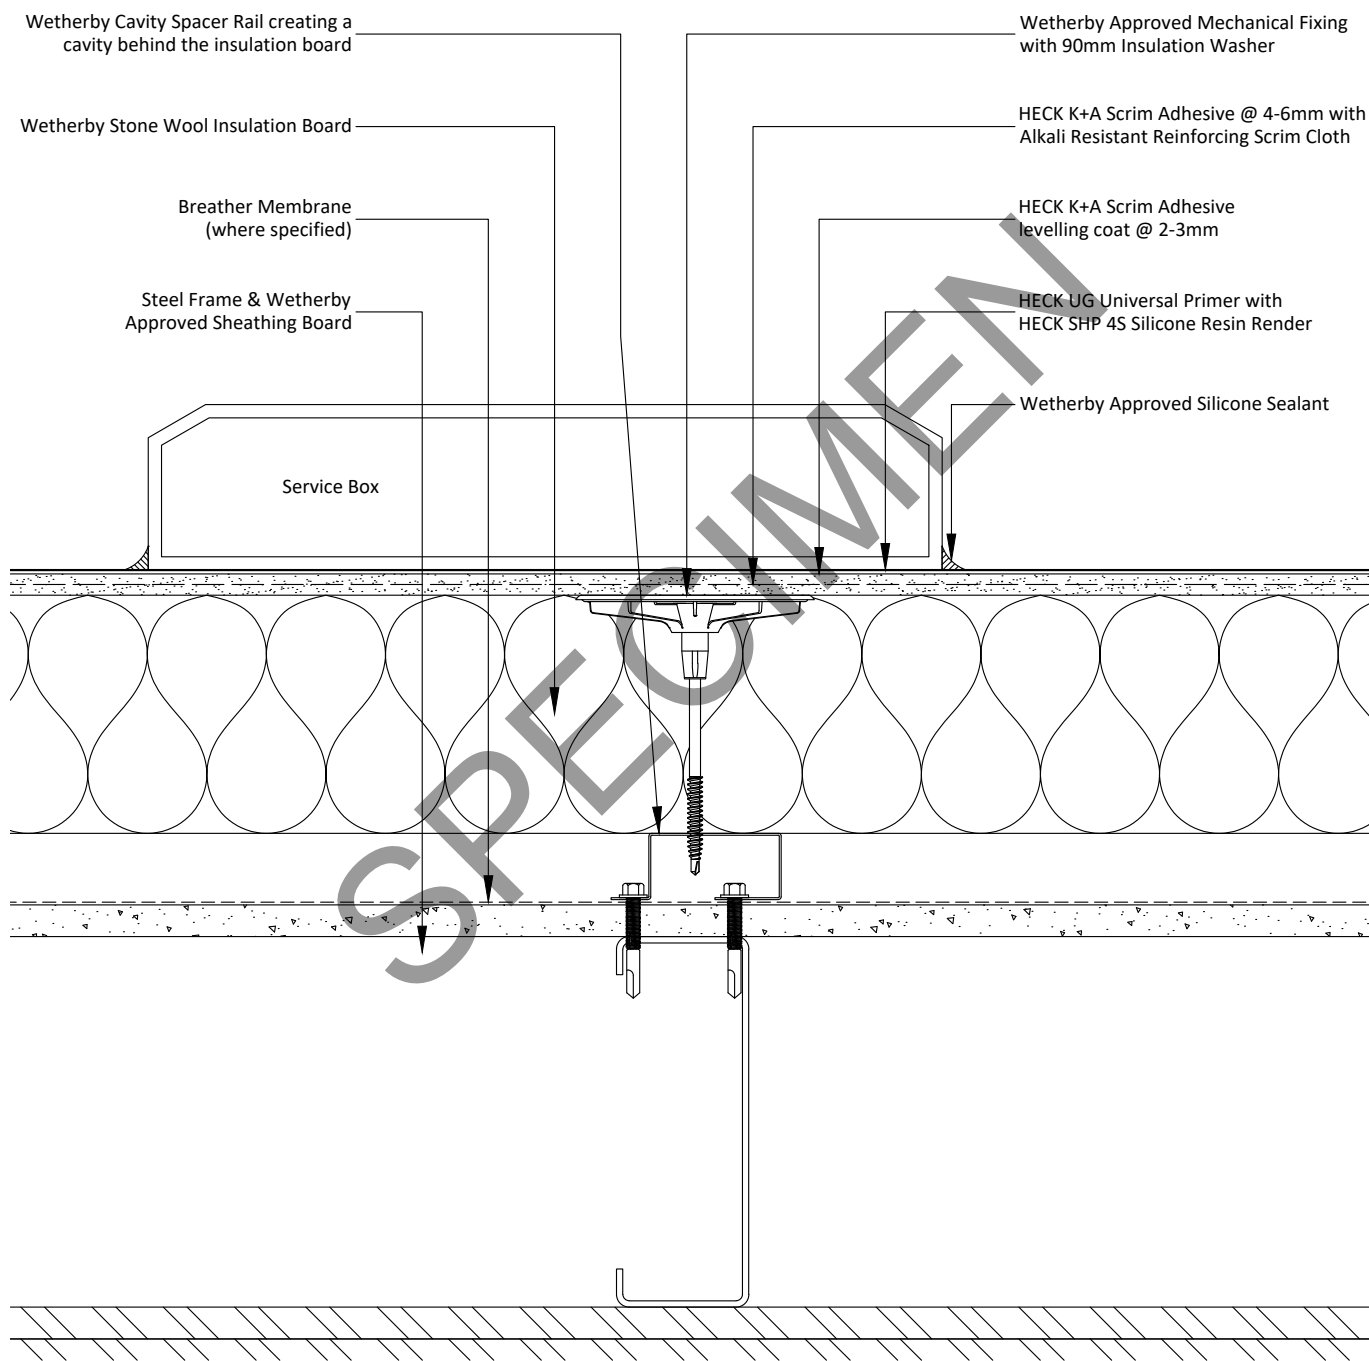


Notes:

- 1 - Service box removed and repositioned on the external face of the EWI system to ensure continuity of insulation.
- 2 - Movement of the service box should only be undertaken by the relevant party, i.e. Utility Company.
- 3 - Service box should be suitably fixed using approved fixings, fixing points to be sealed to ensure water tightness.

Project Name:	Drawn by: N.K	Wetherby Wall Systems Ltd	WETHERBY Wall Systems Part of ROCKWOOL Group 1 Kid Glove Road, Golborne, WA3 3GS Tel: 01942 717100 Fax: 01942 717101 Web: www.wall-systems.co.uk E-mail: technical@wall-systems.co.uk © WWS-LTD 1998-2025. All rights reserved
Typical Details - Stone Wool with Silicone Render	Checked by: J.R		
Drawing Title:	Revision: -		
Service Box Mounted Detail	Scale: NTS		
Drawing No:	Date: 20.03.2026		
WWS-EWI-S-RR-SW-SIL-6002	Drawing Set: WWS-24		

Note: The intent of this drawing is to show the correct application of Wetherby products and systems only. All other building elements are shown for illustrative purposes only and it is not intended to detail the building construction. Detail drawings must be read in conjunction with the Wetherby project specific specification with the specification information taking precedence.

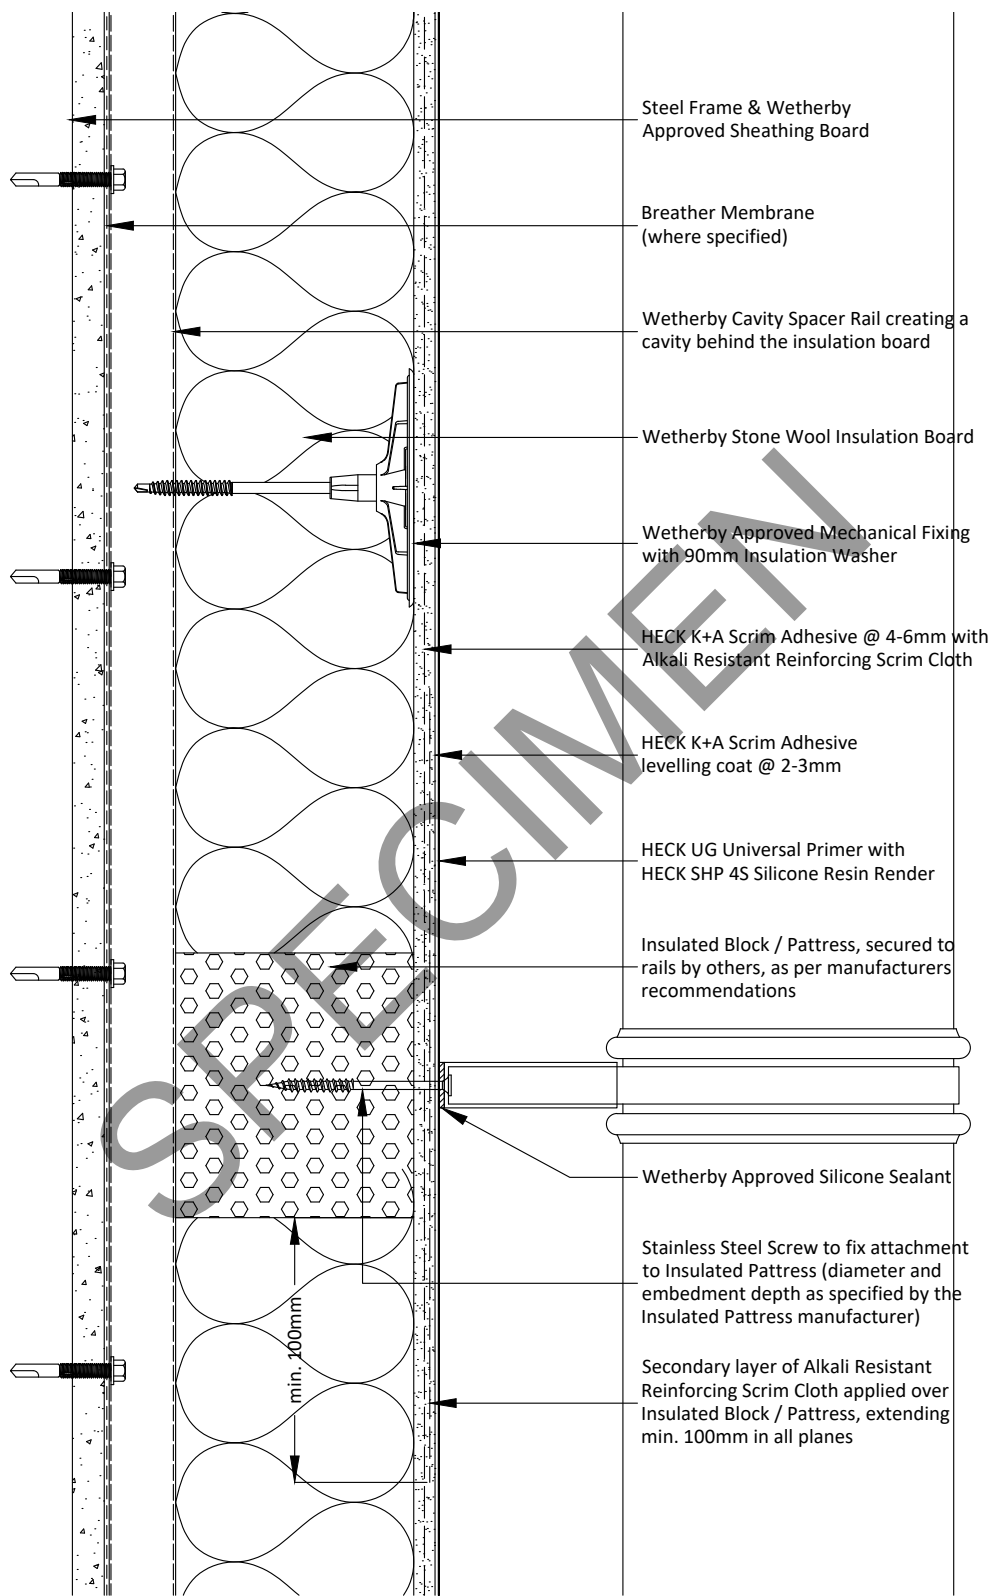

Notes:

- 1 - Insulated pattress must always be installed as per manufacturers recommendations.
- 2 - The suitability of any proposed insulated pattress to be confirmed by Wetherby Technical Department.
- 3 - Refer to insulated pattress manufacturer for allowable loadings.

Project Name:

Typical Details - Stone Wool with Silicone Render

Drawing Title:

Insulated Block / Pattress Detail

Drawing No:

WWS-EWI-S-RR-SW-SIL-6003

Drawn by: N.K

Checked by: J.R

Revision: -

Scale: NTS

Date: 20.03.2026

Drawing Set: WWS-24

Wetherby Wall Systems Ltd

WETHERBY
Wall Systems Part of ROCKWOOL Group

1 Kid Glove Road, Golborne, WA3 3GS


Tel: 01942 717100 Fax: 01942 717101

Web: www.wall-systems.co.uk

E-mail: technical@wall-systems.co.uk

© WWS-LTD 1998-2025. All rights reserved

Note: The intent of this drawing is to show the correct application of Wetherby products and systems only. All other building elements are shown for illustrative purposes only and it is not intended to detail the building construction. Detail drawings must be read in conjunction with the Wetherby project specific specification with the specification information taking precedence.

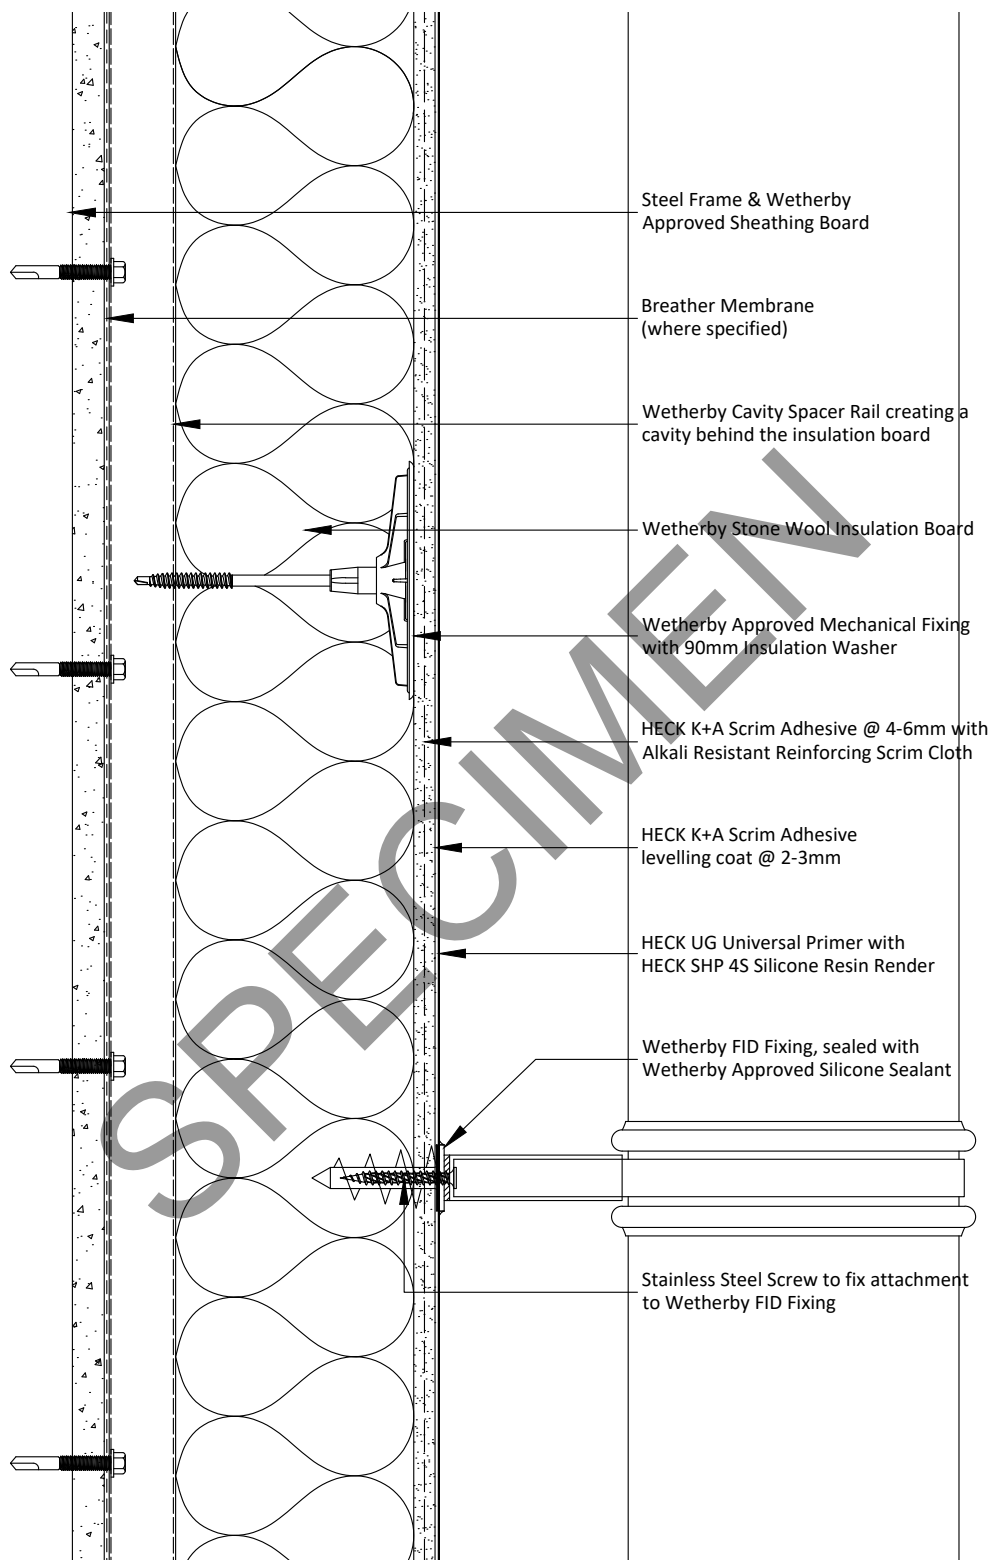

Notes:

- 1 - Pilot hole may be required.
 - 2 - FID50 can receive 4.5-5.0mm diameter screws whilst FID90 can only receive 6.0mm diameter screws.
 - 3 - FID fixings are not suitable for heavier attachments, e.g. cast iron RWP's, satellite dish etc.
- Refer to fixing manufacturer for allowable loadings.

Project Name:

Typical Details - Stone Wool with Silicone Render

Drawing Title:

Lightweight External Attachment Detail

Drawing No:

WWS-EWI-S-RR-SW-SIL-6004

Drawn by: N.K

Checked by: J.R

Revision: -

Scale: NTS

Date: 20.03.2026

Drawing Set: WWS-24

Wetherby Wall Systems Ltd

WETHERBY
Wall Systems Part of ROCKWOOL Group

1 Kid Glove Road, Golborne, WA3 3GS


Tel: 01942 717100 Fax: 01942 717101

Web: www.wall-systems.co.uk

E-mail: technical@wall-systems.co.uk

© WWS-LTD 1998-2025. All rights reserved

Note: The intent of this drawing is to show the correct application of Wetherby products and systems only. All other building elements are shown for illustrative purposes only and it is not intended to detail the building construction. Detail drawings must be read in conjunction with the Wetherby project specific specification with the specification information taking precedence.

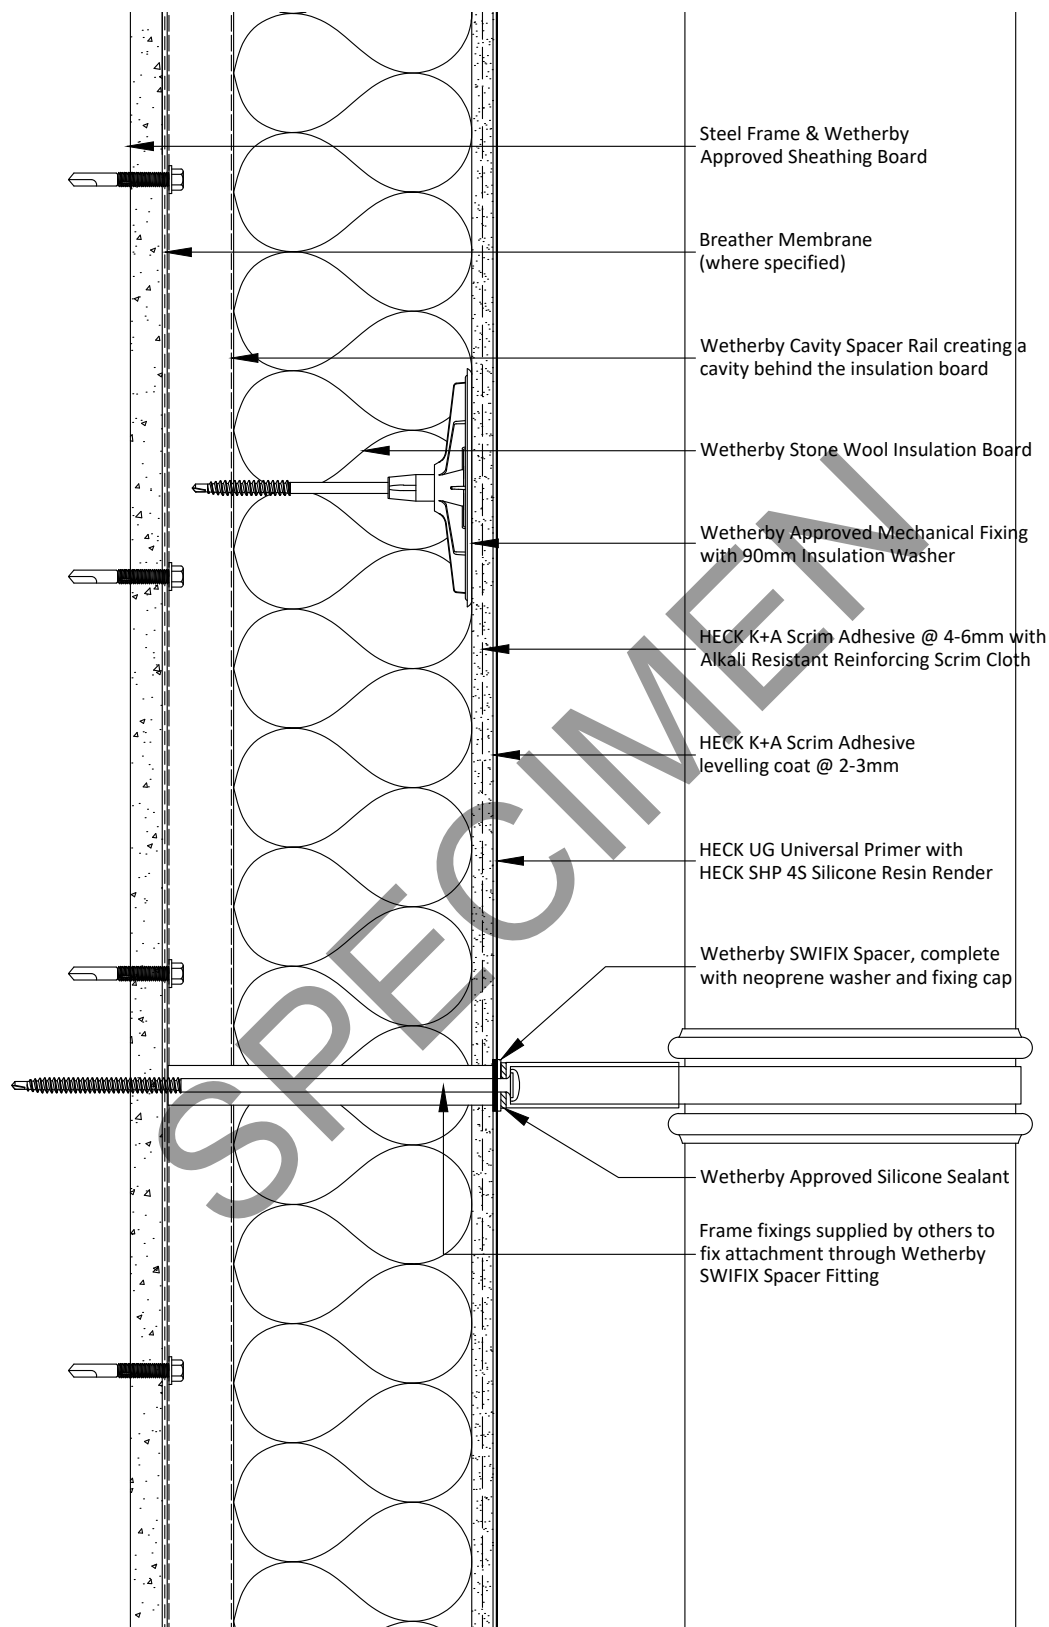

Notes:

- 1 - Wetherby SWIFIX Spacer to be cut to correct length prior to installation.
- 2 - Refer to fixing manufacturer for allowable loadings.

Project Name:

Typical Details - Stone Wool with Silicone Render

Drawing Title:

Heavy External Attachment Detail

Drawing No:

WWS-EWI-S-RR-SW-SIL-6005

Drawn by: N.K

Checked by: J.R

Revision: -

Scale: NTS

Date: 20.03.2026

Drawing Set: WWS-24

Wetherby Wall Systems Ltd

WETHERBY
Wall Systems Part of ROCKWOOL Group

1 Kid Glove Road, Golborne, WA3 3GS


Tel: 01942 717100 Fax: 01942 717101

Web: www.wall-systems.co.uk

E-mail: technical@wall-systems.co.uk

© WWS-LTD 1998-2025. All rights reserved

Note: The intent of this drawing is to show the correct application of Wetherby products and systems only. All other building elements are shown for illustrative purposes only and it is not intended to detail the building construction. Detail drawings must be read in conjunction with the Wetherby project specific specification with the specification information taking precedence.

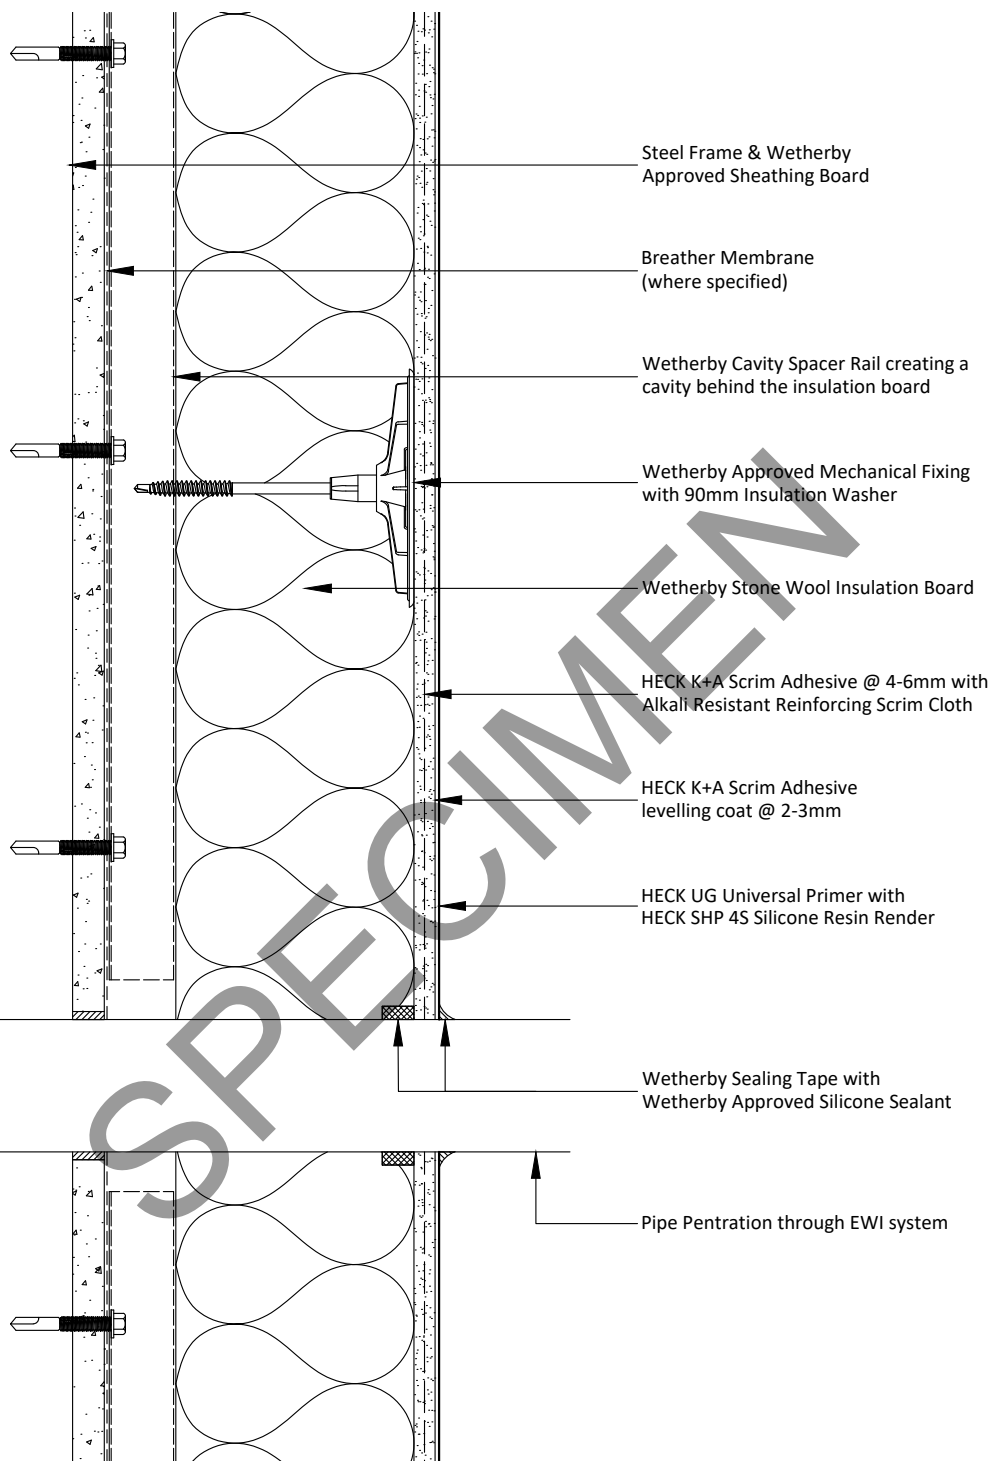

Notes:

- 1 - Detail may require Tenmat Non-Ventilated Fire Barrier (NVFB) Closed State Cavity Fire Barriers subject to the project specific fire strategy. Contact Wetherby Technical Department for further guidance.
- 2 - Any joints in the pipework must be located outside the EWI system for future access and maintenance.
- 3 - Where existing pipework cannot be extended (e.g. water waste overflow pipe), these should be oversleeved to project min. 40mm beyond the face of the finished system and sealed to the substrate and existing pipe.
- 4 - For retrospective installation of pipework within an existing EWI system, contact Wetherby Technical Department for specific guidance.

Project Name:

Typical Details - Stone Wool with Silicone Render

Drawing Title:

Pipe Penetration Detail

Drawing No:

WWS-EWI-S-RR-SW-SIL-6006

Drawn by: N.K

Checked by: J.R

Revision: -

Scale: NTS

Date: 20.03.2026

Drawing Set: WWS-24

Wetherby Wall Systems Ltd

WETHERBY
Wall Systems Part of ROCKWOOL Group

1 Kid Glove Road, Golborne, WA3 3GS


Tel: 01942 717100 Fax: 01942 717101

Web: www.wall-systems.co.uk

E-mail: technical@wall-systems.co.uk

© WWS-LTD 1998-2025. All rights reserved

Note: The intent of this drawing is to show the correct application of Wetherby products and systems only. All other building elements are shown for illustrative purposes only and it is not intended to detail the building construction. Detail drawings must be read in conjunction with the Wetherby project specific specification with the specification information taking precedence.

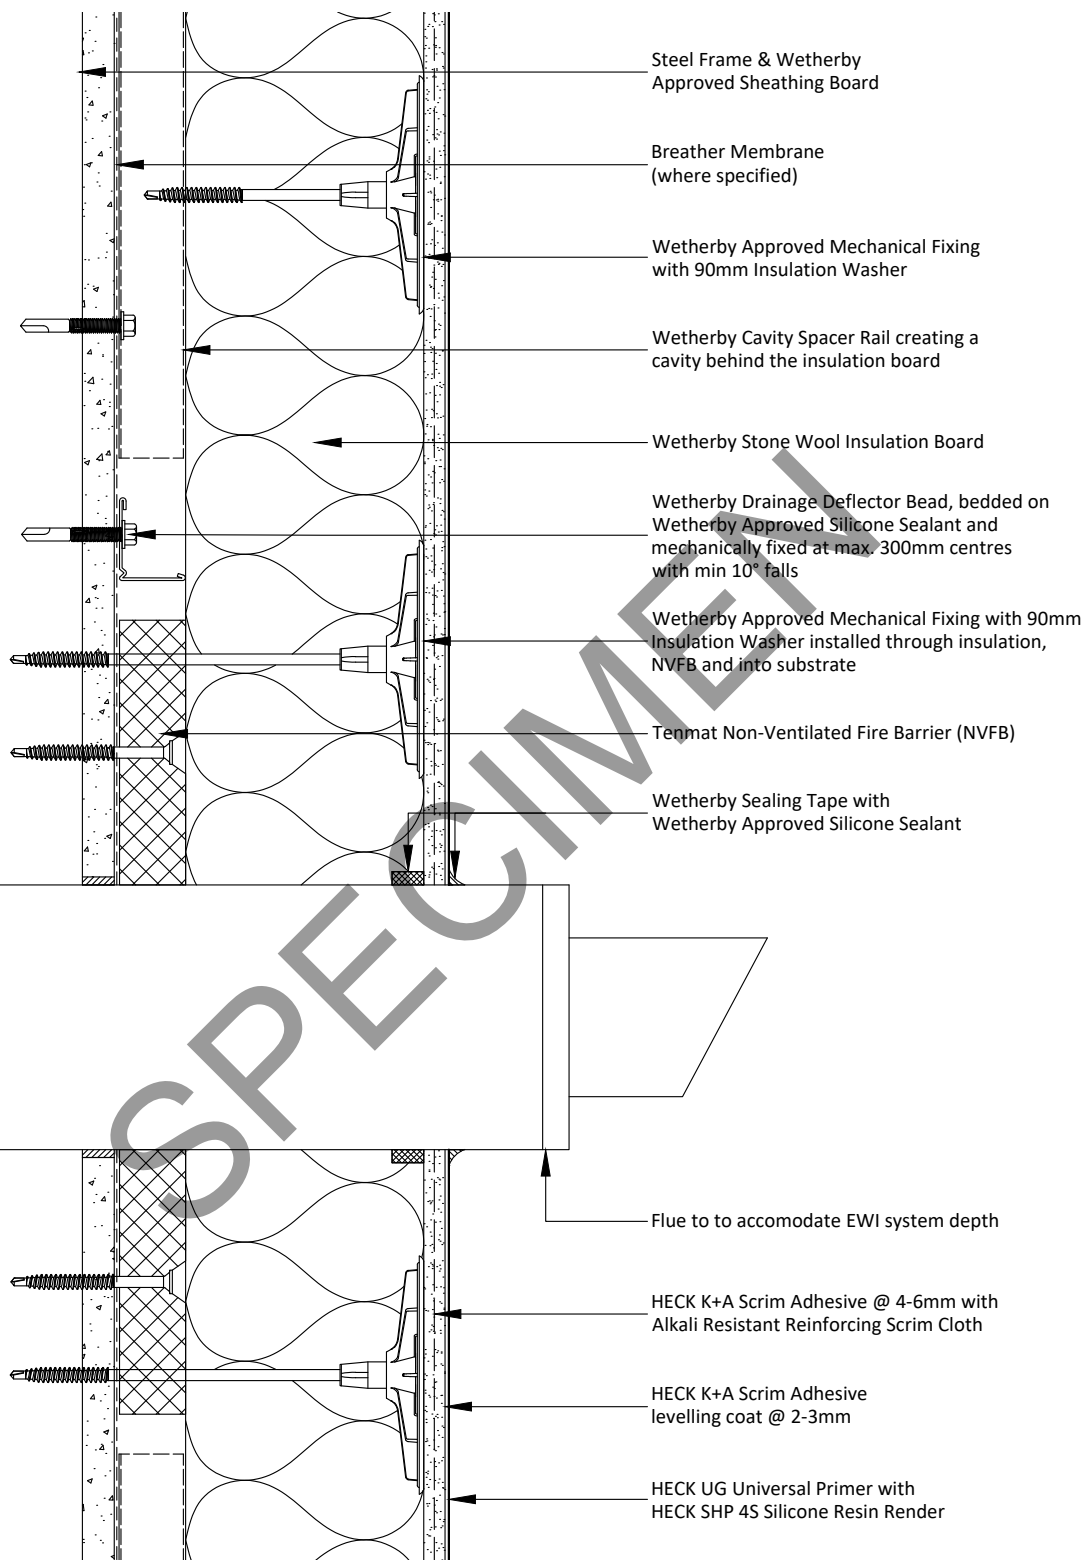

Notes:

- 1 - Tenmat Non-Ventilated Fire Barrier (NVFB) Closed State Cavity Fire Barrier must be installed under min. 2mm compression and must be mechanically fixed at max. 500mm centres and max. 250mm from each end.
- 2 - Detail is only suitable where flue has sufficient depth to accommodate the thickness of the EWI System.
- 3 - Where existing flue depth is insufficient, contact Wetherby Technical Department for further guidance.

Project Name:

Typical Details - Stone Wool with Silicone Render

Drawing Title:

Flue Detail

Drawing No:

WWS-EWI-S-RR-SW-SIL-6007

Drawn by: N.K

Checked by: J.R

Revision: -

Scale: NTS

Date: 20.03.2026

Drawing Set: WWS-24

Wetherby Wall Systems Ltd

WETHERBY
Wall Systems Part of ROCKWOOL Group

1 Kid Glove Road, Golborne, WA3 3GS


Tel: 01942 717100 Fax: 01942 717101

Web: www.wall-systems.co.uk

E-mail: technical@wall-systems.co.uk

© WWS-LTD 1998-2025. All rights reserved

Note: The intent of this drawing is to show the correct application of Wetherby products and systems only. All other building elements are shown for illustrative purposes only and it is not intended to detail the building construction. Detail drawings must be read in conjunction with the Wetherby project specific specification with the specification information taking precedence.

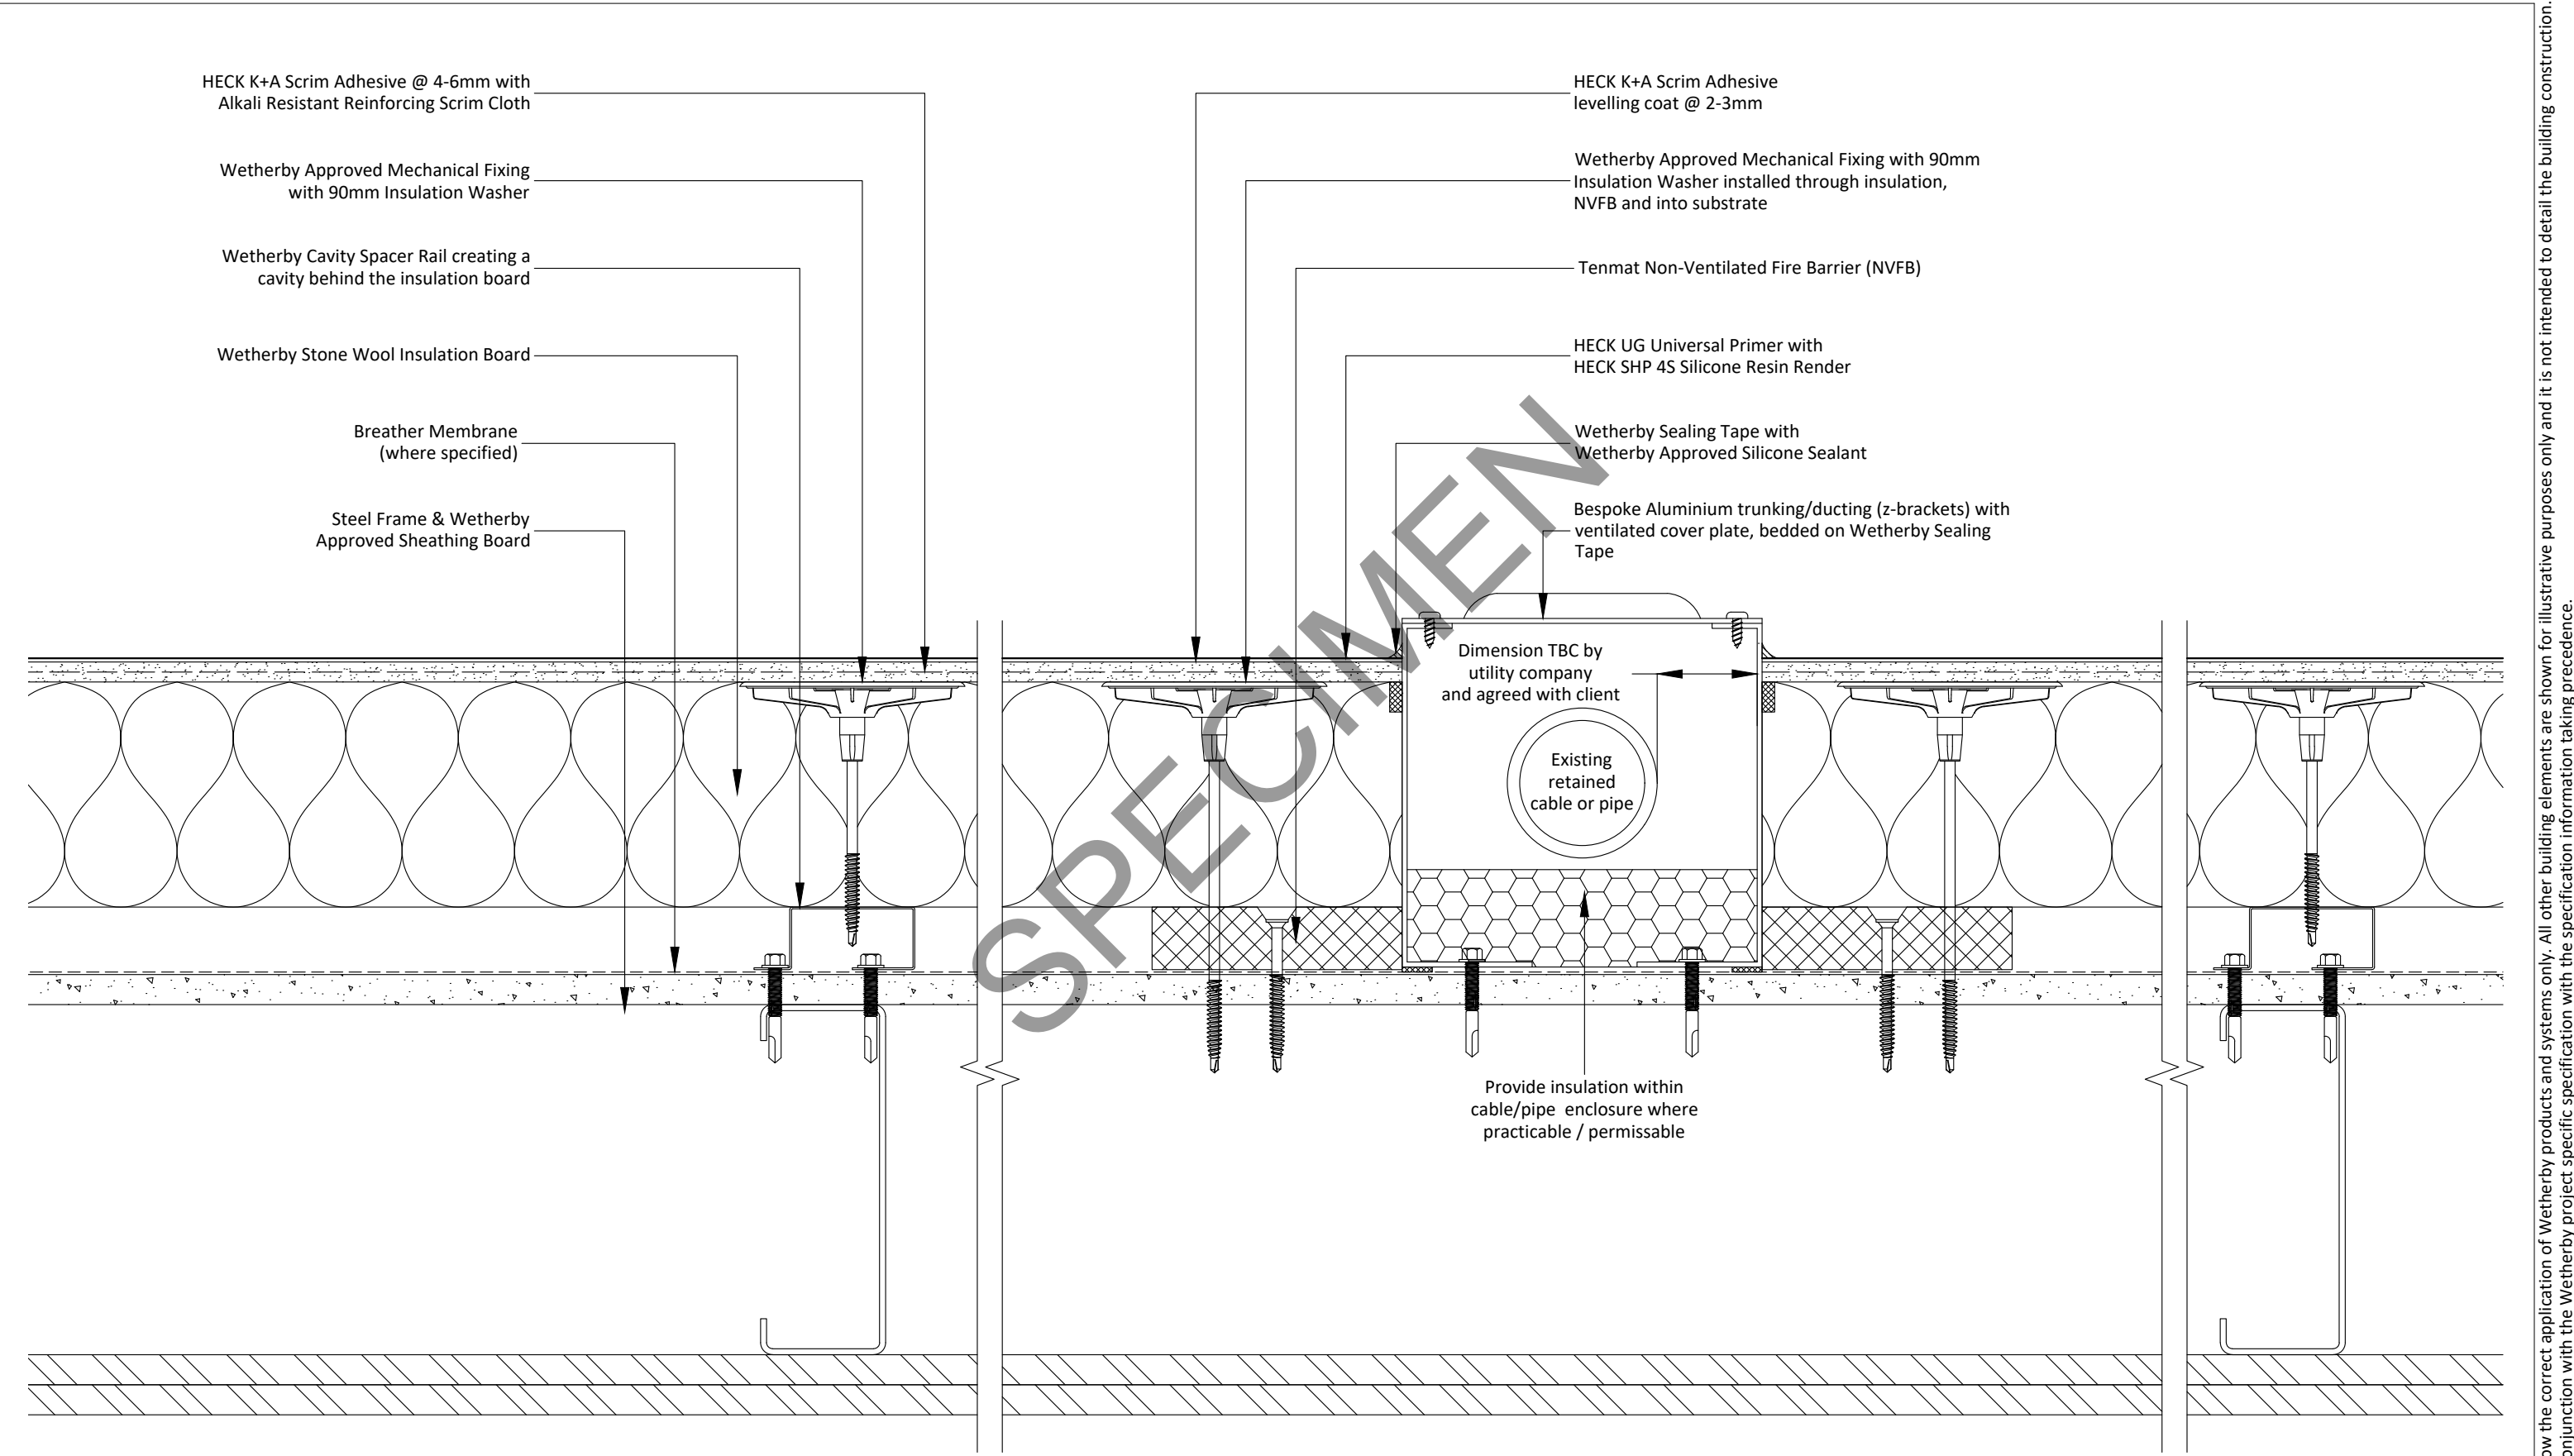

- Notes:**
- 1 - Tenmat Non-Ventilated Fire Barrier (NVFB) Closed State Cavity Fire Barrier must be installed under min. 2mm compression and must be mechanically fixed at max. 500mm centres and max. 250mm from each end.
 - 2 - Aluminium trunking/ducting must be suitably designed to suit the required EWI system thickness
 - 3 - For gas pipes, enclosures must have removable ventilated covers in accordance with the 'Specification for the installation of external wall insulation ensuring safety and operation of fuel burning appliances V.1.0 31st March 2017'. Ensure that the EWI system is fully sealed to the wall to prevent gas entry into the system.
 - 4 - Ventilation rate to be confirmed by utility company.

Project Name:	Drawn by: N.K
Typical Details - Stone Wool with Silicone Render	Checked by: J.R
Drawing Title:	Revision: -
Gas Pipe / Electrical Service Enclosure Detail	Scale: NTS
Drawing No:	Date: 20.03.2026
WWS-EWI-S-RR-SW-SIL-6008	Drawing Set: WWS-24

Wetherby Wall Systems Ltd


WETHERBY

Wall Systems

Part of ROCKWOOL Group

1 Kid Glove Road, Golborne, WA3 3GS
Tel: 01942 717100 Fax: 01942 717101
Web: www.wall-systems.co.uk
E-mail: technical@wall-systems.co.uk
© WWS-LTD 1998-2025. All rights reserved

Note: The intent of this drawing is to show the correct application of Wetherby products and systems only. All other building elements are shown for illustrative purposes only and it is not intended to detail the building construction. Detail drawings must be read in conjunction with the Wetherby project specific specification with the specification information taking precedence.

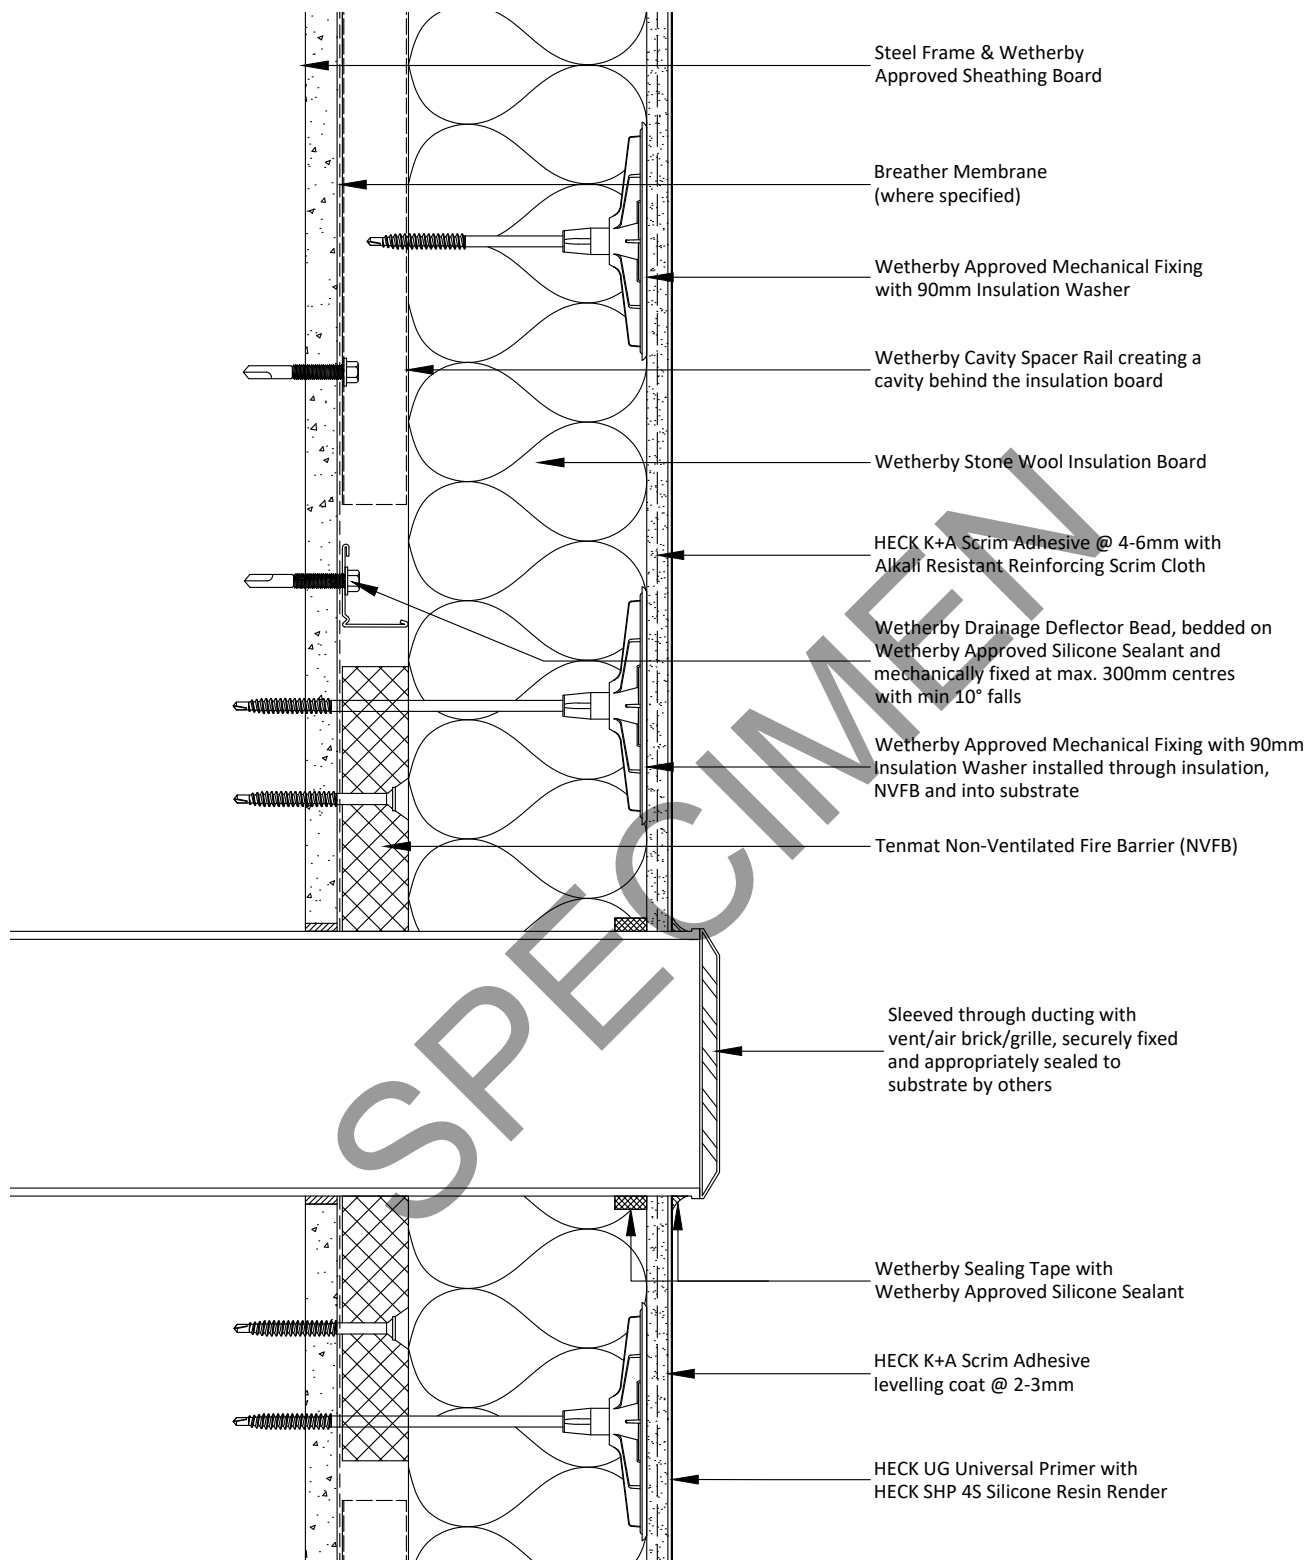


Notes:

- 1 - Tenmat Non-Ventilated Fire Barrier (NVFB) Closed State Cavity Fire Barrier must be installed under min. 2mm compression and must be mechanically fixed at max. 500mm centres and max. 250mm from each end.
- 2 - Sleeved ducting must be suitably designed to suit the required EWI system thickness.
- 3 - Ventilation rate to be confirmed by manufacturer or specialist contractor.

Project Name:	Drawn by: N.K	Wetherby Wall Systems Ltd	 1 Kid Glove Road, Golborne, WA3 3GS Tel: 01942 717100 Fax: 01942 717101 Web: www.wall-systems.co.uk E-mail: technical@wall-systems.co.uk © WWS-LTD 1998-2025. All rights reserved
Typical Details - Stone Wool with Silicone Render	Checked by: J.R		
Drawing Title:	Revision: -		
Vent Detail	Scale: NTS		
Drawing No:	Date: 20.03.2026		
WWS-EWI-S-RR-SW-SIL-6009	Drawing Set: WWS-24		

Note: The intent of this drawing is to show the correct application of Wetherby products and systems only. All other building elements are shown for illustrative purposes only and it is not intended to detail the building construction. Detail drawings must be read in conjunction with the Wetherby project specific specification with the specification information taking precedence.

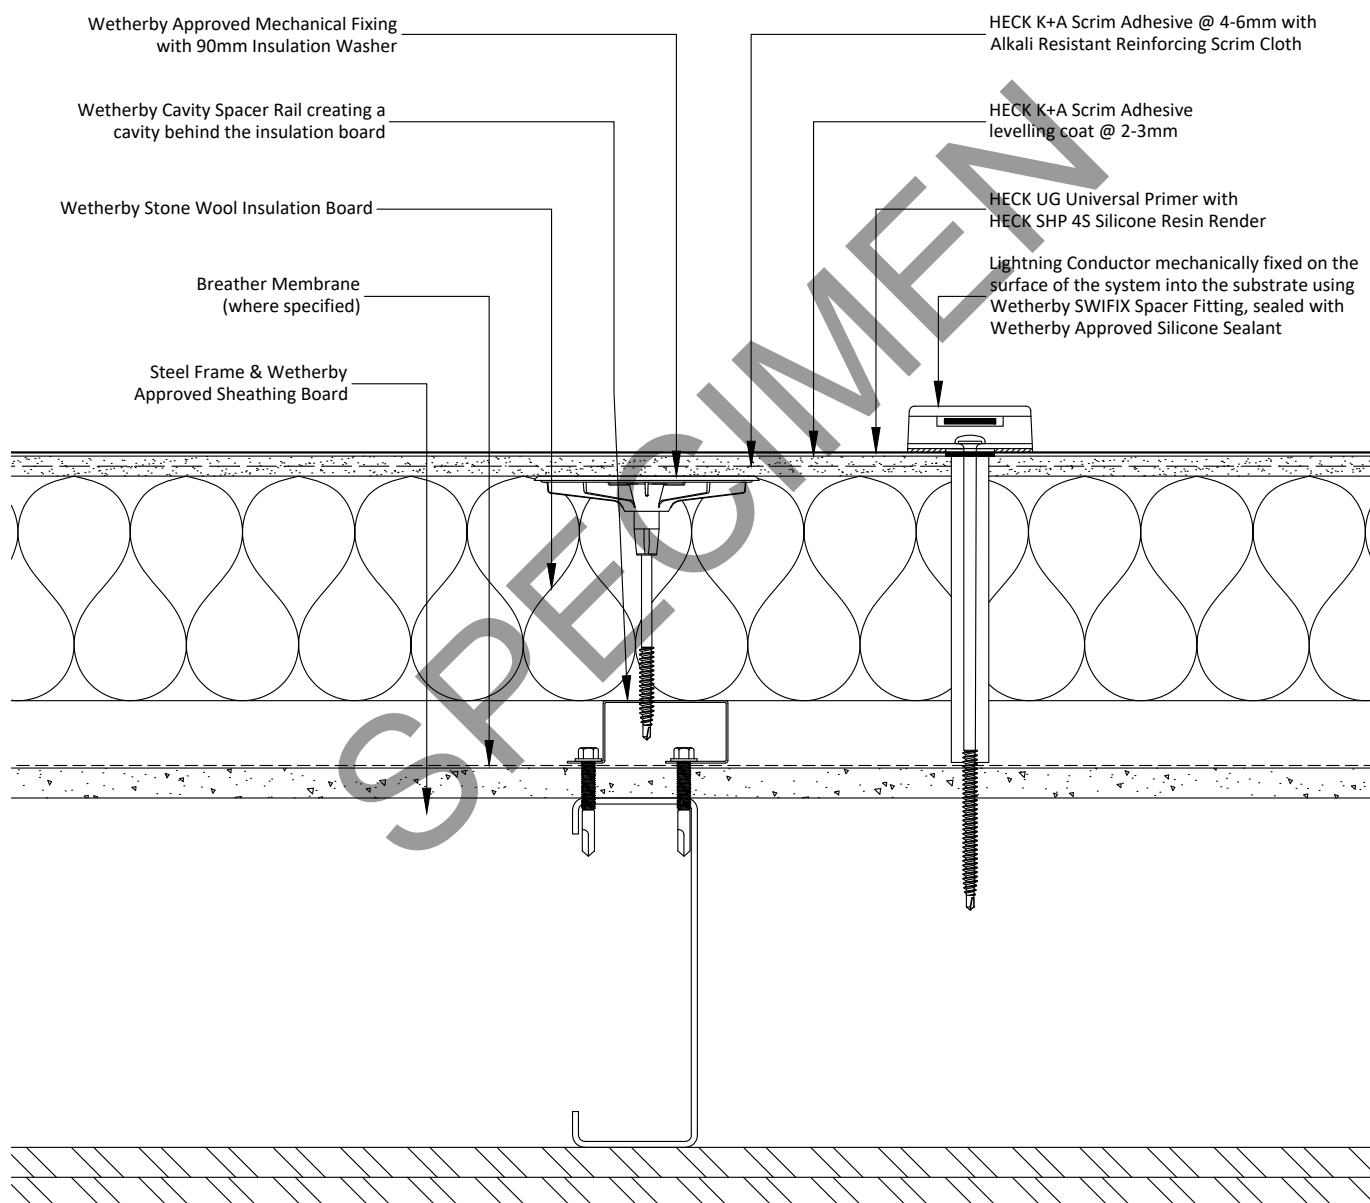


Notes:

- 1 - Wetherby Approved Silicone Sealant to be applied to any fixing points to prevent potential water ingress.

Project Name:	Drawn by: N.K	Wetherby Wall Systems Ltd	WETHERBY Wall Systems Part of ROCKWOOL Group 1 Kid Glove Road, Golborne, WA3 3GS Tel: 01942 717100 Fax: 01942 717101 Web: www.wall-systems.co.uk E-mail: technical@wall-systems.co.uk © WWS-LTD 1998-2025. All rights reserved
Typical Details - Stone Wool with Silicone Render	Checked by: J.R		
Drawing Title:	Revision: -		
Lightning Conductor Detail	Scale: NTS		
Drawing No:	Date: 20.03.2026		
WWS-EWI-S-RR-SW-SIL-6010	Drawing Set: WWS-24		

Note: The intent of this drawing is to show the correct application of Wetherby products and systems only. All other building elements are shown for illustrative purposes only and it is not intended to detail the building construction. Detail drawings must be read in conjunction with the Wetherby project specific specification with the specification information taking precedence.

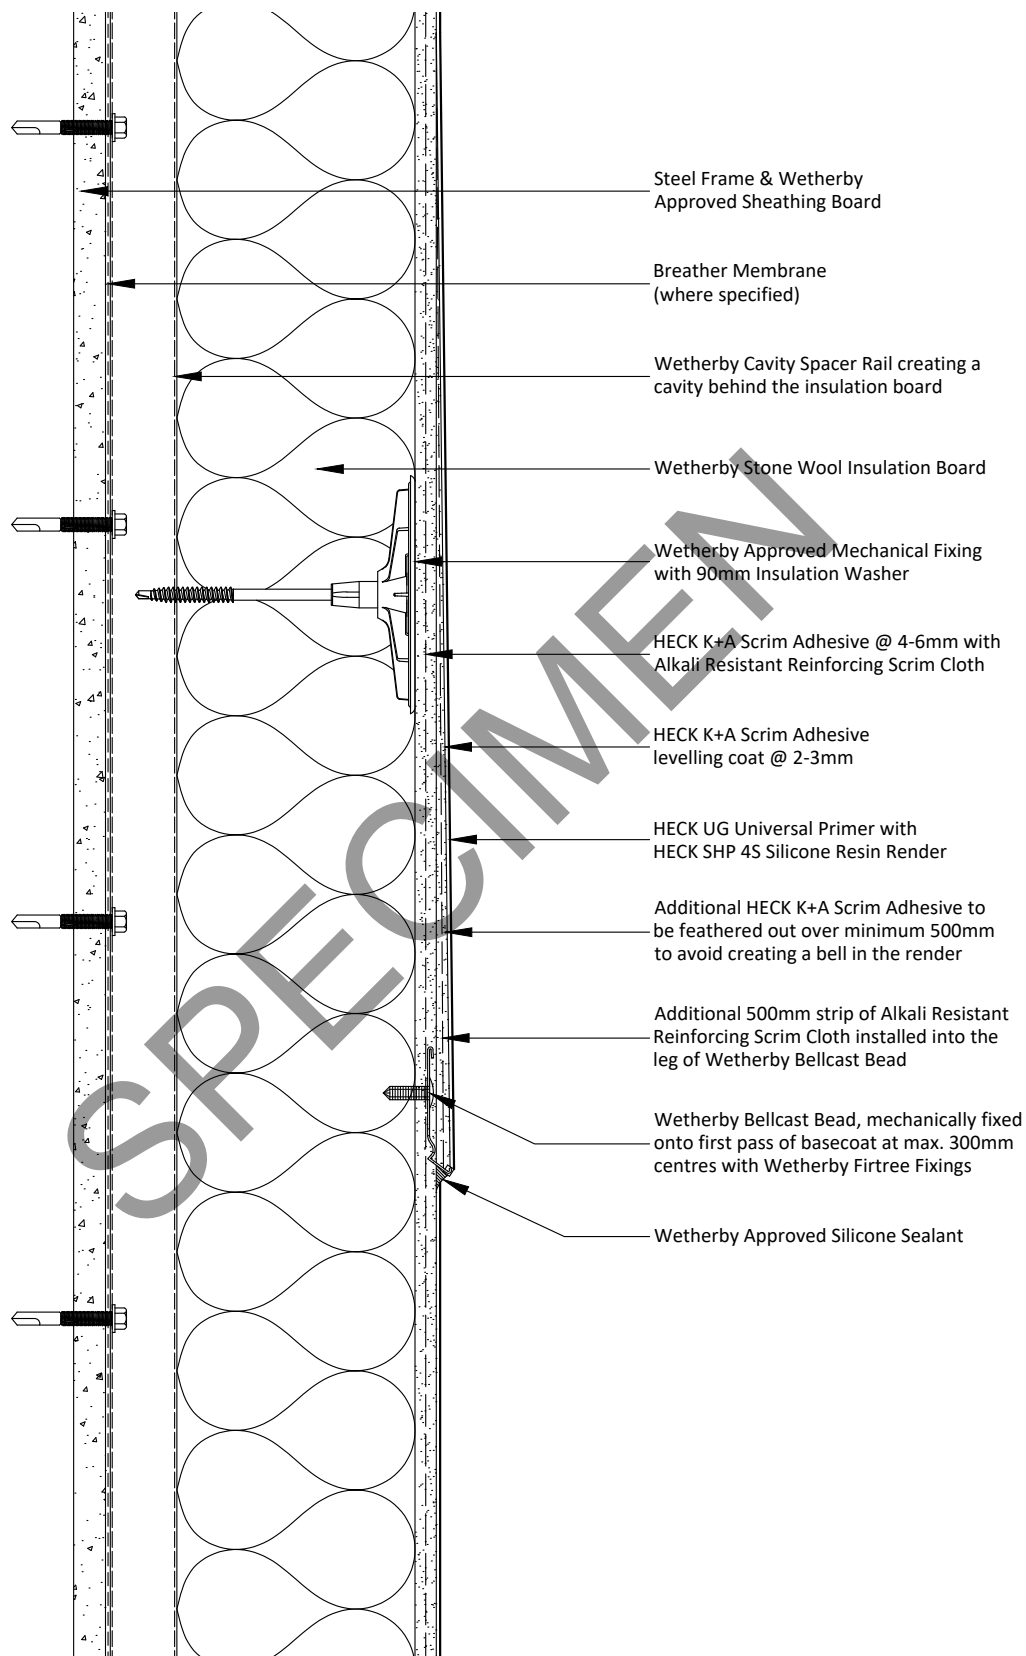

Notes:

1 - Render system must be feathered out to bellcast bead over a minimum distance of 500mm.

Project Name:

Typical Details - Stone Wool with Silicone Render

Drawing Title:

Bellcast Bead Detail

Drawing No:

WWS-EWI-S-RR-SW-SIL-7000

Drawn by: N.K

Checked by: J.R

Revision: -

Scale: NTS

Date: 20.03.2026

Drawing Set: WWS-24

Wetherby Wall Systems Ltd

WETHERBY
Wall Systems Part of ROCKWOOL Group

1 Kid Glove Road, Golborne, WA3 3GS

Tel: 01942 717100 Fax: 01942 717101

Web: www.wall-systems.co.uk

E-mail: technical@wall-systems.co.uk

© WWS-LTD 1998-2025. All rights reserved

Note: The intent of this drawing is to show the correct application of Wetherby products and systems only. All other building elements are shown for illustrative purposes only and it is not intended to detail the building construction. Detail drawings must be read in conjunction with the Wetherby project specific specification with the specification information taking precedence.